

# EWRC 300/500 NT

Controllers for cold rooms for on-board installation



**USER  
MANUAL**

# CONTENTS



|   |           |
|---|-----------|
| <b>1. INTRODUCTION .....</b>  | <b>5</b>  |
| <b>1.1. GENERAL DESCRIPTION .....</b>   | <b>5</b>  |
| <b>1.2. ADVANTAGES AND FEATURES .....</b>   | <b>5</b>  |
| <b>1.3. MODELS .....</b>  | <b>5</b>  |
| <b>2. TECHNICAL DATA .....</b>  | <b>6</b>  |
| <b>2.1. TECHNICAL SPECIFICATIONS (EN 60730-2-9) .....</b>                         | <b>6</b>  |
| <b>2.2. FURTHER INFORMATION .....</b>   | <b>6</b>  |
| 2.2.1. INPUT CHARACTERISTICS .....  | 6         |
| 2.2.2. OUTPUT CHARACTERISTICS .....   | 7         |
| 2.2.3. MECHANICAL CHARACTERISTICS .....   | 7         |
| 2.2.4. FOOD SAFETY .....  | 7         |
| <b>2.3. DISPOSAL .....</b>  | <b>7</b>  |
| <b>3. CONNECTIONS.....</b>  | <b>8</b>  |
| <b>3.1. GENERAL WARNINGS .....</b>  | <b>8</b>  |
| 3.1.1. POWER SUPPLY - DANGEROUS VOLTAGE OUTPUTS (RELAY).....                      | 8         |
| 3.1.2. ANALOGUE INPUTS-PROBES.....  | 8         |
| 3.1.3. SERIAL CONNECTIONS .....   | 8         |
| 3.1.4. RS485 CONNECTION .....   | 8         |
| 3.1.5. TTL CONNECTION .....   | 8         |
| <b>3.2. WIRING DIAGRAM .....</b>  | <b>9</b>  |
| 3.2.1. TERMINALS .....  | 9         |
| <b>3.3. WIRING DIAGRAM FOR MODELS WITH MAGNETO-THERMAL SWITCH INSTALLED .....</b> | <b>10</b> |
| 3.3.1. TERMINALS .....  | 10        |
| <b>4. MECHANICAL INSTALLATION .....</b>   | <b>11</b> |
| <b>4.1. MECHANICAL INSTALLATION.....</b>  | <b>11</b> |
| 4.1.1. WALL-MOUNTING .....  | 11        |
| <b>5. USER AND START-UP INTERFACE .....</b>                                       | <b>14</b> |
| <b>5.1. DISPLAY .....</b>   | <b>14</b> |
| 5.1.1. KEYS.....  | 14        |
| 5.1.2. LEDS.....  | 15        |
| 5.1.3. PRELIMINARY CONFIGURATIONS.....  | 16        |
| 5.1.4. OPERATION IN DEFAULT CONFIGURATION .....                                   | 16        |
| 5.1.5. NAVIGATION .....   | 17        |
| 5.1.6. FUNCTIONS MENU AND KEY-ACTIVATED FUNCTIONS.....                            | 18        |
| 5.1.7. PASSWORD .....   | 19        |
| 5.1.8. SETTING THE SETPOINT .....   | 20        |
| 5.1.9. VIEWING PROBE VALUES .....   | 21        |
| 5.1.10. HOW TO MODIFY THE DATE AND TIME .....                                     | 22        |
| 5.1.11. DISPLAYING ALARMS .....   | 23        |
| 5.1.12. SYSTEM ALARMS EXAMPLE .....   | 23        |
| 5.1.13. MODIFYING A PARAMETER .....   | 24        |
| 5.1.13.1 How to modify a user parameter .....                                     | 24        |
| 5.1.13.2 How to modify an Installer parameter .....                               | 25        |



|   |           |
|---|-----------|
| <b>6. FUNCTIONS AND REGULATORS.....</b>             | <b>26</b> |
| <b>6.1. SETTINGS .....</b>                          | <b>26</b> |
| 6.1.1. PROBE SETTING AND CALIBRATION .....          | 26        |
| 6.1.2. DISPLAY SETTINGS .....                       | 26        |
| <b>6.2. FUNCTIONS .....</b>                         | <b>27</b> |
| 6.2.1. UPLOAD, DOWNLOAD, FORMAT .....               | 27        |
| 6.2.2. MULTI FUNCTION KEY .....                     | 28        |
| 6.2.3. UNICARD.....                                 | 28        |
| <b>6.3. BOOT LOADER FIRMWARE.....</b>               | <b>29</b> |
| <b>6.4. COMPRESSOR .....</b>                        | <b>30</b> |
| 6.4.1. COMPRESSOR CONFIGURATION .....               | 30        |
| 6.4.2. SECOND COMPRESSOR CONFIGURATION.....         | 30        |
| 6.4.3. COMPRESSOR OPERATING CONDITIONS.....         | 30        |
| <b>6.5. COMPRESSOR/GENERAL PROTECTIONS.....</b>     | <b>31</b> |
| 6.5.1. COMPRESSOR SAFETY TIMINGS.....               | 32        |
| <b>6.6. DEFROST/DRIPPING .....</b>                  | <b>33</b> |
| 6.6.1. DEFROST TYPE AND ACTIVATION .....            | 33        |
| 6.6.2. AUTOMATIC DEFROSTING .....                   | 34        |
| 6.6.3. MANUAL DEFROST.....                          | 34        |
| 6.6.4. EXTERNAL DEFROST.....                        | 35        |
| <b>6.7. DEFROST MODE .....</b>                      | <b>36</b> |
| 6.7.1. DEFROST WITH ELECTRIC HEATERS .....          | 36        |
| 6.7.2. INVERSE DEFROST.....                         | 37        |
| 6.7.3. DOUBLE EVAPORATOR DEFROST .....              | 38        |
| <b>6.8. EVAPORATOR FANS.....</b>                    | <b>40</b> |
| 6.8.1. EVAPORATOR FAN OPERATING CONDITIONS .....    | 40        |
| 6.8.2. FAN OPERATION IN THERMOREGULATION MODE.....  | 41        |
| 6.8.3. FAN OPERATION IN DUTY CYCLE MODE.....        | 41        |
| 6.8.4. FAN OPERATION IN DEFROST.....                | 42        |
| 6.8.4.1 Fan operation without probe .....           | 42        |
| 6.8.5. FAN FUNCTION DURING DRIPPING .....           | 43        |
| 6.8.6. POST-VENTILATION.....                        | 43        |
| <b>6.9. DEEP COOLING CYCLE - DCC .....</b>          | <b>44</b> |
| <b>6.10. PREHEAT.....</b>                           | <b>44</b> |
| <b>6.11. PRESSURE SWITCH .....</b>                  | <b>45</b> |
| 6.11.1. AUXILIARY OUTPUT (AUX/LIGHT).....           | 46        |
| <b>6.12. DOOR/EXTERNAL ALARM MANAGEMENT .....</b>   | <b>47</b> |
| <b>6.13. DEMISTING HEATERS (FRAME HEATERS).....</b> | <b>49</b> |
| <b>6.14. CONDENSER FANS .....</b>                   | <b>50</b> |
| <b>6.15. STAND-BY .....</b>                         | <b>51</b> |
| <b>6.16. PUMP DOWN.....</b>                         | <b>51</b> |
| 6.16.1. SERVICE STOPPAGE .....                      | 51        |



|  |           |
|--|-----------|
| <b>7. PARAMETERS</b>                             | <b>52</b> |
| 7.1. HOW TO MODIFY THE USER PARAMETERS           | 52        |
| 7.2. HOW TO EDIT THE INSTALLER LEVEL PARAMETERS  | 52        |
| 7.3. PARAMETER TABLE                             | 53        |
| 7.3.1. PARAMETER H60                             | 62        |
| <b>8. ALARMS</b>                                 | <b>63</b> |
| 8.1. ALARMS AND SIGNALS TABLE                    | 63        |
| 8.2. ALARM CAUSE/EFFECT TABLE                    | 64        |
| 8.3. DESCRIPTION OF ALARMS                       | 66        |
| 8.3.1. PROBE ALARM                               | 66        |
| 8.3.2. MINIMUM AND MAXIMUM TEMPERATURE ALARM     | 67        |
| 8.3.3. END OF DEFROST DUE TO TIMEOUT ALARM       | 68        |
| 8.3.4. EXTERNAL ALARM                            | 68        |
| 8.3.5. DOOR OPEN ALARM                           | 69        |
| 8.3.6. PRESSURE SWITCH INPUT ALARM               | 70        |
| 8.3.7. PANIC ALARM                               | 70        |
| <b>9. MODBUS MSK 554 FUNCTIONS AND RESOURCES</b> | <b>71</b> |
| 9.3.1. DATA FORMAT (RTU)                         | 71        |
| 9.3.2. NETWORK                                   | 71        |
| 9.3.3. MODBUS COMMANDS AVAILBLE AND DATA AREAS   | 72        |
| 9.3.4. ADDRESS CONFIGURATION                     | 72        |
| 9.3.5. PARAMETER VISIBILITY AND VALUES           | 73        |
| 9.3.6. MODBUS TABLES                             | 73        |
| 9.3.7. PARAMETER/VISIBILITY TABLE                | 75        |
| 9.3.8. PARAMETER/VISIBILITY H60 TABLE            | 79        |
| 9.3.9. FOLDER VISIBILITY TABLE                   | 81        |
| 9.3.10. CLIENT TABLE                             | 81        |
| <b>10. ADVANCED FUNCTIONS - NIGHT AND DAY</b>    | <b>83</b> |
| 10.1. DAY/NIGHT REGULATOR OPERATION              | 83        |
| 10.2. OPERATION WITH DEFROST GROUP               | 84        |
| 10.3. DAY/NIGHT REGULATOR DURING A BLACKOUT      | 84        |
| 10.4. OPENING FOLDER NAD - DAY/NIGHT             | 85        |
| <b>11. ADVANCED FUNCTIONS - HACCP</b>            | <b>86</b> |
| 11.1. DISPLAYING HACCP ALARMS                    | 87        |



## 1. INTRODUCTION

### 1.1. GENERAL DESCRIPTION

Using a single device, controllers in the new **Coldface NT** series are able to manage all the functions of a static or ventilated cold room.

With its innovative design, the casing combines ease of installation, water resistance and the possibility of installing a power contactor or a magnetothermal switch. Controllers in the **Coldface NT** series are easy and intuitive to use thanks to the high-visibility double display, the light-up icons and the four large keys for direct access to the functions. The controllers are available with a series of advanced functions, such as the recording of HACCP events with a yearly calendar.

### 1.2. ADVANTAGES AND FEATURES

- Complete management of a static or ventilated cold room
- Innovative design for easy installation and use
- Intuitive navigation with most frequently used parameters
- Large high-visibility display
- Facility for housing accessories on DIN rail

### 1.3. MODELS

Controllers in the new Coldface series allow you to control the temperature of a static or ventilated cold room with single-phase compressors up to 2HP.

They are suited to the control of commercial and industrial cold rooms and, thanks to the wide range of outputs available,

provide control of all associated functions, including lights, alarms, and condensation fans.

The products are equipped with an optional RS-485 serial port, which enables connection to TelevisSystem and ModBUS without the need for external accessories.

The controllers offer simple and intuitive operation: the LED double display, with 6 navigation keys, ensures the clear and simultaneous display of all active functions.

The HACCP function sets, maintains and memorises temperature measurements and any associated alarms, ensuring the quality and hygiene of stored products.

- **EWRC 300 NT** - Versions with 3 configurable relays for controlling all the accessory loads in the room.
- **EWRC 500 NT** - Versions with 5 configurable relays for controlling all the accessory loads in the room.
- **EWRC 500 NT HACCP** - Versions with 5 configurable relays for controlling all the accessory loads in the room, HACCP function with clock and yearly calendar.
- **EWRC 500 NT 4DIN** - Versions with 5 configurable relays for controlling all the accessory loads in the room, plus door for installation of magneto-thermal switch or accessories on a DIN rail.
- **EWRC 500 NT 4DIN HACCP** - Versions with 5 configurable relays for controlling all the accessory loads in the room, HACCP function with clock and yearly calendar, plus door for installation of magneto-thermal switch or accessories on a DIN rail.
- **EWRC 500 NT BREAKER** - Versions with 5 configurable relays for controlling all the accessory loads in the room, plus door and magneto-thermal switch installed.
- **EWRC 500 NT 4DIN BREAKER HACCP** - Versions with 5 configurable relays for controlling all the accessory loads in the room, HACCP function with clock and yearly calendar, plus door and magneto-thermal switch installed.

## 2. TECHNICAL DATA



### 2.1. TECHNICAL SPECIFICATIONS (EN 60730-2-9)

|                                       |   |
|---------------------------------------|---|
| Front panel protection rating         | IP65  |
| Classification:                       | electronic automatic control (not safety) device<br>for stand-alone installation                            |
| Mounting:                             | wall-mounted (hole spacing A-B 116 mm; C-D 87 mm; A-C 235 mm)   |
| Type of action:                       | 1.B   |
| Pollution class:                      | 2   |
| Material class:                       | IIIa  |
| Over-voltage category:                | II  |
| Nominal pulse voltage:                | 2500V   |
| Operating temperature:                | -5 ... +50°C  |
| Storage temperature:                  | -20 ... +85°C   |
| Operating humidity:                   | 10 ... 90%  |
| Storage humidity:                     | 10 ... 90%  |
| Power supply:                         | 230V~ ±10% 50/60 Hz   |
| Power consumption:                    | 11VA max  |
| Magneto-thermal switch:               | <b>Model EWRC 500 BREAKER</b><br>230V~ I <sub>cn</sub> 4500 A, Two-pole, for cables up to 10mm <sup>2</sup> |
| Magneto-thermal switch rated current: | <b>Model EWRC 500 BREAKER</b><br>I <sub>n</sub> = 16A   |
| Nominal pulse voltage:                | <b>Model EWRC 500 BREAKER</b><br>4 KV   |
| Connection:                           | device on external flexible cable, Y type connection  |
| Digital outputs (relay):              | refer to the label on the device  |
| Fire resistance category:             | D   |
| Software class:                       | A   |
| Ball test temperature:                | 100°C   |
| RTC battery life:                     | Without any external power supply, the clock battery will last 4 days.                                      |

### 2.2. FURTHER INFORMATION

#### 2.2.1. INPUT CHARACTERISTICS

|                    |  |
|--------------------|--|
| Measurement range: | NTC: -50.0°C ... +110°C; (on 3-digit display with +/- sign)<br>PTC: -55.0°C ... +150°C; (on 3-digit display with +/- sign) |
| Accuracy:          | 0.5% f.s + 1 digit   |
| Resolution:        | 0.1 °C   |
| Buzzer:            | YES  |
| Analogue Inputs:   | 3 configurable NTC/PTC inputs  |
| Digital Inputs:    | 2 multi-function, voltage-free digital inputs (DI)   |

|   | NTC                           | PTC                           |
|---|-------------------------------|-------------------------------|
| Measurement range   | -50.0...+110°C<br>-58...302°F | -55.0...+150°C<br>-67...302°F |
| Resolution  | 0.1°C<br>0.1°F                | 0.1°C<br>0.1°F                |
| F.S. precision  | 0.5% f.s. + 1 digit           | 0.5% f.s. + 1 digit           |
| Impedance   | -                             | -                             |
| <b>* probes not included - contact the Eliwell Sales Office for accessories</b> |                               |                               |



## 2.2.2. OUTPUT CHARACTERISTICS

|                              |                         |                   |
|------------------------------|-------------------------|-------------------|
| Digital Outputs:             | OUT1 common-line output | 2HP 12(12)A 250V~ |
|                              | OUT2 common-line output | 1HP 8(8)A 250V~   |
|                              | OUT3 common-line output | 1/2HP 8(4)A 250V~ |
| <b>EWRC500 NT</b> model only | OUT4 common-line output | 1HP 8(8)A 250V~   |
| <b>EWRC500 NT</b> model only | OUT5 SPDT output        | 1/2HP 8(4)A 250V~ |
|                              | Common-line max 18A     |                   |

## 2.2.3. MECHANICAL CHARACTERISTICS

|             |   |
|-------------|---|
| Casing:     | Bayblend FR 3010  |
| Dimensions: | front panel 213x318mm, depth 102mm  |
| Dimensions: | <b>Model EWRC 500 BREAKER</b><br>front panel 221x318mm depth 107mm  |
| Terminals:  | screw <ul style="list-style-type: none"><li>• Probe and digital inputs, OUT5 relay: screw-on terminals pitch 5.01: electric cables of 2.5 mm<sup>2</sup> maximum cross-section (one wire per terminal in the case of power connections).</li><li>• Power supply and OUT1..OUT4 relays: screw-on terminals pitch 7.62: electric cables of 4 mm<sup>2</sup> maximum cross-section (one wire per terminal in the case of power connections).</li></ul> |
| Connectors: | TTL for Unicard / MFK / CopyCard / Device Manager connection (via DMI)  |
| Humidity:   | Operation / Storage: 10...90% RH (non-condensing)   |

## 2.2.4. FOOD SAFETY

The device conforms to Standard EN13485 as follows:

- Suitable for storage.
  - Application: air.
  - Climate range A.
  - Measurement class 1 in the -25°C to 15°C range (\*).
- (\* exclusively using Eliwell probes)

NOTE: The technical specifications stated in this document regarding measurement (range, accuracy, resolution, etc.) refer to the instrument alone and not to any accessories provided, such as the probes.  
This means, for example, that the error introduced by the probe must be added to the characteristic error of the instrument.

## 2.3. DISPOSAL



The equipment (or product) must be subjected to separate waste collection in compliance with the local legislation on waste disposal.

## 3. CONNECTIONS



### 3.1. GENERAL WARNINGS

#### **IMPORTANT!**

**Make sure the appliance is switched off before working on the electrical connections.**

**All operations must be carried out by qualified personnel.**

To ensure proper connections, comply with the following:

- Power supplies other than those specified can seriously damage the system.
- Use cables of suitable cross-section for the terminals
- The device is equipped with screw terminals (a single conductor per terminal for the power feeding connections): refer to the label on the instrument for details of the terminal ratings.
- When current exceeds 8A on relay outputs, 2 x 2.5mm<sup>2</sup> cables must be run out for each individual contact to ensure the temperature of the cables does not exceed 85°C.
- Separate the cables of probes and digital inputs from inductive loads and dangerous voltage connections to prevent any electromagnetic interference. Do not place the probe cables near other electrical equipment (switches, meters, etc.)
- Make connections as short as possible and do not wind them around electrically connected parts.
- To avoid causing static discharges, do not touch the electronic components on the boards.

#### 3.1.1. POWER SUPPLY - DANGEROUS VOLTAGE OUTPUTS (RELAY)

Do not exceed the maximum permitted current; for higher loads, use a contactor with sufficient power capacity.

#### **Important!**

**Make sure that power supply is of the correct voltage for the instrument.**

#### 3.1.2. ANALOGUE INPUTS-PROBES

Temperature probes have no connection polarity and can be extended using a normal bipolar cable (note that the extension of the probes influences the instrument's EMC electromagnetic compatibility and measurement class: take great care with the wiring).

#### 3.1.3. SERIAL CONNECTIONS

The controller can be connected to Televis**System** remote control systems by a direct RS-485 connection using the RS485 optional plug-in module.

#### 3.1.4. RS485 CONNECTION

Use a shielded and "twisted" cable with two 0.5mm<sup>2</sup> conductors, plus braiding (i.e. Belden cable model 8762 with PVC sleeve, 2 conductors plus braiding, 20 AWG, nominal capacity between conductors 89pF, nominal capacity of 161pF between conductor and shielding).

See standards relating to EN 50174 data transmission systems for indications on how to lay cables.

Extra care must be taken in separating data transmission circuits from power lines.

An RS-485 network up to 1200m in length featuring a maximum of 32 devices can be connected straight to the controller.

This length can be extended and the number of devices for each channel increased using appropriate repeater modules.

Attach the 120Ω 1/4W resistors between the "+" and "-" terminals on the interface and the last controller in each branch of the network.

#### 3.1.5. TTL CONNECTION


Use a 5-wire TTL cable up to 3 m in length.

An Eliwell-supplied TTL cable is recommended. Contact Eliwell Sales Office for item availability.





## 3.2. WIRING DIAGRAM

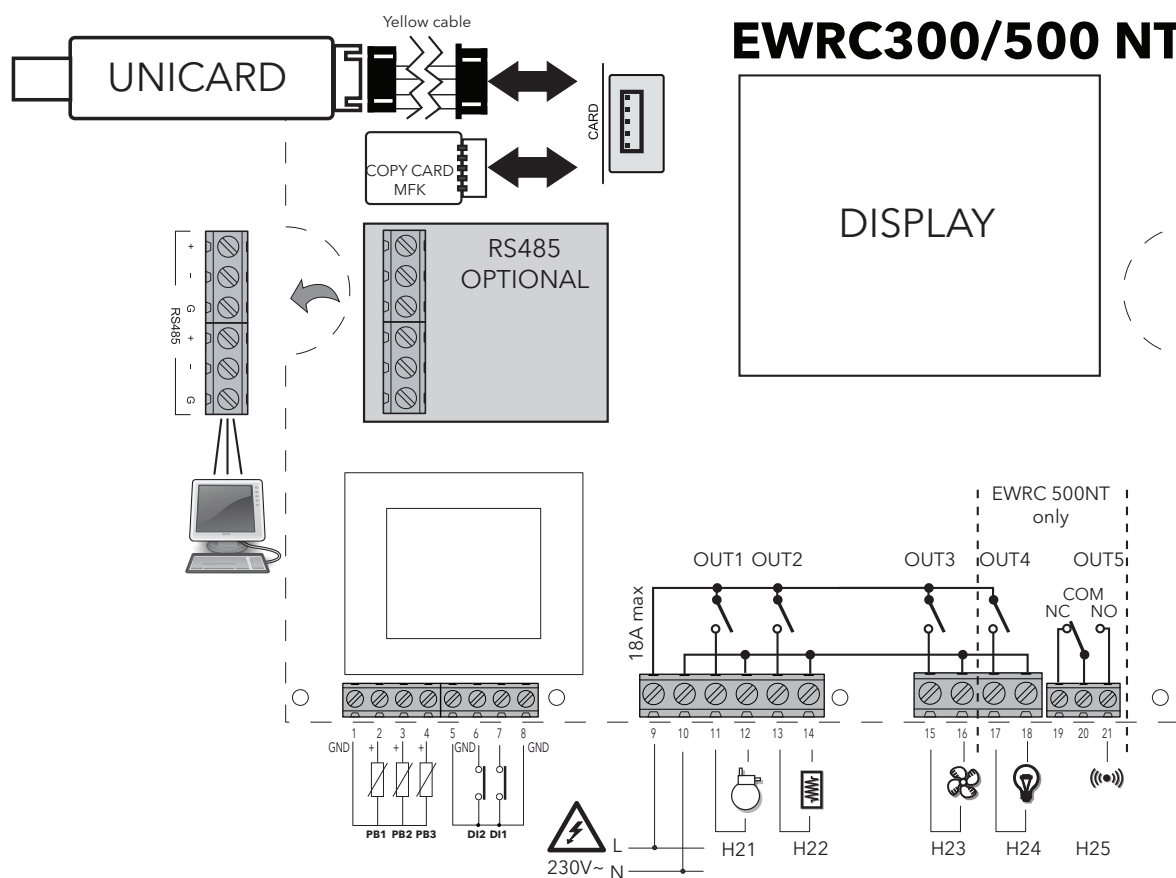


### 3.2.1. TERMINALS

| TERMINALS      |   |              |                            |
|----------------|---|--------------|----------------------------|
| <b>1, 5, 8</b> | GND   | <b>9, 10</b> | LINE/NEUTRAL. Power supply |
| <b>2</b>       | Analogue input Pb1  | <b>11</b>    | N.O. OUT1                  |
| <b>3</b>       | Analogue input Pb2  | <b>12</b>    | NEUTRAL                    |
| <b>4</b>       | Analogue input Pb3  | <b>13</b>    | N.O. OUT2                  |
| <b>6</b>       | Digital input DI2   | <b>14</b>    | NEUTRAL                    |
| <b>7</b>       | Digital input DI1   | <b>15</b>    | N.O. OUT3                  |
| <b>CARD</b>    | TTL for connection to UNICARD / CopyCard                          | <b>16</b>    | NEUTRAL                    |
| <b>RS485</b>   | Plugin module for connection to TelevisSystem / Modbus (optional) | <b>17</b>    | N.O. OUT4                  |
|                |   | <b>18</b>    | NEUTRAL                    |
|                |   | <b>19</b>    | N.C. OUT5                  |
|                |   | <b>20</b>    | OUT5 Common terminal       |
|                |   | <b>21</b>    | N.O. OUT5                  |



### 3.3. WIRING DIAGRAM FOR MODELS WITH MAGNETO-THERMAL SWITCH INSTALLED

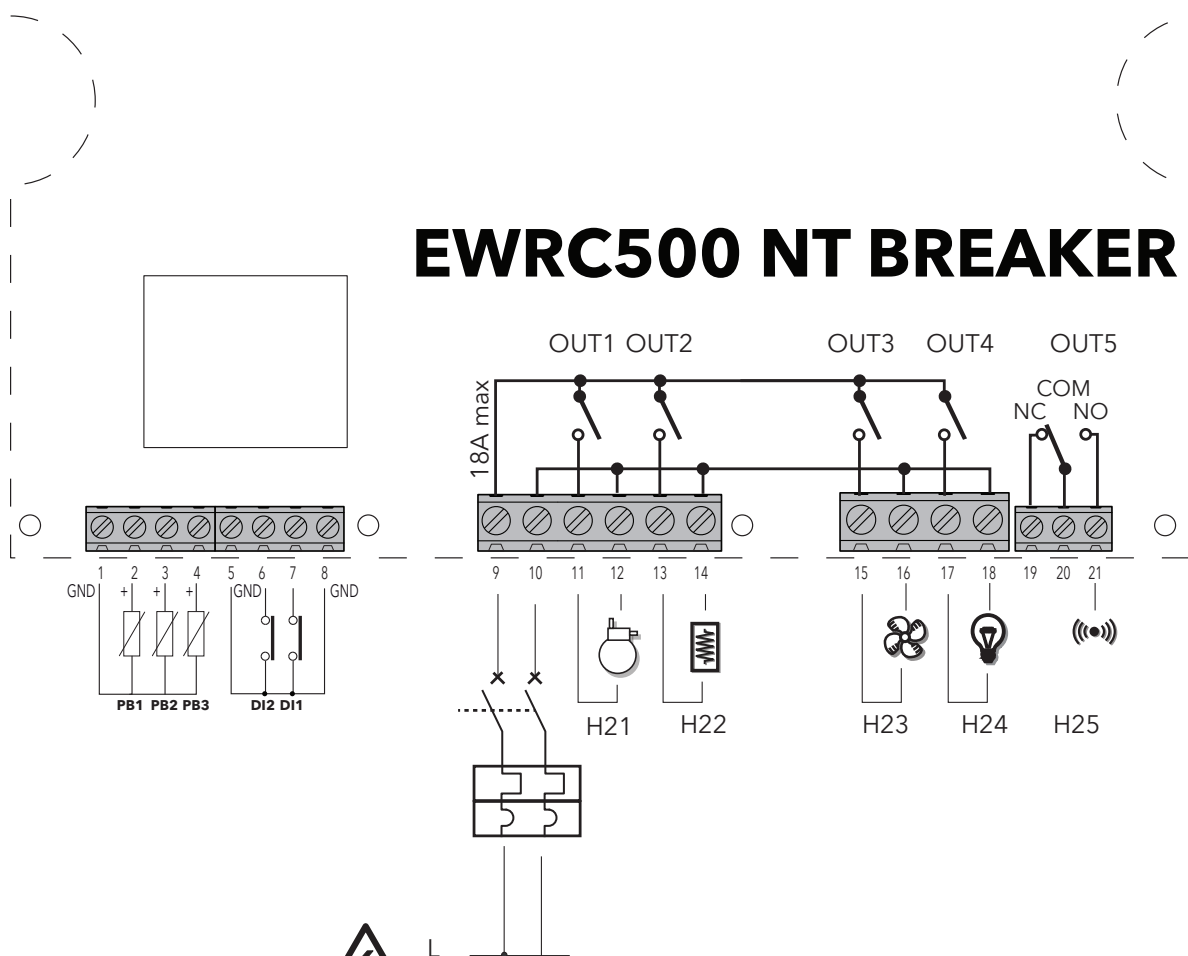

#### 3.3.1. TERMINALS

| TERMINALS      |   |              |                            |
|----------------|---|--------------|----------------------------|
| <b>1, 5, 8</b> | GND   | <b>9, 10</b> | LINE/NEUTRAL. Power supply |
| <b>2</b>       | Analogue input Pb1  | <b>11</b>    | N.O. OUT1                  |
| <b>3</b>       | Analogue input Pb2  | <b>12</b>    | NEUTRAL                    |
| <b>4</b>       | Analogue input Pb3  | <b>13</b>    | N.O. OUT2                  |
| <b>6</b>       | Digital input DI2   | <b>14</b>    | NEUTRAL                    |
| <b>7</b>       | Digital input DI1   | <b>15</b>    | N.O. OUT3                  |
| <b>CARD</b>    | TTL for connection to UNICARD / CopyCard                          | <b>16</b>    | NEUTRAL                    |
| <b>RS485</b>   | Plugin module for connection to TelevisSystem / Modbus (optional) | <b>17</b>    | N.O. OUT4                  |
|                |   | <b>18</b>    | NEUTRAL                    |
|                |   | <b>19</b>    | N.C. OUT5                  |
|                |   | <b>20</b>    | OUT5 Common terminal       |
|                |   | <b>21</b>    | N.O. OUT5                  |

## 4. MECHANICAL INSTALLATION



### 4.1. MECHANICAL INSTALLATION


Do not install the device in damp and/or dirty areas; it is intended for use in sites with ordinary or normal levels of pollution. Keep the area around the instrument cooling slots adequately ventilated.

#### 4.1.1. WALL-MOUNTING

1. Remove the screws (self-tapping 3.5x32 TC head) securing the cap at the top and then open the cover.
2. Drill holes for the high and low voltage cable glands on the sides of the backplate, as shown in the figure. Check that the cables are inside the box. Use suitable cable glands and/or conduit glands that guarantee an airtight seal for all wiring.
3. Drill 4 holes (see A...D) in the wall and fix the backplate in place using 4 screws (not supplied) suited to the wall thickness.
4. Insert plug covers TDI 20 (accessory available on request).
5. Close the door and re-tighten the 4 cover screws, making sure that the hinges are flush and do not interfere with the closure of the cover.

Hinges are available for mounting on special compartments for opening the cover both right and left.

Screw on the respective anchoring screws taking care that the hinges are fitted well and lie flush so that they do not interfere with the compression of the seal.

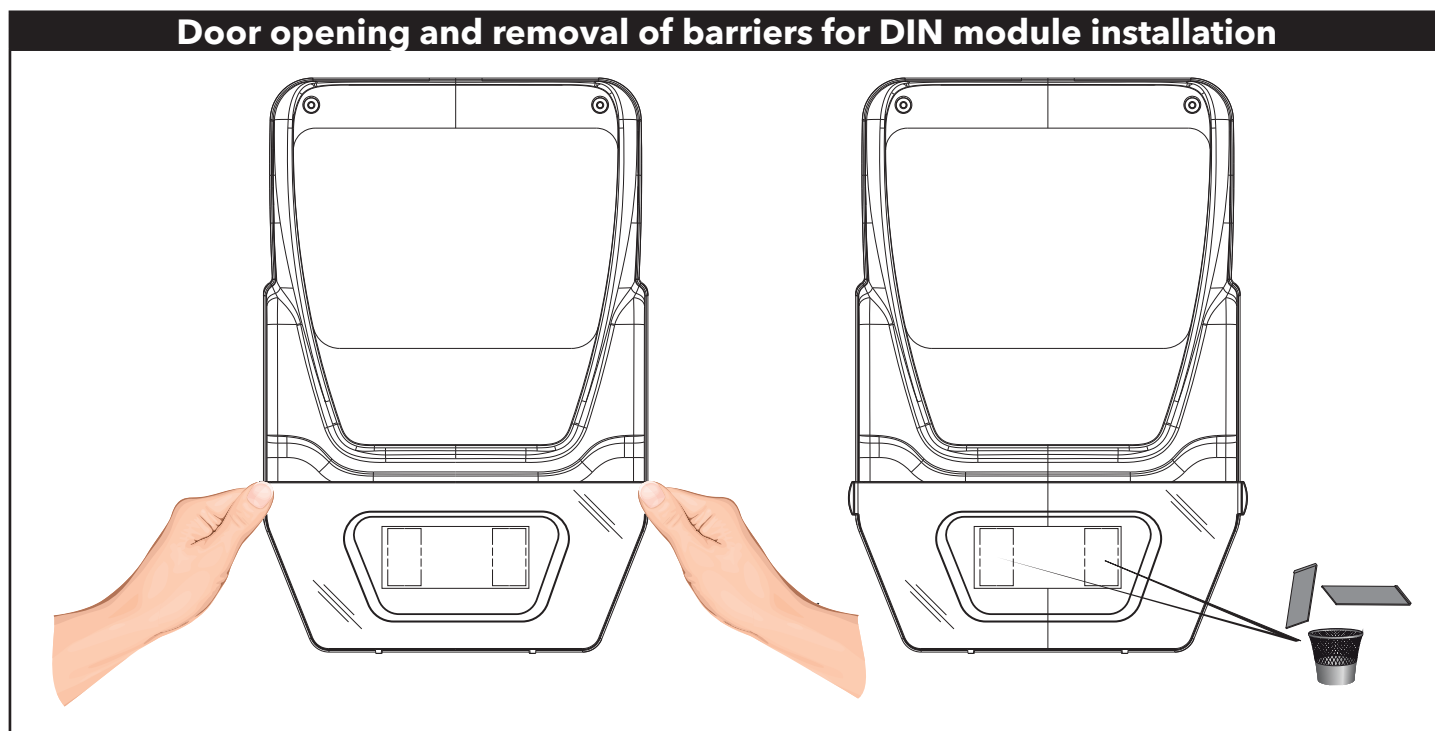

The versions with front door allow direct access to the switch miniature circuit breaker or to the top of the device installed on the DIN rail mounted inside.

To open the door, use both hands as shown in the figure. Apply a slight pressure with your thumbs on top to release the side flaps. Simultaneously with the index finger gently pull the door toward you.

In versions provided with the miniature circuit breaker, the installer must connect it to the power supply of the electronic board through the wiring harness included in the packaging.

The wiring diagram is illustrated in the figure on the previous page.


In versions with transparent front door, the omega DIN rail is always available and already installed.

You can mount up to a maximum of 4 DIN modules, including 2DIN miniature circuit breaker when present.


The DIN housing is easily expandable from 2 to 4 DIN exploiting the pre-drilling barriers as shown in the figure top right.




## Removing the cover

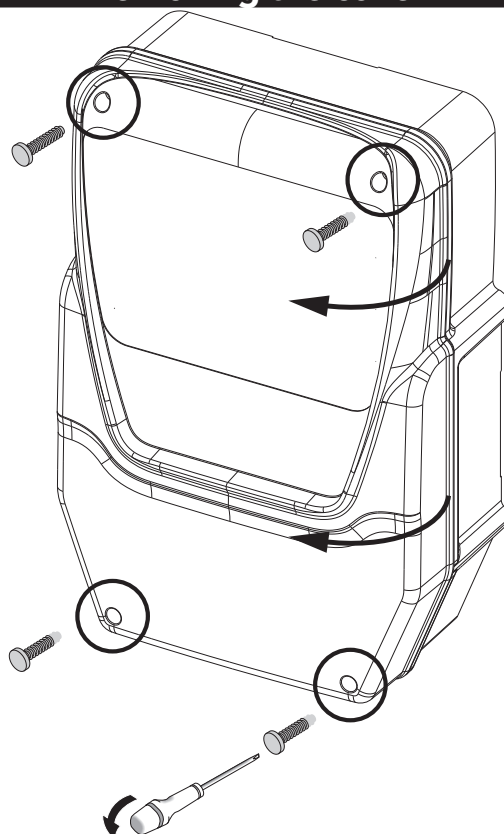

## Wall installation

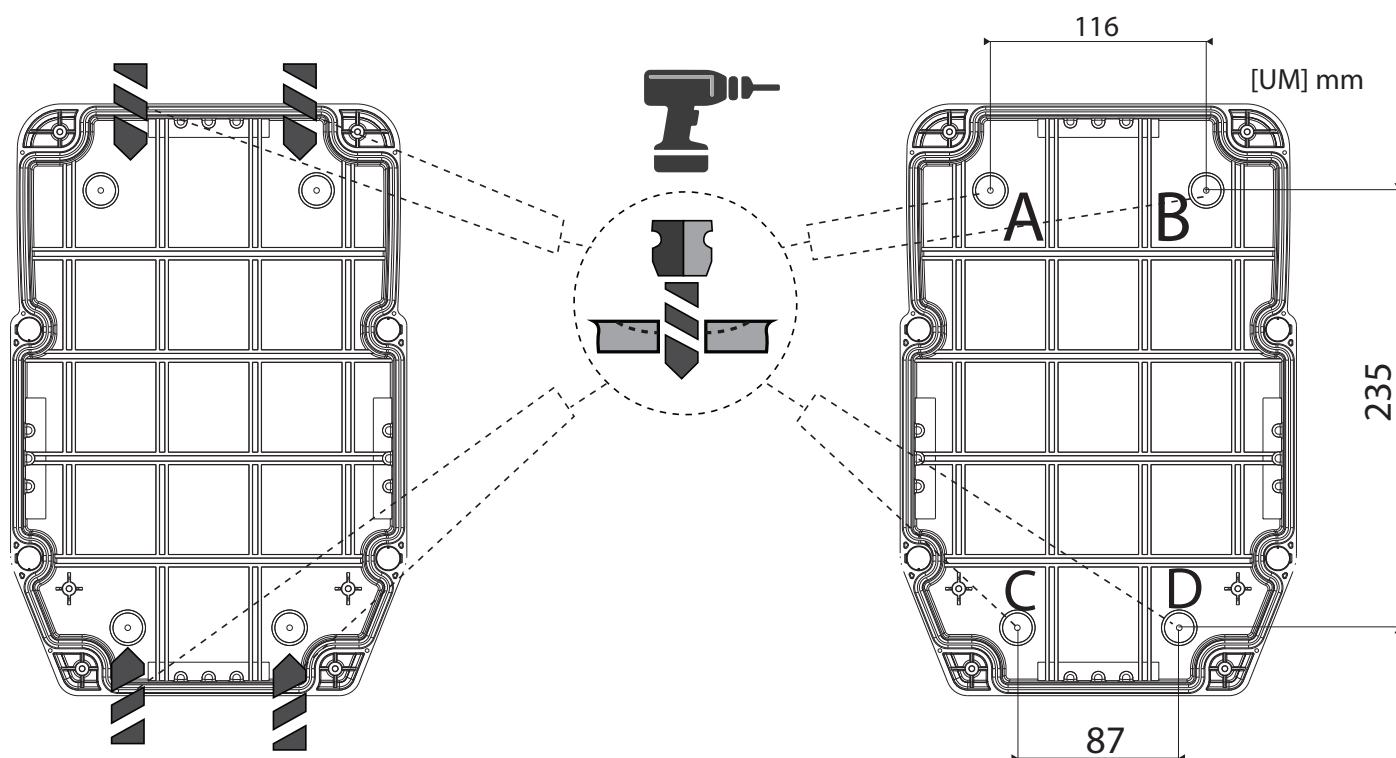

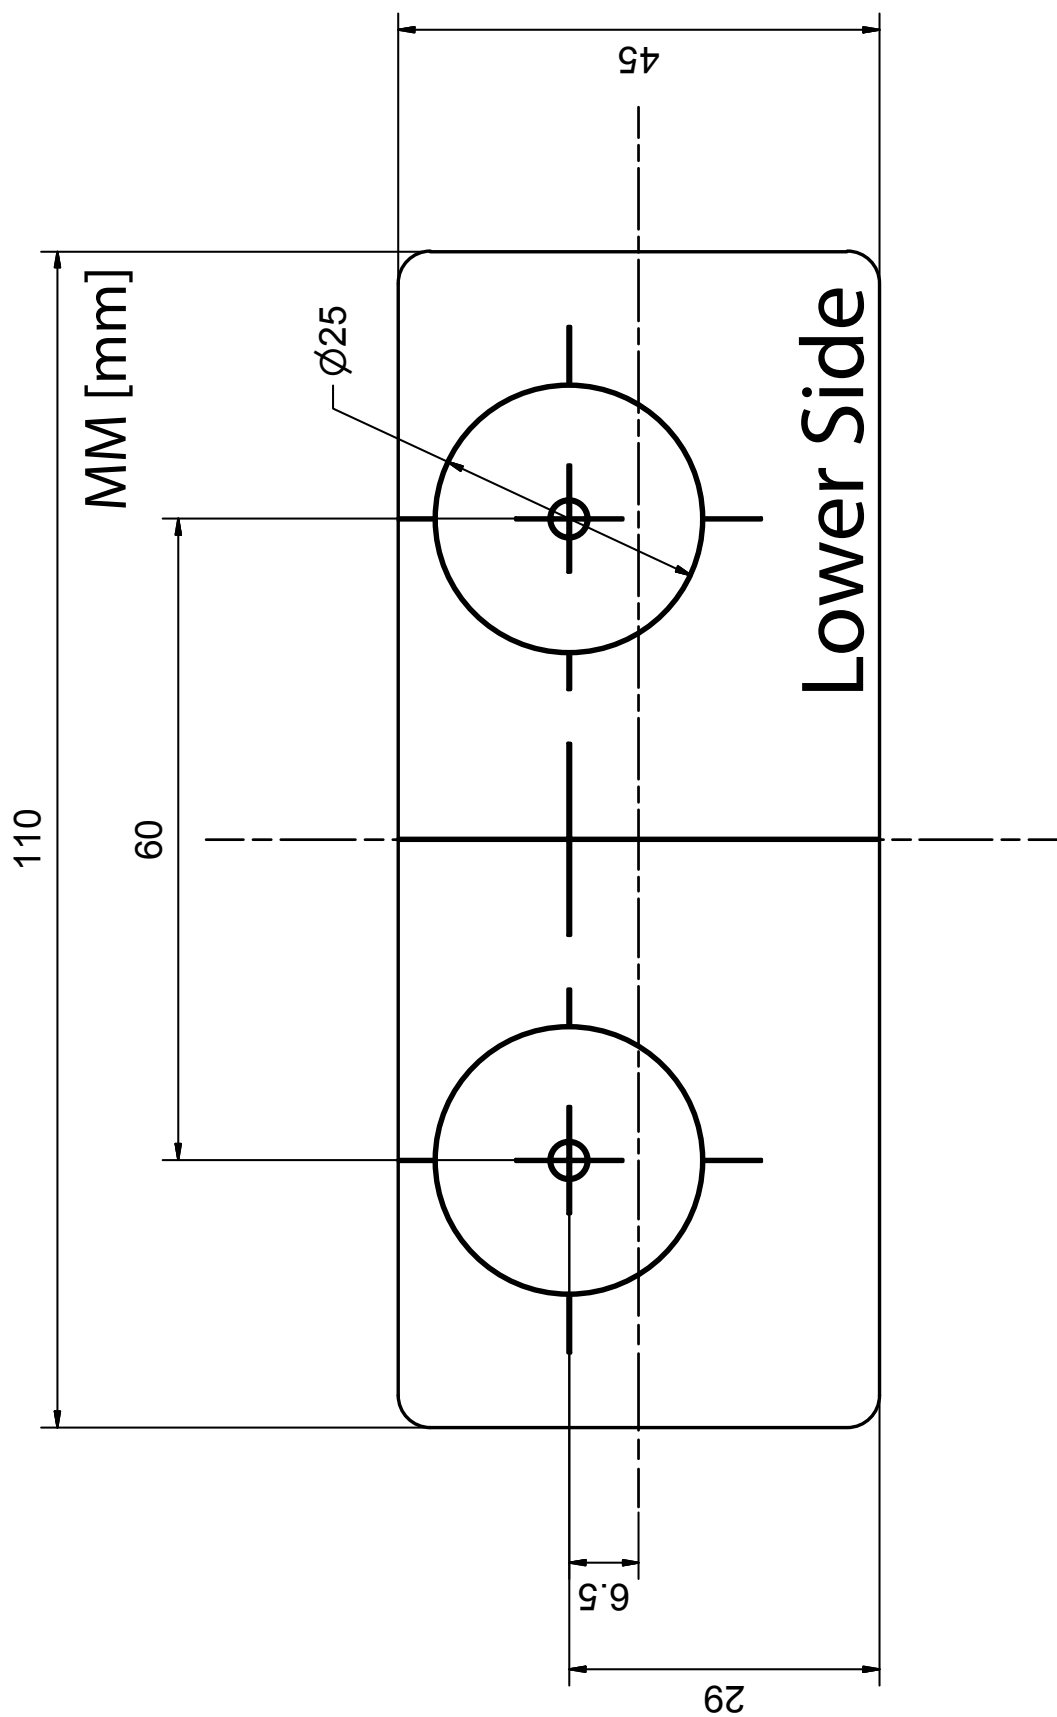

## 5. USER AND START-UP INTERFACE



### 5.1. DISPLAY


#### 5.1.1. KEYS



| No. | KEY                | press and release  | press and hold for about 3 seconds  | NAVIGATION MENU  | Notes  |
|-----|--------------------|--|---|--|--|
| A   | ESC key<br>Defrost | <ul style="list-style-type: none"> <li>• Functions menu</li> </ul>   | <ul style="list-style-type: none"> <li>• Manual defrost</li> <li>• Return to Main Menu</li> </ul> | <ul style="list-style-type: none"> <li>• Output</li> </ul>                               | Configurable - see parameter H33                     |
| B   | ▲ UP<br>Alarms     | <ul style="list-style-type: none"> <li>• Alarms Menu (always visible)</li> </ul>   | /   | <ul style="list-style-type: none"> <li>• Scroll</li> <li>• Increase values</li> </ul>    | HACCP alarms only in certain models and if available |
| C   | SET                | <ul style="list-style-type: none"> <li>• Display SetPoint / probe values / time (Models with clock only)</li> <li>• Confirm values</li> <li>• Access value edit mode (upper display blinking)</li> </ul> | Access Parameters menu  | <ul style="list-style-type: none"> <li>• Confirm values</li> <li>• Move right</li> </ul> | Time only visible on models with clock               |
| D   | ▼ DOWN<br>AUX      | <ul style="list-style-type: none"> <li>system INFO</li> <li>See Technical Support</li> </ul>   | Activate auxiliary function   | <ul style="list-style-type: none"> <li>• Scroll</li> <li>• Decrease values</li> </ul>    | Configurable - see parameter H32                     |
| E   | ON/OFF             | /  | On/Off device   | /  | Configurable - see parameter H34                     |
| F   | LIGHT              | Switch light on/off  | Switch light on/off   | /  | Configurable - see parameter H35                     |



## 5.1.2. LEDs

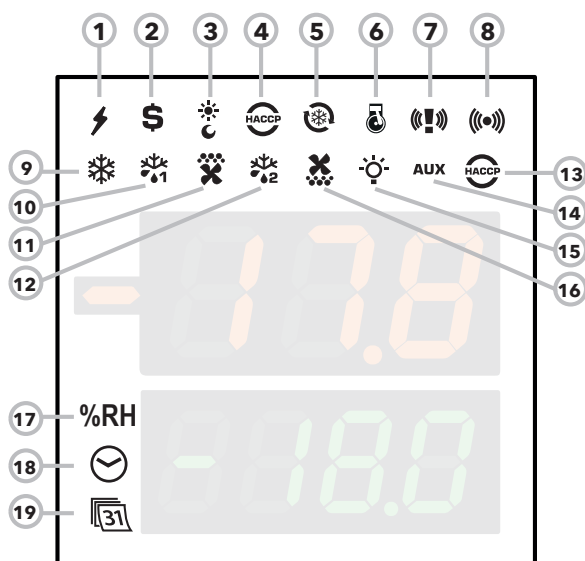

Meaning of LEDs:

| No. | LED  | Colour | Description                               |
|-----|------|--------|---|
| 17  | %RH  | amber  | not used                                  |
| 18  | TIME | amber  | access in case of time display or editing |
| 19  | DATA | amber  | access in case of date display or editing |

| No. | LED                | Colour | ON                      | BLINKING           | OFF                      |
|-----|--------------------|--------|-------------------------|--------------------|--------------------------|
| 1   | POWER SUPPLY       | green  | Power supply ON         | /                  | Power supply OFF         |
| 2   | ENERGY SAVING      | amber  | Energy saving ON        | /                  | Energy saving OFF        |
| 3   | NIGHT & DAY        | amber  | Night & Day ON          | /                  | Night & Day OFF          |
| 4   | HACCP              | amber  | HACCP menu              | /                  | /                        |
| 5   | DEEP COOLING (DCC) | amber  | Deep cooling cycle ON   | /                  | Deep cooling cycle OFF   |
| 6   | PUMP DOWN          | amber  | Compressor Pump Down ON | /                  | Compressor Pump Down OFF |
| 7   | PANIC              | red    | Panic alarm             | /                  | No alarm                 |
| 8   | ALARM              | red    | Alarm                   | Silenced           | No alarm                 |
| 9   | COMPRESSOR         | amber  | Compressor ON           | delay              | Compressor OFF           |
| 10  | DEFROST 1          | amber  | defrost                 | dripping           | No defrost               |
| 11  | EVAPORATOR FANS    | amber  | Fans ON                 | forced ventilation | Fans OFF                 |
| 12  | DEFROST 2          | amber  | defrost                 | dripping           | No defrost               |
| 13  | HACCP ALARM        | red    | HACCP alarm             | Not displayed      | No alarm                 |
| 14  | AUXILIARY (AUX)    | amber  | AUX ON                  | /                  | AUX OFF                  |
| 15  | LIGHT              | amber  | Light ON                | /                  | Light OFF                |
| 16  | CONDENSER FANS     | amber  | Fans ON                 | /                  | Fans OFF                 |

ON: function/alarm ON; OFF: function/alarm OFF



### 5.1.3. PRELIMINARY CONFIGURATIONS

After making the electrical connections, simply power up the device to start operation.

At first start-up, Eliwell recommends that you:

1. Make sure the instrument is powered (green POWER SUPPLY LED on).
2. Make sure the display is working: when the controller is powered up it performs a lamp test, during which time the display and LEDs will blink for several seconds to ensure that they all function correctly.
3. Make sure there are no active alarms (ALARM / HACCP ALARM LEDs off and labels E1, E2 and E3 not displayed).
4. Configure the main parameters listed in the USER menu to suit your requirements, as described below.

### 5.1.4. OPERATION IN DEFAULT CONFIGURATION

The instrument is configured for negative cold. For positive cold, disable the evaporator probe Pb2 (set H42=n) and set relay OUT3 (parameter H23=6) to prevent continuous ventilation.

#### COMPRESSOR

The compressor is active if the cold room temperature detected by Pb1 exceeds the value of SEt + differential diF. The compressor stops if the cold room temperature detected by Pb1 falls below the SEt value. The instrument includes compressor on/off protection\*.

#### DEFROST

Defrost is by means of electric heaters (parameter dty = 0) and the time counter is always active with the instrument switched on (dCt=1).

#### Manual defrost

Manual defrost is activated by pressing and holding the ESC key (A).

If conditions for defrosting are not present, (e.g. the evaporator probe temperature is higher than the defrosting end temperature) or the parameter OdO≠0, the display will blink three times to indicate that the operation will not be performed.

#### Default Defrost settings

dit = 6 hours. interval between 2 defrost cycles

dSt = 6.0°C. defrosting end temperature set by Pb2.

The Defrost cycle may terminate due to timeout based on the parameter dEt (default 30 min).

#### EVAPORATOR FANS

Relay OUT3 is configured as fans relay and is activated in the required cases, according to delays and parameter settings\*.

#### Default fan settings

dt = 0 min. dripping time

dFd = Y. Fans off during defrosting.

#### LIGHT - EWRC 500 NT only

The light is activated by pressing and holding the LIGHT key (F).

Since digital input D.I. 1 is configured as door switch, relay OUT4 (light) is activated when the door is opened. The light also switches on with the instrument in stand-by\*.


#### ALARM RELAY - EWRC 500 NT only

Relay OUT5 is configured as alarm relay and is activated in the case of alarms, according to delays and parameter settings.





## 5.1.5. NAVIGATION

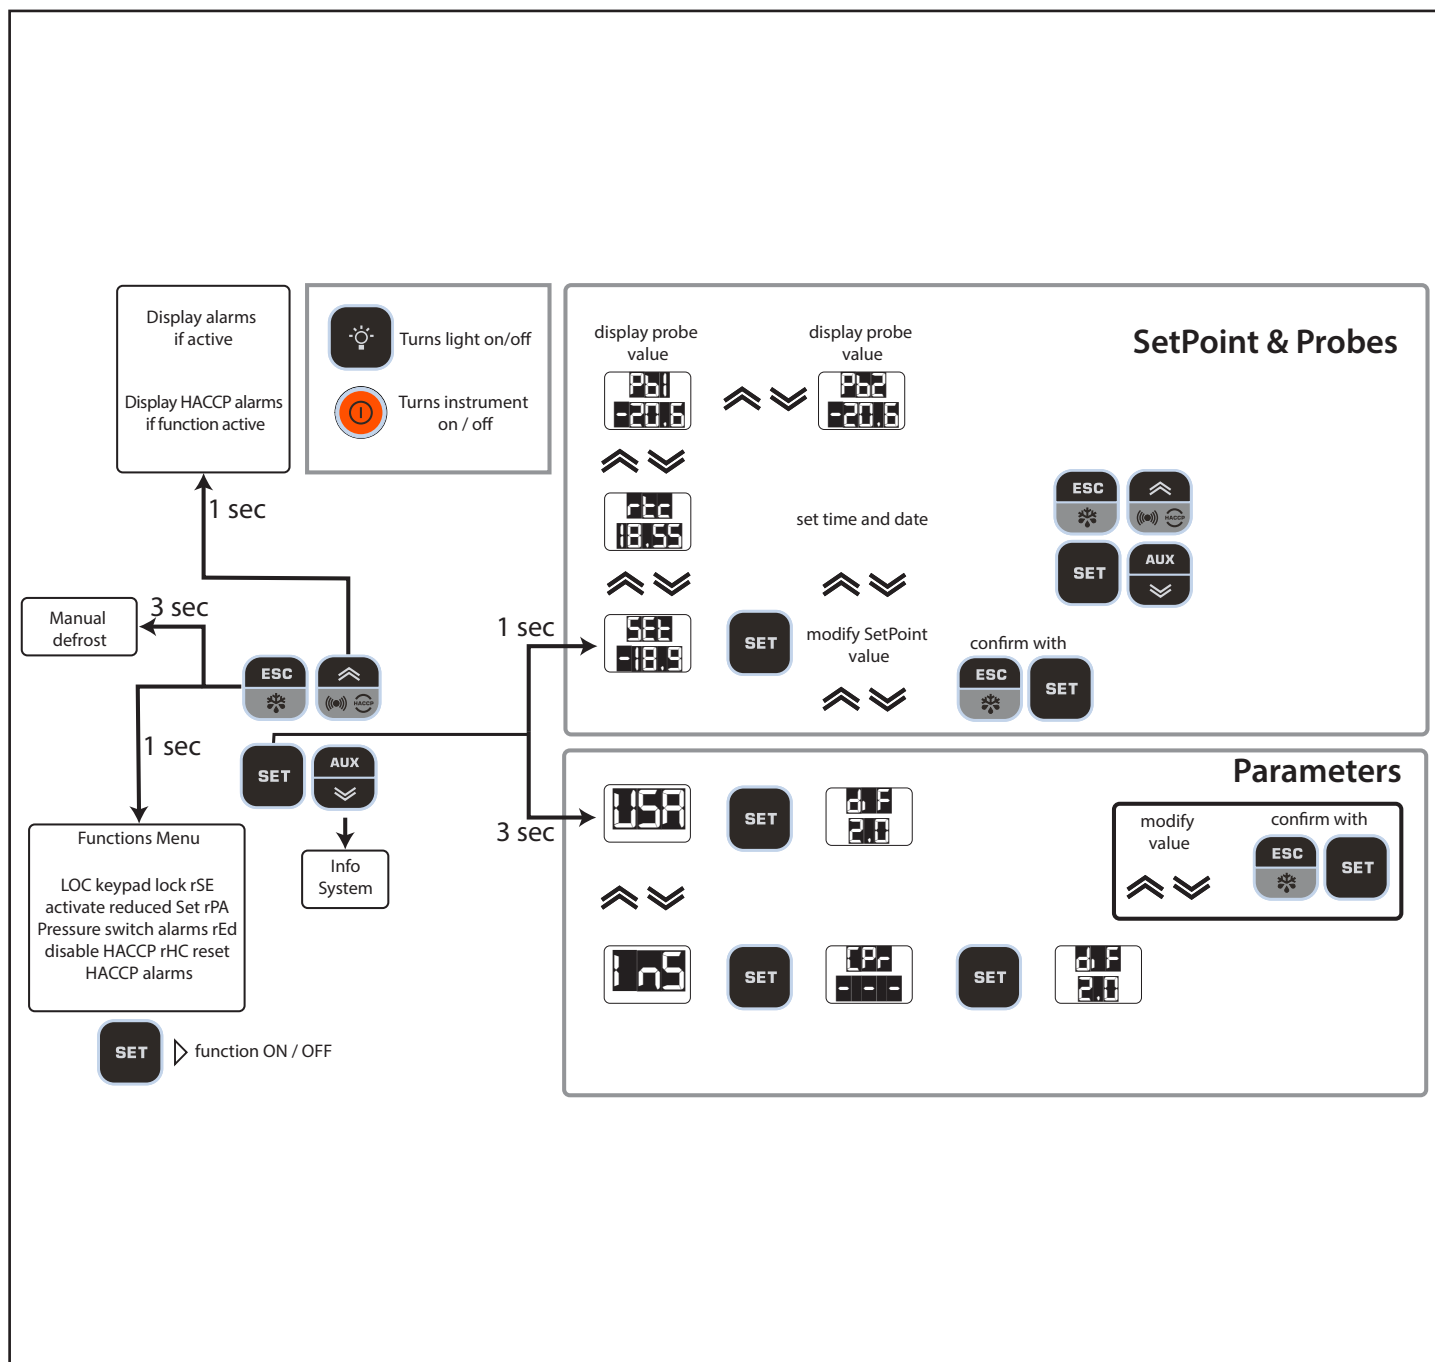



## 5.1.6. FUNCTIONS MENU AND KEY-ACTIVATED FUNCTIONS

The Functions menu is used to perform a number of manual functions such as putting the device into stand-by, clearing pressure switch interventions and clearing HACCP alarms, etc.

Access the Functions menu by pressing the ESC key.

The following table lists the functions, which are all OFF by default.

| Display | Function                       | Description   |
|---------|--------------------------------|---|
|         | Keypad lock                    | The UP/ES/ON-OFF/LIGHT keys and the functions programmed via keys are locked<br>The DOWN key may be used to view the Setpoint only; the value cannot be modified<br>Only function visible if keypad locked (On) |
|         | Disable HACCP alarm recording  | Disables HACCP alarm recording  |
|         | Reset pressure switch alarm    | Clears pressure switch alarm<br>NOTE: the function reverts to OFF status when you exit the Functions Menu   |
|         | Reduced set (Economy setpoint) | Reduced set (Economy setpoint)  |
|         | Reset HACCP alarms             | Clears HACCP alarms<br>May be protected by Password PA3   |

All models have the **UP** key set to display the Alarms Menu.

All models also allow the setting of other keys to activate a specific function as identified by the client.

The parameters for configuring the two keys are:

- **H32** = DOWN key configuration
- **H33** = ESC key configuration
- **H34** = ON/OFF key configuration
- **H35** = LIGHT key configuration

The values that can be set apply to these keys and the functions that can be activated are:

| Value of H32/H33/H34/H35   | Function enabled  |
|--|---|
| <b>0</b> = Disabled<br><b>1</b> = Defrost<br><b>2</b> = Auxiliary<br><b>3</b> = Activate economy setpoint<br><b>4</b> = Reset HACCP alarms<br><b>5</b> = Disable HACCP alarms<br><b>6</b> = Light<br><b>7</b> = Stand-by<br><b>8</b> = NOT USED<br><b>9</b> = Evaporator fans ON | <b>10</b> = Activate / deactivate Frame Heater relay<br><b>11</b> = Enable/disable Night And Day functions<br><b>12</b> = Deep cooling cycle<br><b>13</b> = Clear voltage drop errors (Power Failure Reset)<br><b>14</b> = Service stoppage<br><b>15</b> = Activate economy set + Night And Day |



### 5.1.7. PASSWORD

**Password PA1 is disabled by default.**

**Password PA1:** allows access to **User** parameters.

To enable it (**PA1≠0**): press and hold **set** for at least 3 seconds. The label **USr** appears. Press **set** again.

Scroll through the parameters using **UP** and **DOWN** until you find label **PA1**, press SET to display its value, change it using **UP** and **DOWN** and save it by pressing set or **ESC**.

**Example with password enabled (PA1≠0)** it will then be requested before access to the User parameters is granted.

| Display | Description   |
|---------|---|
|         | Press SET for 3 seconds   |
|         | Label PA1 appears   |
|         | Press SET<br>Use UP and DOWN keys to enter the password   |
|         | Example the password is 12<br>Press SET   |
|         | User menu accessed<br>The first User parameter appears<br><br>If the value entered is incorrect, label <b>PA1</b> will be shown again and the procedure must be repeated. |

**Password "PA2":** allows access to **Installer** parameters.

The example is the same. N.B. Password **PA2** is set by default to **15**

| Display | Description  |
|---------|--|
|         | Press SET for 3 seconds                                    |
|         | Label USr appears<br>Use 'UP' and 'DOWN' to search for InS |



| Display | Description  |
|---------|--|
|         | Press SET  |
|         | Use UP and DOWN keys to enter the password   |
|         | Example the password is 15<br>Press SET  |
|         | installer menu accessed<br>the first CPr folder appears<br><br>If the value entered is incorrect, label <b>PA2</b> will be shown again and the procedure must be repeated. |








### 5.1.8. SETTING THE SETPOINT

By way of example, we will change the Setpoint value from -18.0 degrees centigrade to -20.0 degrees centigrade.

| Display | Description  |
|---------|--|
|         | Press and release the SET key  |
|         | The upper display will show SEt, the lower display will indicate the current SetPoint value<br>Press and release the SET key once more |
|         | The upper display will show SEt blinking<br>Use the UP & DOWN keys to adjust the SetPoint value  |
|         | Press the ESC key several times to return to the normal display<br>(or press the SET key to confirm, followed by ESC to exit)          |
|         | The new Setpoint value is saved and appears on the lower display   |



## 5.1.9. VIEWING PROBE VALUES

| Display   | Description  |
|---|--|
|    | Press and release the SET key  |
|    | The upper display will show SET, the lower display will indicate the current SetPoint value<br><br>Use the DOWN key to view the value of probe Pb1 |
|    | The time is displayed in HACCP models  |
|   | Use the DOWN key again to view the value of probe Pb1  |
|  | Use the DOWN key again to view the value of probe Pb2  |
|  | If H43 is not 0 (probe 3 present)<br>Use the DOWN key again to view the value of probe Pb3   |
|  | Press the ESC key to return to the normal display<br>Normal display  |



## 5.1.10. HOW TO MODIFY THE DATE AND TIME

Function only available in HACCP models

| Display | Description   |
|---------|---|
|         | Press and release the SET key   |
|         | The upper display will show SET, the lower display will indicate the current SetPoint value<br>Use the DOWN key to display the time                         |
|         | <b>The CLOCK LED is on</b><br>Press and release the SET key   |
|         | <b>The CLOCK LED is on</b><br><u>The hour value will begin to blink</u><br>Use the UP & DOWN keys to adjust the hour value                                  |
|         | <b>The CLOCK LED is on</b><br>Press and release the SET key   |
|         | <b>The CLOCK LED is on</b><br>The hour value has been changed<br><u>The minute value begins to blink</u><br>Use the UP & DOWN keys to adjust the hour value |
|         | Repeat this procedure to adjust the date value (DAY.MONTH and YEAR)   |
|         | In this case the DATA LED (31) is on<br>Press the ESC key several times to return to the normal display   |



### 5.1.11. DISPLAYING ALARMS

| Display | Description  |
|---------|--|
|         | <p>Press and release the UP key<br/>The upper display will show ALr</p>  |
| <br>    | <p>The lower display will show</p> <p>a. nOnE if no alarms active</p> <p>b. SYSt if system alarms present</p>  |
|         | <p><b>HACCP models ONLY</b></p> <p>The upper display will show ALr</p> <p>The lower display will show HACCP if HACCP alarms are present<br/>NOTE: parameter H50 must = 1</p> |

### 5.1.12. SYSTEM ALARMS EXAMPLE

Let us suppose two alarms have occurred,

- one HIGH TEMPERATURE on the cold room probe
- one HIGH TEMPERATURE on probe 3 (parameter H43 different from 0)

| Display | Description  |
|---------|--|
|         | <p>Press and release the UP key</p>  |
|         | <p>The upper display will show ALr</p> <p>The lower display will indicate SYSt<br/>Press and release the SET key</p>   |
|         | <p>The upper display will show ALr</p> <p>The lower display will show<br/>HA1 HIGH TEMPERATURE alarm on the cold room probe</p> <p>Use the UP &amp; DOWN keys to view other alarms, if present</p> |
|         | <p>In the example, the lower display will indicate HA3 HIGH TEMPERATURE alarm on probe 3<br/>(see para. H43)</p> <p>Press the ESC key several times to return to the normal display</p>            |



### 5.1.13. MODIFYING A PARAMETER

The User parameters **USr** are the most frequently used ones and are NOT grouped into sub-folders.

They are always visible by default (access password PA1 is not enabled by default).

The same parameters are also visible in the respective folders 'Compressor', 'Fans', etc. within the Installer parameters menu **InS**.

They are always visible by default (access password PA2 is not enabled by default).



**NOTE:** It is advisable to switch the device off and on again each time the configuration of the parameters is changed, so as to prevent malfunctions affecting the configuration and/or the current timings.

#### 5.1.13.1 How to modify a user parameter






Instructions are provided below on how to modify a User parameter.

The same procedure applies to Installer (**inS**) level parameters.

Let us take the **dit** parameter as our example.

There are no sub-folders at User level. At Installer level the parameter is in the folder containing **dEF** defrost parameters.

We will now demonstrate how to change the value from **6h to 8h**.

| Display   | Description   |
|---|---|
|    | Press and hold the SET key for approx. 3 seconds  |
|  | The folder for USr parameters will appear<br>Press and release the SET key<br>Press and release the SET key to access the first parameter |
|  | The first User parameter appears<br>Use the UP & DOWN keys to find the parameter that you wish to modify                                  |
|  | Press and release the SET key<br>The dit label will blink<br>Use the UP & DOWN keys to adjust its value                                   |
|  | Press and release the SET key to confirm the modification   |





### 5.1.13.2 How to modify an Installer parameter

Instructions are provided below on how to modify the same User parameter but via the Installer menu.

Let us take the **dit** parameter as our example.

At Installer level the parameter is in the folder containing **dEF** defrost parameters.

We will now show how to change the value from **8h** to **6h**.

| Display | Description   |
|---------|---|
|         | Press and hold the SET key for approx. 3 seconds  |
|         | <p>The folder for USr parameters will appear<br/>Use the UP &amp; DOWN keys to search for the inS folder<br/>Press and release the SET key</p> <p>Press and release the SET key to access the first parameter</p> |
|         | <p>The first folder appears</p> <p>Use the UP &amp; DOWN keys to search for the dEF folder</p>  |
|         | <p>Press and release the SET key</p> <p>The first parameter in the dEF folder will appear<br/>Use the UP &amp; DOWN keys to find the parameter you want to change</p>   |
|         | <p>Press and release the SET key<br/>The dit label will blink<br/>Use the UP &amp; DOWN keys to adjust its value</p> <p>Press and release the SET key<br/>to confirm the modification</p>                         |

## 6. FUNCTIONS AND REGULATORS



This section describes the various functions of the devices.



**IMPORTANT:** some functions may not be available in certain models.

### 6.1. SETTINGS

#### 6.1.1. PROBE SETTING AND CALIBRATION

**EWRC 300/500 NT** have 3 configurable NTC/PTC inputs (PB1 ... PB3).

The temperature probes (PB1 ... PB3) must all be the same type and should be configured via parameter **H00**, visible at User level (**USr**) inside the **CnF** folder at Installer level (**inS**).

- **H00** = 0 if using PTC probes
- **H00** = 1 if using NTC probes (default)

After installation, the values read by the probes can be corrected/calibrated using the following parameters:

- **CA1**: probe 1 offset. Positive or negative value to be added to the value read by Pb1 (Range: **-30.0 ... +30.0**)
- **CA2**: probe 2 offset. Positive or negative value to be added to the value read by Pb2 (Range: **-30.0 ... +30.0**)
- **CA3**: probe 3 offset. Positive or negative value to be added to the value read by Pb3 (Range: **-30.0 ... +30.0**)

#### 6.1.2. DISPLAY SETTINGS

At User level (**USr**) or inside the **diS** folder at Installer level (**inS**) you will find the parameters used to set the temperature readout, decimal point usage, unit of measure and display during defrost.

- **ndt**: (**USr/inS**) enables/disables decimal point display (with resolution of one-tenth of a degree; e.g.: 10.0°C).  
Display with decimal point is only possible within the range of values from -99.9°C to +99.9°C
  - **ndt = y** → displays read values with decimal point (**default**)
  - **ndt = n** → displays read values without decimal point



**NOTE:**

enabling/disabling the decimal point only affects the on-screen display of values. The controller will continue to perform calculations with decimal point.

- **ddl**: (**USr/inS**) sets the type of display during and up to the end of defrost.
  - **ddl = 0** → displays the probe value (**default**)
  - **ddl = 1** → continues to display the value read by the probe at the start of defrosting
  - **ddl = 2** → displays fixed label **DEF**
- **dro**: (**inS**) sets temperature display to °C or °F.
  - **dro = 0** → display in °C (**default**)
  - **dro = 1** → display in °F



**IMPORTANT** : switching between °C and °F DOES NOT modify the values of temperature parameters (e.g. setpoint=10°C becomes 10°F).

This means that the maximum and minimum limits of parameters as absolute values are the same for both units of measure and hence the ranges are different.

- **ddd**: (**inS**) establishes the value to be shown on the upper display.  
All other display and adjustment modes are the same.
  - **ddd = SEt** → displays the Setpoint value
  - **ddd = Pb1** → displays the values read by Pb1 (**default**)
  - **ddd = Pb2** → displays the values read by Pb2
  - **ddd = Pb3** → displays the values read by Pb3



## 6.2. FUNCTIONS

### 6.2.1. UPLOAD, DOWNLOAD, FORMAT

#### Description

The Unicard/Multi Function Key is connected to the serial port (TTL) and allows fast programming of instrument parameters.



**DOWNLOAD** from reset operating mode: at power-on, if the Unicard/Multi Function Key is inserted in the device, the controller automatically downloads data.

After connecting the Unicard/Multi Function Key with the device switched off and on completion of the lamp test, one of the following labels will be displayed:

- **dLY** if the operation was successful
- **dLn** if the operation was not successful

After about 5 seconds, the display will display the probe or setpoint value, depending on the default settings.



**IMPORTANT:** once download has been completed successfully, the controller will start to work with the new map loaded.

Operating mode: access "Installer" parameters by entering the password "**PA2**" if enabled (PA2≠0), scroll through the folders using **UP & DOWN** until the "**FPr**" folder appears. Select it using **SET**, scroll through the parameters using **UP & DOWN** and then select one of the functions by pressing **SET**:

- **UL** (Upload): This function uploads the programming parameters from the instrument to the card. If the operation is successful, the display will show "**y**", otherwise it will show "**n**".
- **Fr** (Format): This command is used to format the copy card (which is necessary when using the card for the first time). Important: the **Fr** parameter deletes all data present and this operation cannot be reversed.
- **Download:** Connect the UniCard/Multi Function Key with the instrument switched off. At power-up, data will automatically start downloading from the Unicard/Multi Function Key to the controller. At the end of the lamp test, the display will show "**dLy**" if the operation was successful and "**dLn**" if it failed.



**IMPORTANT:** before Uploading or Downloading a map, make sure that communication with the supervisor (PC with Televis, TelevisGo system, etc.) has been cut off. This means you should make sure that the RS485 is disconnected from the instrument or that Supervision system acquisitions have been stopped.

#### Parameters

The parameters that control this function are:

| Label | Description  |
|-------|--|
| UL    | Transfer programming parameters from instrument to Unicard/MFK<br><b>COLDFACE → Unicard/MFK</b>                |
| dL    | Transfer programming parameters from Unicard/Multi Function Key to instrument<br><b>Unicard/MFK → COLDFACE</b> |
| Fr    | Format the UniCard/Multi Function Key. Erases all data on the UNICARD/MFK                                      |



## 6.2.2. MULTI FUNCTION KEY

The Multi Function Key lets you download/upload a parameter map from/to a controller.

Regardless of whether you are down or uploading a parameter map, the controller must be connected to a power supply and switched on.



## 6.2.3. UNICARD

The UniCard lets you download/upload a parameter map from/to a controller, in the same way as the Multi Function Key.


It is a versatile tool that also allows you to quickly and easily customise devices.

It differs from the Copy Card in the following ways:


- 1) It can be connected directly to a computer via USB
- 2) it can be plugged into a USB socket or USB battery, to power the device directly during upload/download procedures.

The Unicard can be powered in the following ways:

### A) Cabinet powered

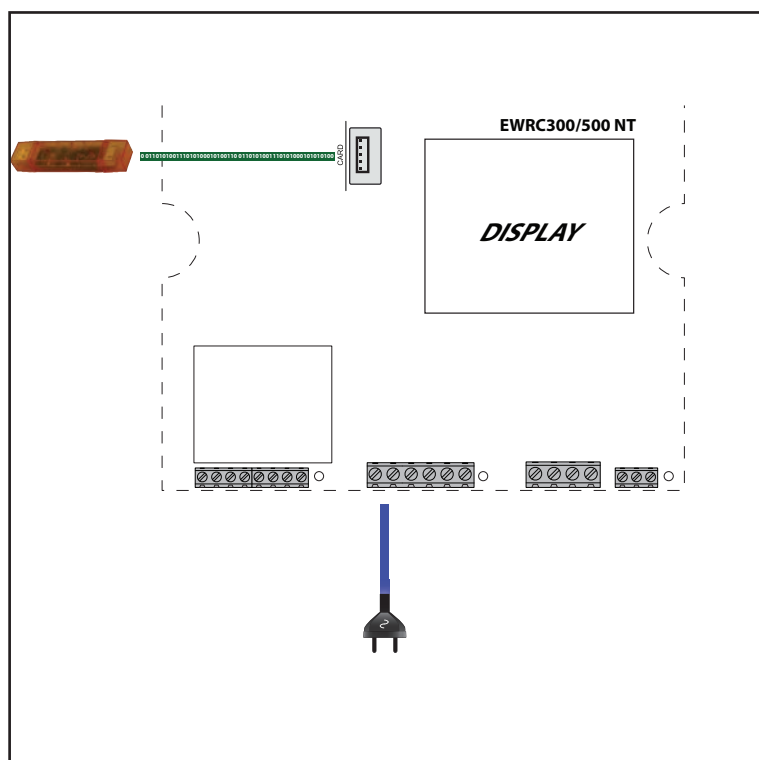

### B) Site powered

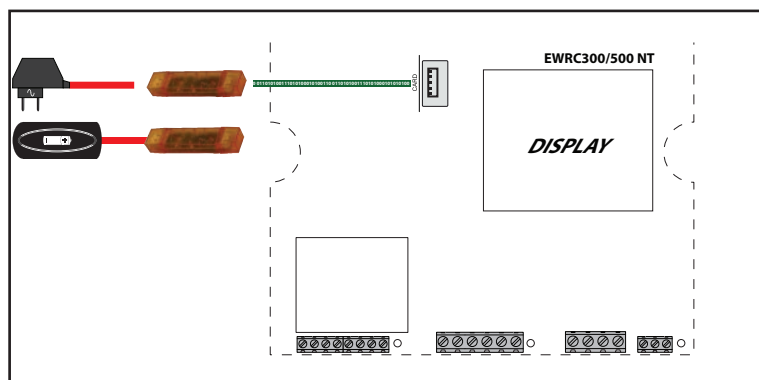



## 6.3. BOOT LOADER FIRMWARE

The device is equipped with a Boot Loader, so it is possible to update the Firmware directly on site. Updating may be carried out using UNICARD or MULTI FUNCTION KEY (MFK).

Updating procedure:

- Connect the UNICARD/MFK equipped with the application;
- Power the device if it is off, otherwise switch it off and on again



**NOTE:** the UNICARD/MFK can be connected even with the instrument powered.

- Wait until the green LED of the UNICARD/MFK is blinking (operation in progress). Note: Steady red LED ONLY for UNICARD;
- The operation will be concluded when the green LED of the UNICARD/MFK is:
  - **ON:** operation concluded correctly
  - **OFF:** operation not performed (application not compatible...)



**IMPORTANT:** the LED display is guaranteed only for UNICARDS produced from week 18-12 onwards.

In order to download the Firmware application on the UNICARD (in CLONE mode as used for parameters maps) you must use the Device Manager (version 05.00.06 or later), which you can download from the Eliwell site after having registered at level 2.



**NOTE:** with this version of the Device Manager the UNICARD can be connected DIRECTLY without using the DMI.



## 6.4. COMPRESSOR

The compressor is controlled by the device's relay. It will be switched on or off depending on:

- the temperature status readings from the cold room probe
- the temperature control functions set
- the defrost/dripping functions (see Defrost section)

### 6.4.1. COMPRESSOR CONFIGURATION

See the wiring diagrams for details of how to connect the compressor to the device.

Relay polarity is fixed.

NOTE: you MUST check the Compressor → digital output (relay) association by setting parameter **H2x** accordingly.

NOTE: by default **H21 = 1 (compressor)**

### 6.4.2. SECOND COMPRESSOR CONFIGURATION

Coldface offers the option of using a second compressor.

NOTE: you MUST check the Compressor 2 → digital output (relay) association by setting parameter **H2x** accordingly.

For example **H25 = 10 (compressor 2)**.

NOTE: to prevent the two compressors from starting up with an insufficient interval in between, an activation delay can be set for the second compressor using the **dSC** parameter

### 6.4.3. COMPRESSOR OPERATING CONDITIONS

Compressor operation

The regulator is active when:


- the device is ON
- there is no control probe fault alarm **E1**
- the time set in parameter **OdO** has elapsed
- a defrost cycle is not underway (except in FREE mode)

(There is a fixed interval of one second between the request and activation of the relay)

The parameters that control this regulator are:

- the setpoint that can be set via the keypad, with a range from minimum to maximum setpoint
- the differential

The diagram below indicates the compressor activation mode for cooling based on parameters **SEt** and **diF** > 0.

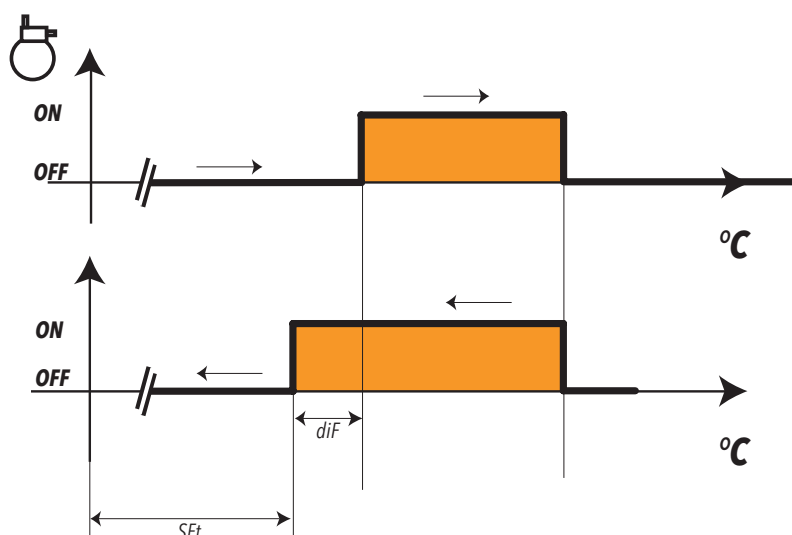



## 6.5. COMPRESSOR/GENERAL PROTECTIONS

### Description

If the cold room probe is in error **E1** the output relay configured as compressor/general regulates in accordance with the times set in parameters **Ont** and **OFt**.

The first time to consider is **Ont**.

If **Ont > 0**, the protection programmed in parameters **dOn-dOF-dbi** must be respected (see Compressor Safety Times).



**NOTE:** You are reminded that parameter **Odo** inhibits the activation of all outputs commanding a relay for its entire duration (compressor/general, defrost, fans), excluding buzzers or alarm relays.

### Operating conditions

The table below lists the ways the compressor relay output can be managed:


| Ont | OFt | Compressor OUT |
|-----|-----|----------------|
| 0   | 0   | OFF            |
| 0   | >0  | OFF            |
| >0  | 0   | ON             |
| >0  | >0  | DUTY CYCLE     |

If **Ont > 0** and **OFt = 0** the compressor regulator entrusts relay deactivation to the safety protection **CAt**.

If **Ont > 0** and **OFt > 0**, the compressor regulator activates in operating cycle mode irrespective of the values read by the probes (cold room probe failure) and of requests from other loads (**Duty Cycle** mode).

If the cold room probe is working properly, the Duty Cycle mode does **NOT** activate as it does not have priority over normal compressor regulator settings.

The following diagram shows the **Duty Cycle** operating mode based on parameters **Ont** and **OFt > 0**:

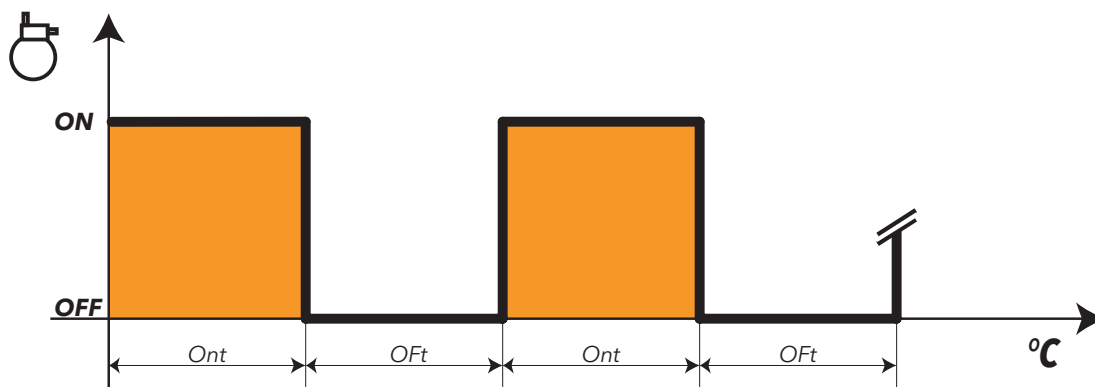



### 6.5.1. COMPRESSOR SAFETY TIMINGS

Compressor on-off operations must respect the safety times that you can set using the special parameters as described below.

The compressor LED will flash to indicate when an activate compressor request has been received but a safety protection exists.

A safety time (compressor On... Off safety time) regulated by the parameter **dOF** must be respected between a switch-off and switch-on of the same compressor. This waiting time also occurs at switch-on of the device.


A safety time regulated by the parameter **dbi** must be respected between one switch-on and the next.

The safety time set in parameter **dOn** must elapse between a start-up request and actual start-up.

Times set with parameters **dOn**, **dOF** and **dbi**, if active, are not accumulative but parallel.

The following diagram illustrates the operation of the compressor protection with parameters **dOn**, **dOF**, **dbi** set where:

|            |   |
|------------|---|
| <b>IN</b>  | Input status for Compressor regulator.  |
| <b>OUT</b> | Output status for Compressor regulator. |

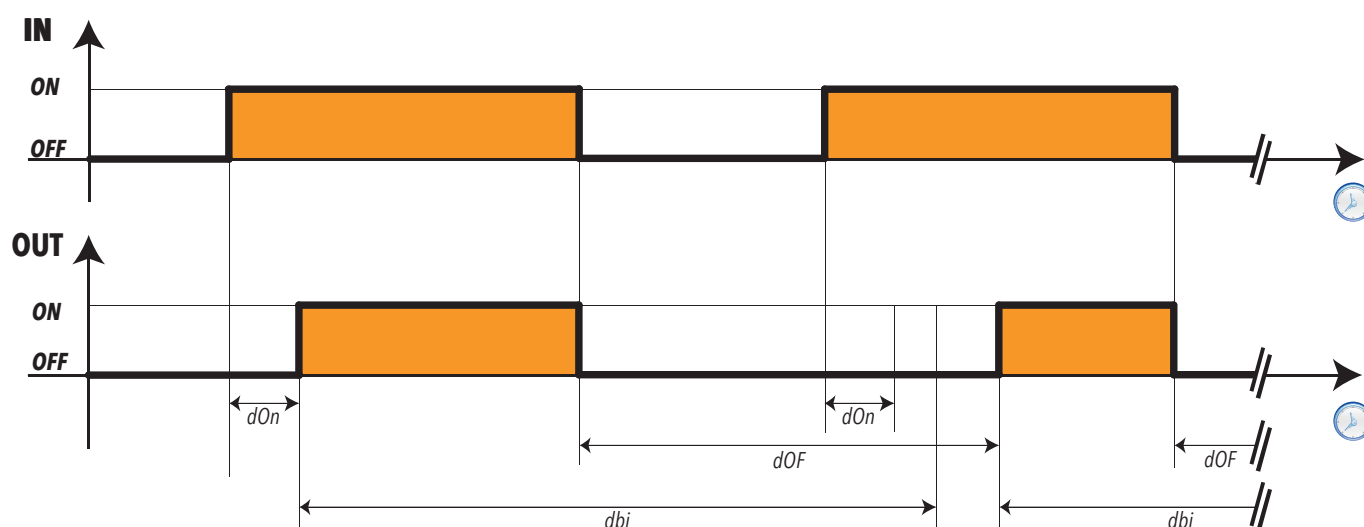

**NOTE:** See the section entitled Compressor Function During Defrost for other safety measures and compressor timings.

#### Maximum timer period

The maximum compressor activation time before its deactivation can be set via the parameter **CA<sub>t</sub>**.

#### Minimum timer period

The minimum compressor activation time before its deactivation can be set via the parameter **C<sub>it</sub>**.

#### User parameters

The parameters that manage this regulator are:

| Label                 | Description   |
|-----------------------|---|
| <b>Ont</b>            | Compressor output ON time in the event of a faulty Pb1 probe  |
| <b>OFt</b>            | Compressor output OFF time in the event of a faulty Pb1 probe |
| <b>dOn</b>            | Compressor output activation delay from request               |
| <b>dOF</b>            | Compressor output activation delay from shutdown              |
| <b>dbi</b>            | Delay between two consecutive starts of the compressor output |
| <b>OdO</b>            | Output activation delay from power-on                         |
| <b>C<sub>it</sub></b> | Minimum compressor output activation time                     |
| <b>CA<sub>t</sub></b> | Maximum compressor output activation time                     |





## 6.6. DEFROST/DRIPPING

### 6.6.1. DEFROST TYPE AND ACTIVATION

Defrost is used to stop ice from forming on the surface of the evaporator. Its **activation** can be:

- automatic, in one of the following modes selected via **dCt**:
  - compressor hours (Digifrost);
  - appliance hours;
  - compressor stopped;
  - via clock (see corresponding paragraph under RTC);
- via D.I.;
- via key;
- remote.

The **type** of defrost can be selected via the parameter **dtY** and can be:

1. defrost with electric heaters;
2. inverse;
3. FREE

#### Dripping

On completion of defrost, given that there will be water on the evaporator, it is better not to start "cooling" right away as this would ruin the effect of the defrost by creating ice immediately.

The dripping interval is regulated via parameter **dt**.

#### Defrost conditions and operation

Defrosting is enabled if:

- The evaporator temperature, read by probe 2, is lower than the defrost end setpoint configured via parameter **dSt**.
- Manual defrosting has not already been activated, in which case the request for automatic defrost will be cancelled.

Defrost requests can be made in the following ways:

|                           |  |
|---------------------------|--|
| Controller power-on       | If parameter <b>dPO</b> (defrost at power-on) is programmed accordingly.   |
| Time intervals            | If <b>dit</b> > 0 whenever the defrost time interval set in parameter <b>dit</b> elapses.  |
| Manually (via key)        | By pressing the <b>UP</b> key.<br>The cycle will not start if <b>OdO</b> ≠ 0, the request will be refused and the display will flash three times to indicate that defrost is impossible.   |
| External request via D.I. | If D.I. appropriately configured.<br>Activation from D.I. respects the protections of the automatic cycle.<br>The cycle will not start if <b>OdO</b> ≠ 0, the request will be refused and the display will flash three times to indicate that defrost is impossible. |

HACCP models also offer the following mode:

|      |   |
|------|---|
| Time | if <b>dit</b> = 0 and <b>dCt</b> =3 with rtc function (real time clock) present.<br>At the times set in parameters dE1...dE8 (dd folder). |
|------|---|



## 6.6.2. AUTOMATIC DEFROSTING

The defrost cycle is programmed to start at intervals.



**NOTE:** To disable the automatic cycle, set **dit**=0.

If **dit**>0, then defrost cycles will be run at fixed intervals, as indicated in parameter **dit**, and the interval time is counted as follows:

| Par.       | Value    | U.M. | Description                                       | Notes   |
|------------|----------|------|---|---|
| <b>dCt</b> | <b>0</b> | num  | Hours of compressor operation (DIGIFROST® method) | In this case, the counter runs only if the compressor is on.<br>A new count starts when the defrost interval elapses and a new defrost cycle starts if conditions permit.<br><b>NOTE:</b> compressor running time is counted separately from the evaporator temperature.<br>If the evaporator probe were missing or faulty, the count would still be active for the period of activity of the compressor.   |
|            | <b>1</b> | num  | Controller running time                           | The defrosting interval is counted continuously when the device is on and starts at each power-on.<br>A defrost cycle starts when the defrosting interval elapses (indicated by dit) if conditions permit and the controller immediately starts counting a new defrosting interval.   |
|            | <b>2</b> | num  | Compressor stop                                   | Each time the compressor stops, a defrost cycle is run according to the mode set in parameter <b>dtv</b> .  |
|            | <b>3</b> | num  | RTC (clock)                                       | The clock can be used to set:<br>• defrost times ( <b>6</b> bands for weekdays and <b>6</b> bands for weekends)<br>• regular defrosts (every <b>n</b> days)<br>• daily events ( <b>1</b> event for weekdays and <b>1</b> event for weekends)<br><br>Time band defrosts and periodic defrost are mutually exclusive functions (they cannot be activated simultaneously).<br><br>If defrost by RTC has been enabled and the clock has failed, the defrost will run according to the mode set in <b>dit</b> (provided the value is <b>≠ 0</b> ). |



**IMPORTANT:** regardless of how the interval is counted, the following conditions apply:

If parameter **OdO** is underway or the temperature read by the evaporator probe is higher than **dSt**, then defrost will not be permitted: a new interval will be counted and only at the end of this subsequent count will conditions be tested for the start of a defrost cycle.

## 6.6.3. MANUAL DEFROST

If you press and hold **ESC** for manual defrost (or via D.I. if **H11 ... H12 = 1** is suitably configured), the appliance enters defrost mode. Procedures for the activation of this defrost cycle are the same as for external defrost.

The defrosting interval will now be counted as described for Automatic Defrost (time **dEt** is not cleared, it continues).

If the conditions for defrost activation are not present, i.e.:

- the time set in parameter **OdO** has not elapsed
- the evaporator temperature is higher than the value set in parameter **dSt**

this will be signalled on the display (screen flashes three times) and defrost will stop.

Manual defrost is always enabled except when **dit** = 0.



## 6.6.4. EXTERNAL DEFROST

If the Digital Input is configured for this function (if **H11 ... H18 = 1**) and if conditions permit, defrost can be requested and the relative regulator activated.


Time graphs for signals in each of the various function modes are presented below.



**IMPORTANT:** Defrost activation occurs when the signal is toggled and the polarity can be selected. Hence you can only activate a defrost, NOT stop one that is underway. Defrost or dripping currently underway and the defrost or dripping interval count cannot be suspended.

|                           |   |
|---------------------------|---|
| <b>IN (Digital Input)</b> | Input status for defrost regulator, with activation from Digital Input.   |
| <b>OUT (Defrost)</b>      | Output status for defrost regulator.  |
| <b>DurDI</b>              | Digital Input duration.   |
| <b>NOTE:</b>              | <b>dSt</b> indicates end defrost time when Setpoint temperature reached and <b>dEt</b> indicates end of defrost due to timeout. |

The control diagram is as follows:

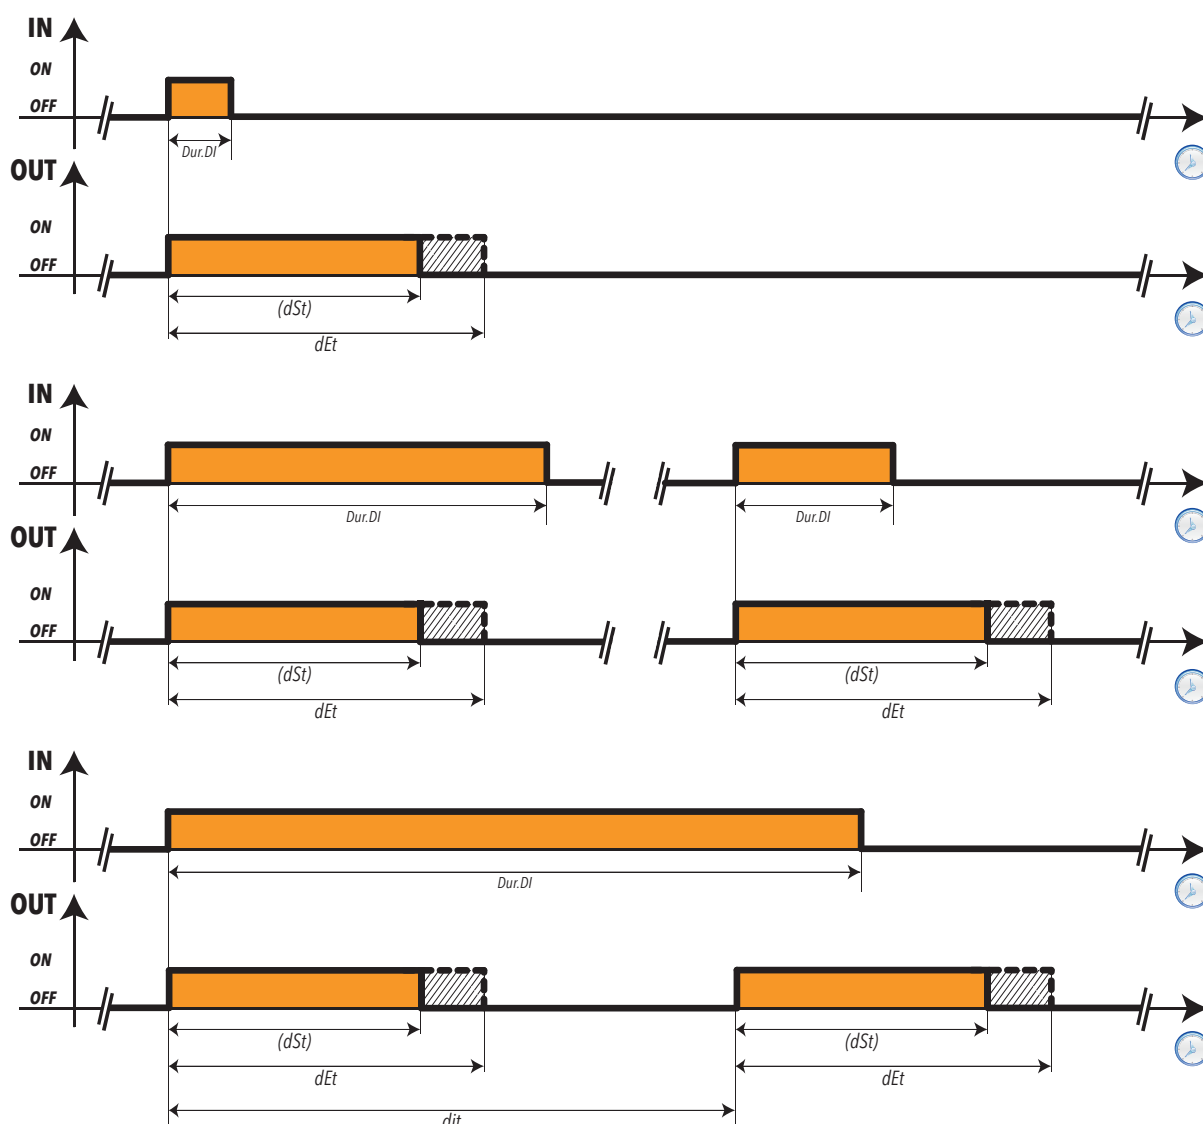



## 6.7. DEFROST MODE

### 6.7.1. DEFROST WITH ELECTRIC HEATERS

Defrost with electrical heaters is configured by setting **dtY = 0**.

The compressor remains stopped for the duration of the defrost cycle and the relay configured as defrost regulator output, to which the electrical heaters are connected, activates. On completion of defrost, the electrical heaters are switched off and the compressor remains off for the dripping time set in parameter **dt**, if it is not equal to zero.


Defrost ends due to:

| Evaporator Probe         | End of defrost description  |
|--------------------------|---|
| Evaporator Probe ABSENT  | Due to timeout set in parameter <b>dEt</b> (defrost timeout).   |
| Evaporator Probe PRESENT | Temperature setpoint for the end of defrost set in parameter <b>dSt</b> reached.<br>If this setpoint is not reached within the time set in parameter <b>dEt</b> (defrost timeout), the defrost will end due to timeout. |

#### NOTES:

- If **dSt** intervenes before **dEt**, dripping (**dt** and **Fdt**) aligns with **dSt**.
- If **Fdt < dt** then **Fdt = dt**.
- During defrost, fans are OFF if parameter **dFd** is set accordingly, otherwise they will behave as set for the fan regulator.

The operating diagram is as follows:

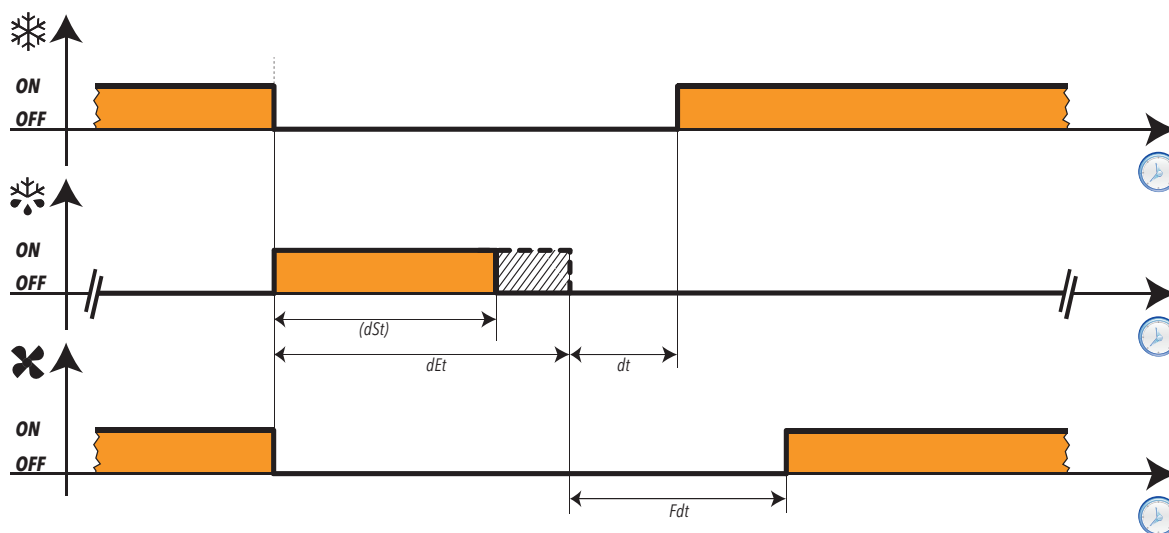

Legend:

|  |   |
|--|---|
|  | Output status for <b>Compressor regulator</b>     |
|  | Output status for <b>Defrost regulator</b>        |
|  | Output status for <b>Evaporator Fan regulator</b> |



## 6.7.2. INVERSE DEFROST

Hot gas defrost is configured by setting parameter **dtY = 1**.

The compressor stays on for the entire duration of the defrost cycle and the relay configured as defrost regulator output, and that the solenoid valve is connected to, activates.

On completion of the defrost cycle, the solenoid valve relay is de-energised and the dripping phase set in parameter **dt** (if not equal to zero) is interrupted. The compressor relay is once again controlled by the compressor regulator.

Defrost ends due to:

| Evaporator Probe            | End of defrost description  |
|-----------------------------|---|
| Evaporator Probe<br>ABSENT  | Due to timeout set in parameter <b>dEt</b> (defrost timeout).   |
| Evaporator Probe<br>PRESENT | Temperature setpoint for the end of defrost set in parameter <b>dSt</b> reached.<br>If this setpoint is not reached within the time set in parameter <b>dEt</b> (defrost timeout), the defrost will end due to timeout. |



**IMPORTANT:** parameters **dOn**, **dOF** and **dbi** still have priority.

### NOTES:

- If **dSt** intervenes before **dEt**, dripping (**dt** and **Fdt**) aligns with **dSt**.
- If **Fdt** < **dt** then **Fdt** = **dt**.
- During defrost, fans are OFF if parameter **dFd** is set accordingly, otherwise they will behave as set for the fan regulator.

The operating diagram is as follows:





### 6.7.3. DOUBLE EVAPORATOR DEFROST

The defrost for a second evaporator can be controlled via the probe configured as second evaporator.

Configure a relay output (see configuration parameters H21...H25) as a defrost relay for evaporator 2.

To enable this function, you need to:

- Set probe Pb3 to control defrost evaporator 2 mode (parameter H43).
- Configure a relay output (see configuration parameters H21...H25) as a defrost relay for evaporator 2.
- Define defrost mode by setting parameter H45.

#### Input mode

A double evaporator defrost can take place in three different ways on the basis of parameter **H45**, as described below:

- H45=0: Defrost is enabled only when the temperature of evaporator 1 is lower than the value set in parameter **dSt**.
- H45=1: Defrost is enabled when the readings from at least one of the two probes is below its defrosting end temperature (**dSt** for evaporator 1 and **dS2** for evaporator 2).
- H45=2: Defrost is enabled when both probe values are below the relative end of defrost setpoints (**dSt** for evaporator 1 and **dS2** for evaporator 2).

The probe error condition is considered as a probe calling for defrost.

The defrost for every single evaporator ends when the following conditions have been met:

- the **dEt/dE2** timeout period has begun
- the **dSt/dS2** temperature has been reached

#### Ending mode

for defrost in the case of a double evaporator takes place when both probe values have reached or exceeded the relative end of defrost setpoints (dSt for evaporator 1 and dS2 for evaporator 2).

If one or both probes are in error, the end of defrost will take place due to timeout.

#### In any case

If there are no conditions for performing the defrost the request will be cancelled.

The defrost for a single evaporator will end when the corresponding probe reaches or exceeds the defrosting end temperature or when the timeout period begins.

Dripping begins when both defrosts have ended.

If one or both probes are in error, the defrost for the corresponding evaporator will end due to timeout. Onset is allowed as if the corresponding temperature is lower than the corresponding setpoint (dSt or dS2).

If the probe is not configured to be the probe for the second evaporator ( $H43 \neq 2$ ), the defrost for the second evaporator may take place if a digital output is configured to control defrost on the second evaporator ( $H21..H25 = 9$ ). In this case consent for defrost will be granted, as if the probe temperature (2nd evap.) < dS2 and the output takes place due to timeout. The fan regulator is not affected.



## User parameters

The parameters that manage this regulator are:

| Label | Description  |
|-------|--|
| dt    | Selects defrost type   |
| dit   | Time interval between 2 consecutive defrost cycles                                       |
| dCt   | Selects the count mode for the defrost interval  |
| dOH   | Defrost cycle activation delay after request   |
| dEt   | Defrost timeout, evaporator 1. Determines the maximum defrost duration                   |
| dE2   | Defrost timeout, evaporator 2. Determines the maximum defrost duration                   |
| dSt   | Defrost 1 end temperature - determined by evaporator probe 1                             |
| dS2   | Defrost 2 end temperature - determined by evaporator probe 2                             |
| dPO   | Determines whether the instrument must enter defrost mode at power-on                    |
| Fdt   | Fan activation delay after a defrost cycle   |
| dt    | Dripping time  |
| dFd   | Allows exclusion of the evaporator fans to be selected or not selected during defrosting |
| dAO   | Temperature alarm disabling time after defrost cycle                                     |
| dAt   | Alarm signalling end of defrost due to timeout   |
| ddL   | Display mode during defrost cycle (lock display)   |
| Ldd   | Timeout value for display unlock - label dEF   |

Summary table

### Defrost on evaporator 1

| Defrost START   |  | Defrost END  |
|---|--|--|
| If H45=0  | Probe Pb3 temperature (evap. 2) (evap. 1) < dSt  | Probe Pb3 temperature (evap. 2) (evap. 1) > dSt<br>or if<br>Probe Pb3 temperature (evap. 2) (evap. 1) < dSt due to<br>timeout<br>or if probe Pb2 in error due to timeout |
| If H45=1  | Probe Pb3 temperature (evap. 2) (evap. 1) < dSt  |  |
| If H45=2  | Probe Pb3 temperature (evap. 2) (evap. 1) < dSt and<br>Probe temperature (evap. 2) < dS2 |  |
| Note: if the probe is in error or H43≠2 and a digital output is configured as a regulator for the second evaporator, the following condition applies: Probe temperature (evap. 2) < dS2 |  |  |

### Defrost on evaporator 2

| Defrost START   |   | Defrost END   |
|---|---|---|
| If H45=0  | Probe Pb3 temperature (evap. 2) (evap. 1) < dSt<br>and<br>Probe temperature (evap. 2) < dS2 | Probe 3 temperature (evap. 2) > dS2<br>or if<br>Probe temperature (evap. 2) < dS2 due to timeout<br>or if probe in error due to timeout |
| If H45=1  | Probe temperature (evap. 2) < dS2   |   |
| If H45=2  | Probe Pb3 temperature (evap. 2) (evap. 1) < dSt<br>and Probe temperature (evap. 2) < dS2    |   |
| Note: if the probe is in error or H43≠2 and a digital output is configured as a regulator for the second evaporator, the following condition applies: Probe temperature (evap. 2) < dS2 |   |   |

### Dripping

| Drip cooling START |  | Drip cooling END |
|--------------------|--|------------------|
|                    | End of defrost for both evaporators if defrosting takes place for both evaporators, otherwise end of the only defrost in progress. | Unchanged        |



## 6.8. EVAPORATOR FANS

### 6.8.1. EVAPORATOR FAN OPERATING CONDITIONS

The regulator is active when:

- the time set in parameter **OdO** has elapsed.
- the temperature of the evaporator probe, if present, is between the values of the parameters **Fot** and **FSt**.
- during defrost it is not excluded by the parameter **dFd** (**dFd = On**).
- dripping is not active (**dt**).
- the fan delay is not active after defrost (**Fdt**).

The request to switch fans on or off can be made in the following ways:


- by the compressor regulator to help in the "cooling" process (temperature control mode)
- by the defrost regulator to check and/or limit the diffusion of hot air

|                            | FCO | Compressor ON         | Compressor OFF        |
|----------------------------|-----|-----------------------|-----------------------|
| Probe present and working  | 0   | THERMOSTAT CONTROLLED | OFF                   |
|                            | 1   | THERMOSTAT CONTROLLED | THERMOSTAT CONTROLLED |
|                            | 2   | THERMOSTAT CONTROLLED | THERMOSTAT CONTROLLED |
|                            | 3   | THERMOSTAT CONTROLLED | DUTY CYCLE*           |
|                            | 4   | THERMOSTAT CONTROLLED | DUTY CYCLE* **        |
| Probe present but in error | 0   | DUTY CYCLE            | OFF                   |
|                            | 1   | ON                    | OFF                   |
|                            | 2   | DUTY CYCLE            | DUTY CYCLE            |
|                            | 3   | DUTY CYCLE            | DUTY CYCLE            |
|                            | 4   | DUTY CYCLE            | DUTY CYCLE            |
| Probe absent               | 0   | ON                    | OFF                   |
|                            | 1   | ON                    | ON                    |
|                            | 2   | DUTY CYCLE*           | DUTY CYCLE*           |
|                            | 3   | ON                    | DUTY CYCLE*           |
|                            | 4   | ON                    | DUTY CYCLE* **        |

\* see paragraph "Fan operation with Pb2 absent" (H42 ≠ 0).

\*\* Normal Duty-Cycle operation reversed (OFF cycle - ON cycle)

The graphs below illustrate fan operation on the basis of the **FCO** value. In the graphs, we can see that:

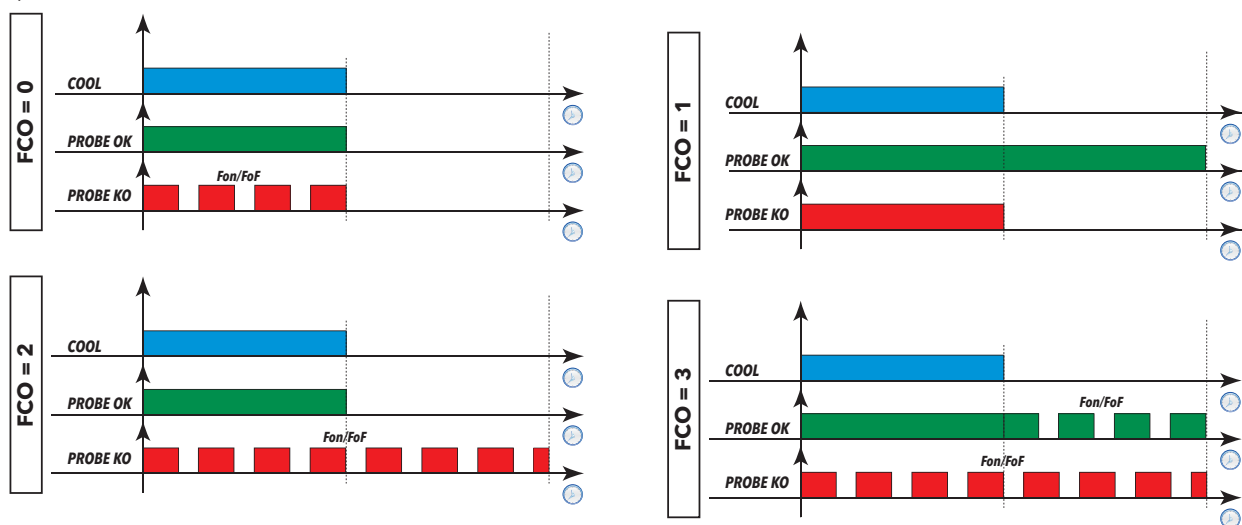

Legend:

|                 |   |
|-----------------|---|
| <b>COOL</b>     | Cooling   |
| <b>Probe OK</b> | Fan operation with the probe present and working  |
| <b>Probe KO</b> | Fan operation with the probe present but in error |





### 6.8.2. FAN OPERATION IN THERMOREGULATION MODE

During "cooling", the fans operate as shown in this diagram:

Thermostat control of fans takes place at the values set in parameters

- **FSt** (fan disabling temperature) and **FAd** (fan differential).
- **Fot** (fan start temperature) and **FAd** but with the sign inverted.

By default, the fan disabling temperature, set by parameters **FSt** (fan disabling temperature) and **FAd** (fan differential), is an absolute value, as **FPt** = 0 (actual temperature value).


Depending on the parameter **FPt**, the fan disabling temperature set at parameter **FSt** can be absolute (actual temperature value) or relative (value to add to the Setpoint **SEt**).

Depending on the parameter **FPt**, the fan start temperature set at parameter **Fot** can be absolute (actual temperature value) or relative (value to add to the Setpoint **SEt**).

**IMPORTANT:** if as an absolute value the parameter **Fot** is greater than **FSt** the fans will be excluded

Around the fan start temperature (-50°C by default) the differential will always take account of the differential parameter **FAd** but with the sign inverted (negative side). Fan stop in **Fot**, and activation at value (**Fot** + **FAd**).

The fan regulator operates as indicated below:

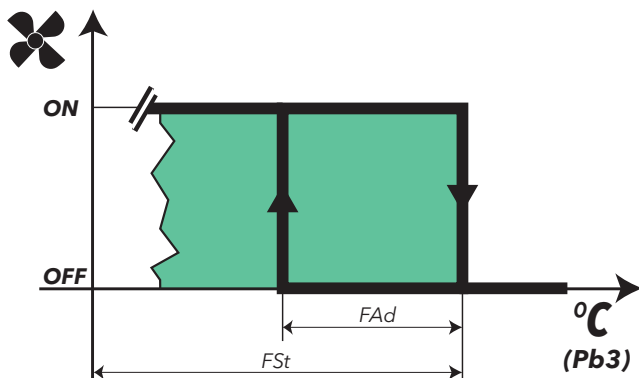


### 6.8.3. FAN OPERATION IN DUTY CYCLE MODE

For Duty cycle operation, parameters **Fon** and **FoF** must be set accordingly.

The fans operate as follows:

| DUTY CYCLE |     |               |
|------------|-----|---------------|
| Fon        | FoF | Fan operation |
| 0          | 0   | OFF           |
| 0          | ≠0  | OFF           |
| ≠0         | 0   | ON            |
| ≠0         | ≠0  | DUTY CYCLE    |

The fan regulator will operate in Duty Cycle mode as illustrated below:

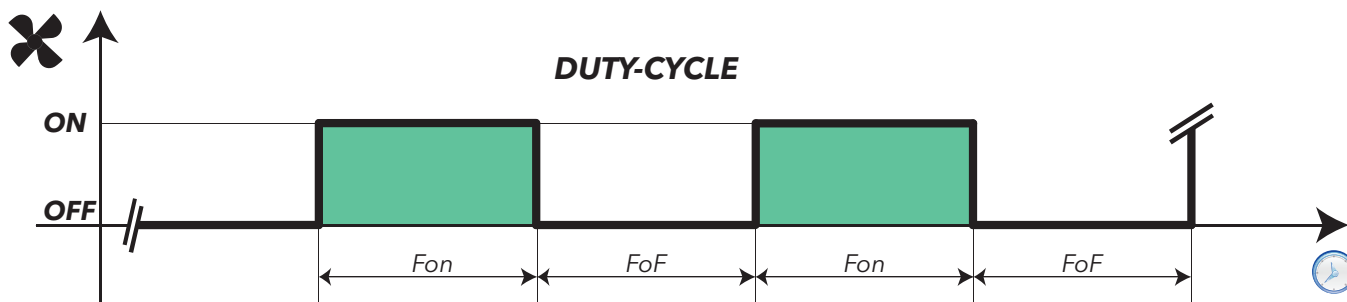




## 6.8.4. FAN OPERATION IN DEFROST

During defrost, the fans operate as shown in this diagram:

|   |                                      |
|---|--------------------------------------|
| <b>dFd</b> = OFF: exclusion of fans during defrost  | <b>OFF</b>                           |
| <b>dFd</b> = On: fans are not excluded during defrost<br>(see parameters <b>FCO</b> , <b>Fon</b> , <b>FoF</b> ) | <b>THERMOREGULATION / DUTY CYCLE</b> |

Thermostat control of fans takes place at the values set in parameters:

- **FSt** (fans disabling temperature) and **FAd** (fans differential).

 **NOTE:** during defrost with electrical heaters, the compressor is OFF but the fans work as if the compressor was still ON, unless they have been disabled during defrost (see parameter **dFd**).


When the evaporator fans are enabled in defrost (**dFd = On**) and regulate the evaporator probe Pb2 in thermoregulated mode, when the latter enters error "E2" during defrost, the fans must always be ON, regardless of the values set via the Duty Cycle.

### 6.8.4.1 Fan operation without probe

If parameter **H42 = n** (probe Pb2 absent), depending on the FCO value and the status of the compressor, the fans may assume the status "On", "Off", "Duty Cycle".

The parameter **FCO** will determine the operating mode of the evaporator fans during the DAY phase and the NIGHT phase.

The following is an example of fan operation on the basis of the value set for **FCO**.

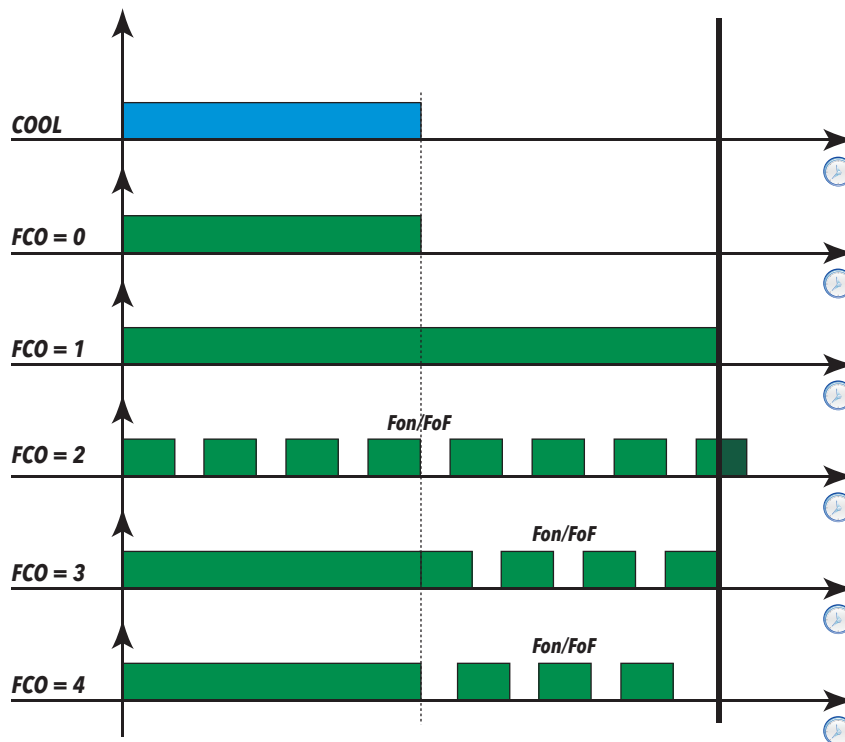



## 6.8.5. FAN FUNCTION DURING DRIPPING

If parameter **dt**  $\neq 0$  (dripping time), the fans will stay OFF for the time set in this parameter.

See "**Defrost with electrical heaters**".

Note that if **Fdt** (fan delay time) is greater than **dt** (dripping time) the fans stay OFF for the time set in **Fdt** rather than **dt** (e.g. whichever timing is longer will be applied).

## 6.8.6. POST-VENTILATION

Parameter **FdC** delays the switching off of the fans after the compressor has stopped (increasing efficiency of the system by making better use of inertia). Post-ventilation must be active with any FCO value and without a configured probe.

If **FdC = 0** the function is disabled.

 **NOTE:** Post-ventilation does not have priority over the delay set by parameter **dcd**.

### User parameters

The parameters that manage the fan regulator are:

| Label | Description  |
|-------|--|
| FPt   | Characterises parameter "FSt" which can be expressed either as an absolute value or relative to the setpoint |
| FSt   | Evaporator fans disabling temperature  |
| Fdt   | Evaporator fans delay after defrost cycle  |
| dFd   | Evaporator fans disabling during defrost time  |
| FCO   | Evaporator fans operating mode   |
| FAd   | Evaporator fans activation differential  |
| dt    | Dripping time  |
| FdC   | Evaporator fans switch-off delay after compressor disabled   |
| Fon   | Evaporator fans ON time in duty cycle mode   |
| FoF   | Evaporator fans OFF time in duty cycle mode  |



## 6.9. DEEP COOLING CYCLE - DCC

### Description

This regulator ensures that the compressor regulates the setpoint **dCS**, with differential equal to the value set via parameter **diF**. When the **DCC** (Deep Cooling Cycle) activates, the interval between defrost cycles is cleared and defrosts disabled. Ending of the **DCC** is time-based, by setting the parameter **tdc**≠**0**, or when the setpoint **dCS** is reached if **tdc = 0**.

When a **DCC** has ended and once the time set in parameter **dcc** has elapsed, a defrost cycle is forced and the counters restart for the interval between defrost cycles (value set via parameter **dit**). If **dcc=0** defrost begins at the end of the **DCC**. During the **DCC** the temperature alarms are disabled.

Normal temperature alarm management is restored at the end of the **DCC**, when the temperature value read by probe **PB1** reaches the regulation setpoint value **SEt**.

### Operating conditions


The Deep Cooling Cycle will be activated via Digital Input or via a suitably configured key.

In the event of a probe error and/or power failure, the Deep Cooling Cycle is stopped and standard controller function restored.

If parameters **dCS**, **tdc** and **dcc** are modified, the Deep Cooling Cycle is recalculated with the new values set.

 **NOTE:** After a Deep Cooling Cycle, the **dcc** time must elapse before a new cycle can begin.

The control diagram is as follows:

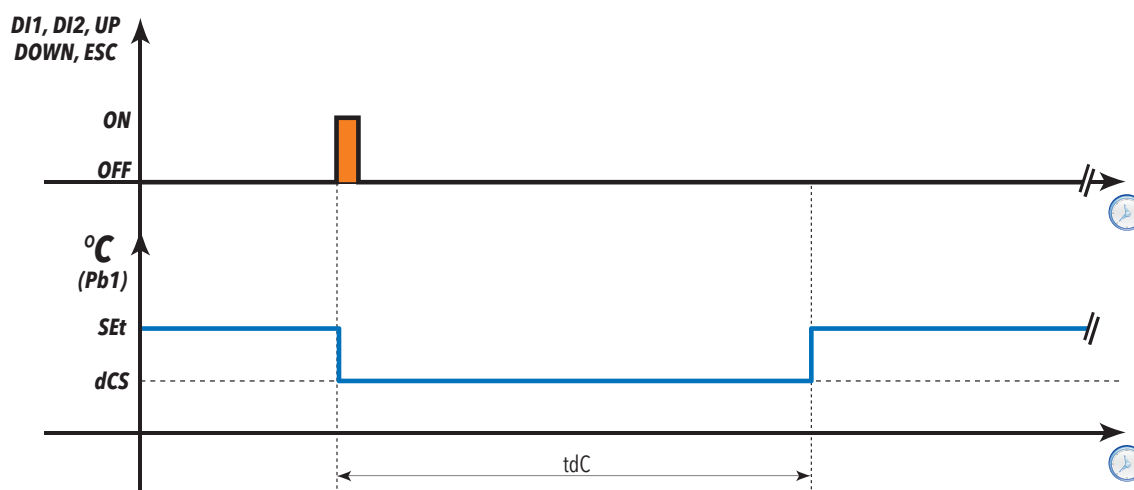

### User parameters

The parameters that manage the fan regulator are:

| Label | Description                       |
|-------|-----------------------------------|
| dCS   | Deep Cooling Setpoint             |
| tdc   | Deep Cooling Time                 |
| dcc   | Defrost Delay after Deep Cooling. |

## 6.10. PREHEAT

The pre heating phase is connected to a suitably configured digital input (**H11 / H12 = ±12**).

In the period when the preheat output is active:

- the compressor output will be forced OFF;
- the compressor LED will blink.

The Preheat only affects defrosting in applications that require the use of the compressor (**dtY**= 1 and **dtY**= 2).



## 6.11. PRESSURE SWITCH

### Description

This regulator performs diagnostic procedures on an activated digital input by assigning the value  $\pm 11$  (General pressure switch),  $\pm 09$  (Minimum pressure switch) or  $\pm 10$  (Maximum pressure switch) to one of the parameters **H11/H12**.

If a pressure switch input is activated, power to the compressor loads is immediately cut off, the relative alarm LED lights up to provide a visual warning and the alarms folder **ALr** is also displayed. The folder contains labels with the number of pressure switch activations (up to the maximum value set in parameter **PEn**):

- **P01, P02, ...P0n...** for general pressure switch
- **H01, H02, ...H0n...** for maximum pressure switch
- **L01, L02, ...L0n...** for minimum pressure switch

If the number of activations exceeds the maximum number defined by parameter **PEn** within a time less than the value of **PEi**, the following conditions occur:

- The compressor, fan and defrost outputs are disabled.
- In the alarms folder **ALr** the label **PA, LPA** or **HPA** (general, minimum or maximum pressure switch respectively) is displayed.
- The alarm relay comes on (if configured).

- IMPORTANT:** 1) If the number of activations does not exceed the number set in **PEn** within the time limit **PEi**, the alarm is automatically cleared.  
 2) The input must be:
- closed on itself if unused and the input is active when normally closed;
  - open if unused and active when normally open;
  - deactivated via digital input configuration parameter.

- NOTES:** 1) Once it has entered alarm status, the device must be switched off and on again, or reset using the **rPA** key in the functions menu.  
 2) If parameter **PEn = 0**, the function is disabled and alarms and counters are also disabled.  
 3) The pressure switch alarm is not stored in EEPROM.  
 4) During the pressure switch activation period the defrost interval count runs as normal.

### Operating conditions

The number of pressure switch errors is counted using a FIFO method. The time interval **PEi** is divided into 32 parts; the counter is incremented by one unit if there are one or more activations during one part of the entire interval **PEi**.

Two operating examples are given below: In both cases, suppose that **PEi = 32'** (equal to  $32'/32 = 1$  minute) and **PEn = 7**.

#### Example 1: ALARM SIGNALLED.

The interval for storing activations is 1 minute: all activations within that minute are counted as a single activation and the alarm (if any) is activated when the sampling interval has elapsed. In this example the pressure switch alarm is signalled because there have been 7 activations during the 32' time window.

#### Example 2: ALARM NOT SIGNALLED.

In this example the alarm is not activated because during the 32' time window the number of activations set in parameter **PEn** was not reached. In practice the time window is a rolling window and all activations that are outside of it are deleted: the reference point is the last activation and the time **PEi** is subtracted from that point to establish how many activations are included in the count.



### User parameters

The parameters that manage the pressure switch regulator are:

| Label | Description  |
|-------|--|
| PEn   | Number of errors allowed per general/maximum/minimum pressure switch input |
| PEI   | General/minimum/maximum pressure switch error count interval (in 32 parts) |



## 6.11.1. AUXILIARY OUTPUT (AUX/LIGHT)

### Description

If one of the parameters **H21...H25** is set to the value **H2x=5**, it anticipates the relay control as AUX and, by pressing the associated key **H32...H35** - which should be set to the value **H3x=2**, the relay is activated if it was off previously and vice-versa.

The on/off status is saved in non-volatile memory hence when power returns after a blackout, the device will restart in the status that was active prior to the blackout.

If one of the parameters **H11...H12** is set to the value **H11, H12=±3**, it anticipates the AUX relay control by the digital input; in this case the relay will mirror the status of the input. In this case, on/off status is not saved in non-volatile memory.



**IMPORTANT:** the meaning of the D.I. must always remain the same: for example, if the relay is activated by D.I. and switched off by key, when the D.I. is reset to the starting position, the relay does not change status (since it was already de-energised by key). With the instrument OFF, if set accordingly, only the digital input (D.I.) and the associated key can change the status of the output.

### Operating conditions

The regulator is activated by:


- Key
- Function
- Digital input

if configured accordingly.

The regulator is not active when:

| Condition       | AUX output status                                       |
|-----------------|---|
| during start-up | OFF   |
| during stand-by | status depending on parameter <b>H06</b> and <b>H08</b> |

The control diagram is as follows:

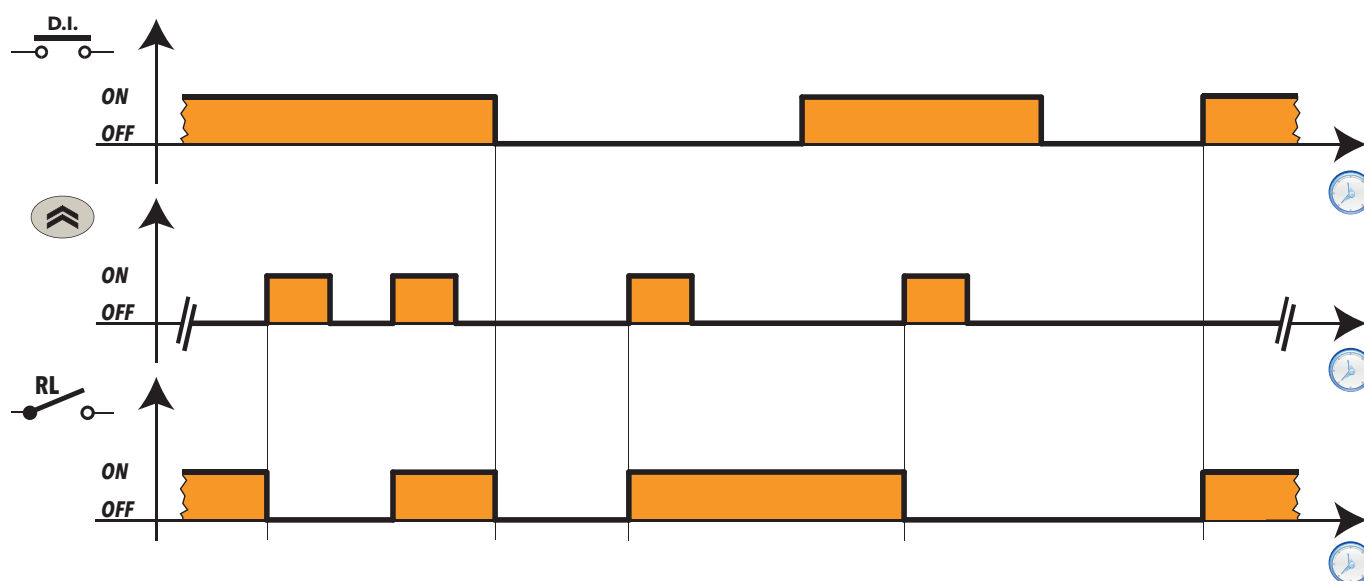

### User parameters

The parameters that manage the auxiliary (AUX) output regulator are:

| Label     | Description                                     |
|-----------|---|
| H11...H12 | Configuration of digital input 1...2 / Polarity |
| H21...H25 | Configuration of digital output 1...5           |
| H32...H35 | Configuration of DOWN, ESC, ON/OFF, LIGHT key   |



## 6.12. DOOR/EXTERNAL ALARM MANAGEMENT

The door switch input is associated to an appropriately configured digital input (**H1x = ±4**). By controlling the opening of the door, it is possible to deactivate the compressor output and/or the fans. It is also possible to associate a deactivation delay to the compressor output by means of parameter **dCO**. If the door is opened during a defrost cycle, the cycle is not shut down.

The values that can be set for the parameters involved are:

**dod**: Door switch switches off loads on D.I. command.

- **0** = function disabled
- **1** = disables fans (FAN)
- **2** = disables the compressor (COMP)
- **3** = disables the compressor (COMP) and fans (FAN)

Any protective timers (e.g. compressor start delay, etc.) will still be observed.

**rLO**: Locks compressor, defrost and fan regulators if the digital input (configured as external alarm) is activated.

- **0** = no resource locked
- **1** = compressor and defrost locked
- **2** = compressor, defrost and fans locked

**doA**: Establishes what should be activated/deactivated on activation/deactivation of the digital input. Only applies if **PEA** ≠ 0.

- **0** = activates the compressor (COMP)
- **1** = activates fans (FAN)
- **2** = activates the compressor (COMP) and fans (FAN)
- **3** = deactivates the compressor (COMP)
- **4** = deactivates fans (FAN)
- **5** = deactivates the compressor (COMP) and fans (FAN)

**PEA**: Establishes which of the door switch and alarm should be linked to the parameter **doA** in the following way:

- **0** = function deactivated
- **1** = function linked to door switch
- **2** = function linked to external alarm
- **3** = function linked to door switch and external alarm




**dCO**: Compressor resource activation/power off delay (0 ... 255 min).


**dFO**: Evaporator Fan resource activation/power off delay (0 ... 255 min).

**tdO**: Door open alarm exclusion time (0 ... 255 min). The door open alarm will be activated if the door remains open for a time period greater than the setting for this parameter.

The way in which parameters **dCO** and **dFO** act depends on how the parameter **doA** is configured. To better understand the meaning of these parameters, refer to the figures below.

The graphs below illustrate fan operation on the basis of the **doA** value. In the graphs, we can see that:

|   |                 |
|---|-----------------|
|  | Door            |
|  | Evaporator fans |
|  | Compressor      |

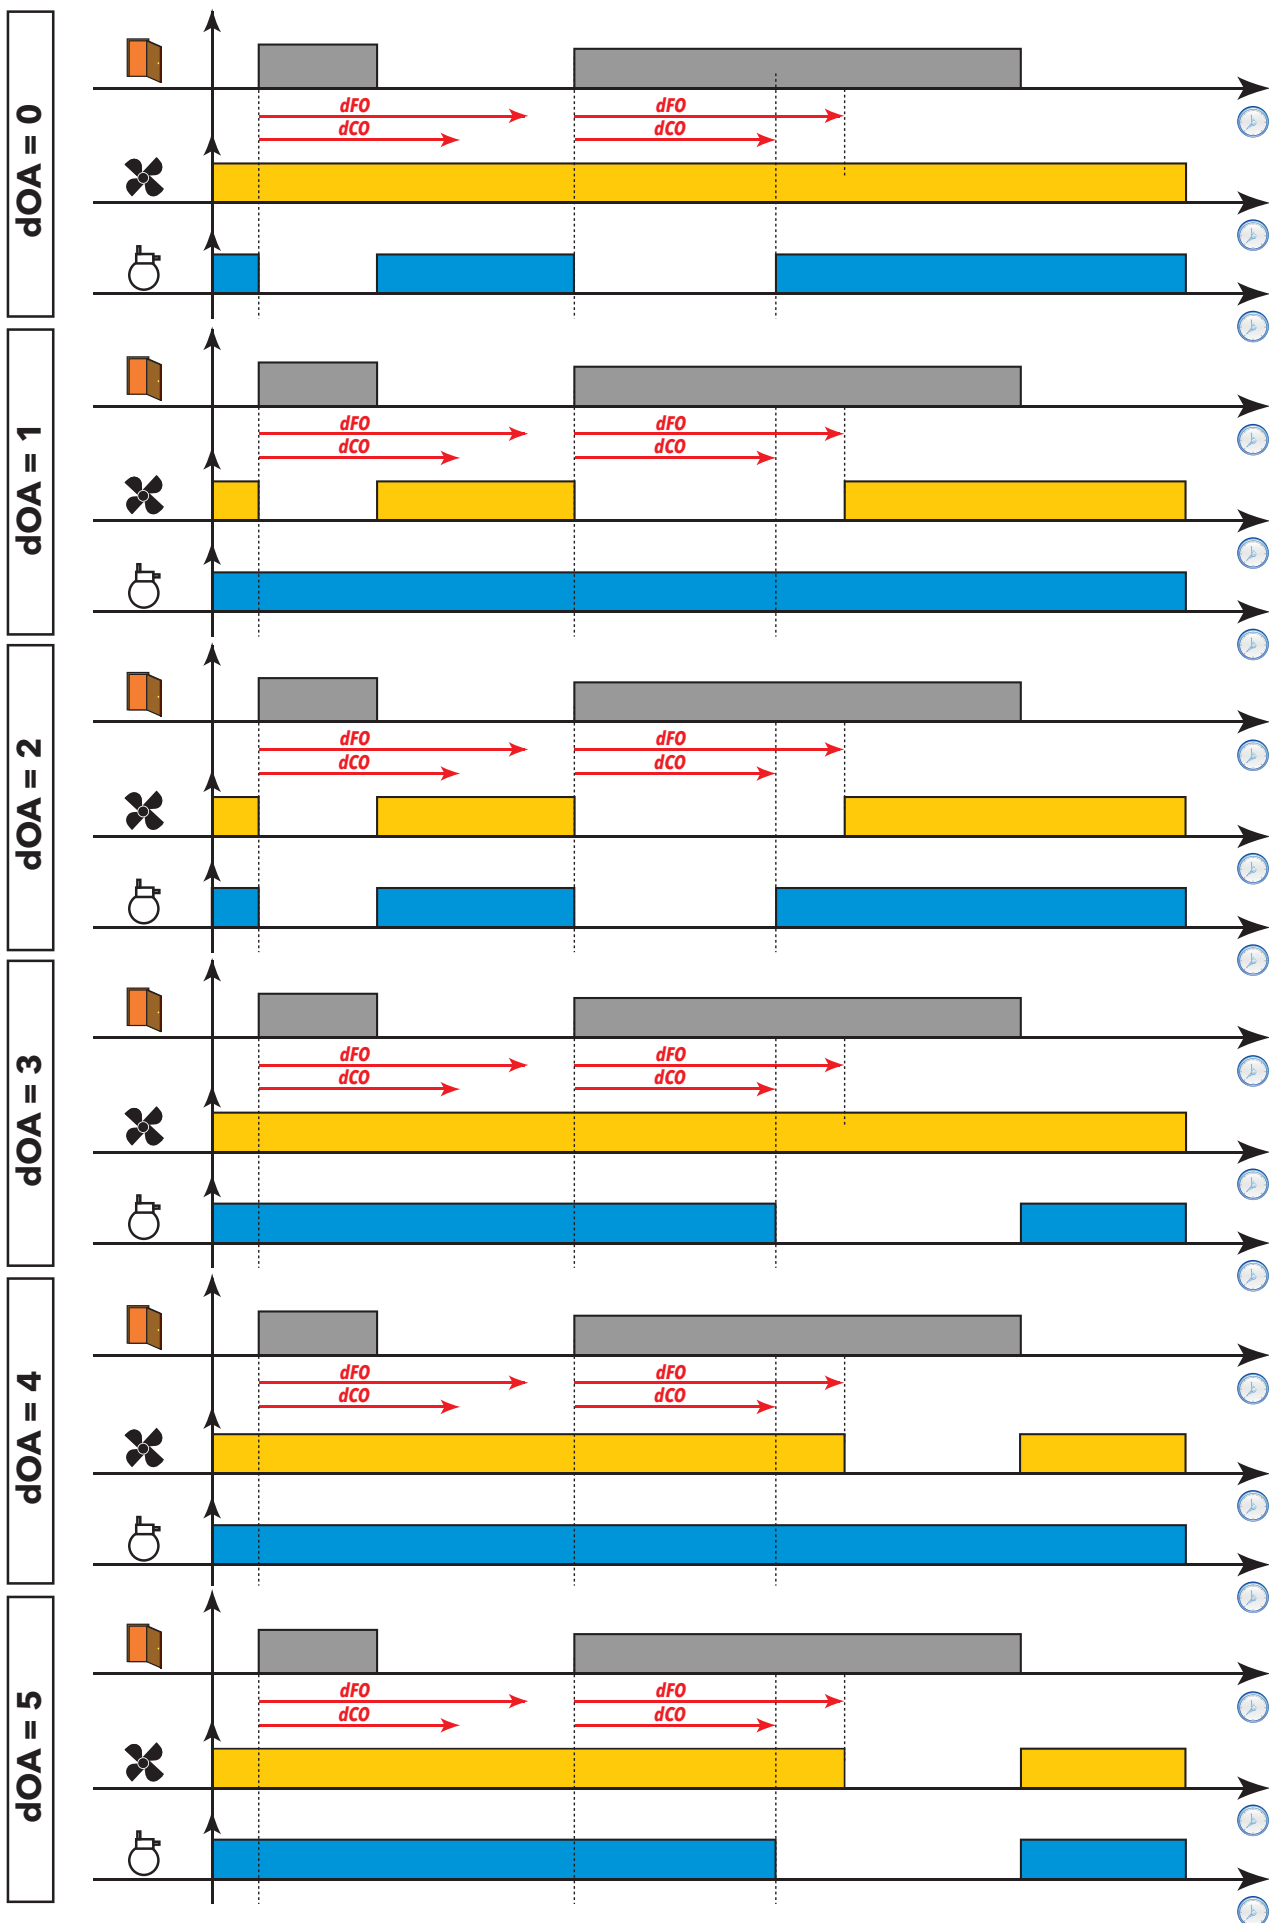





## 6.13. DEMISTING HEATERS (FRAME HEATERS)

The controller is equipped with a regulator for the frame heaters.

### Description

#### Operating conditions

The table below lists the ways the relay output can be managed:


| HOn | HOF | FRAME HEATER OUT |
|-----|-----|------------------|
| 0   | 0   | OFF              |
| 0   | >0  | OFF              |
| >0  | 0   | ON               |
| >0  | >0  | DUTY CYCLE       |

Where **HOn** = 0 the regulator is always off, while if **HOn** > 0 and **HOF** = 0 the regulator is always on.

If **HOn** > 0 and **HOF** > 0, the regulator activates in operating cycle mode irrespective of the values read by the probes (cold room probe failure) and of requests from other loads (**Duty Cycle** mode).

If the cold room probe is working properly, the Duty Cycle mode does **NOT** activate as it does not have priority over normal regulator settings.

The following diagram shows the **Duty Cycle** operating mode based on parameters **HOn** and **HOF** > 0:

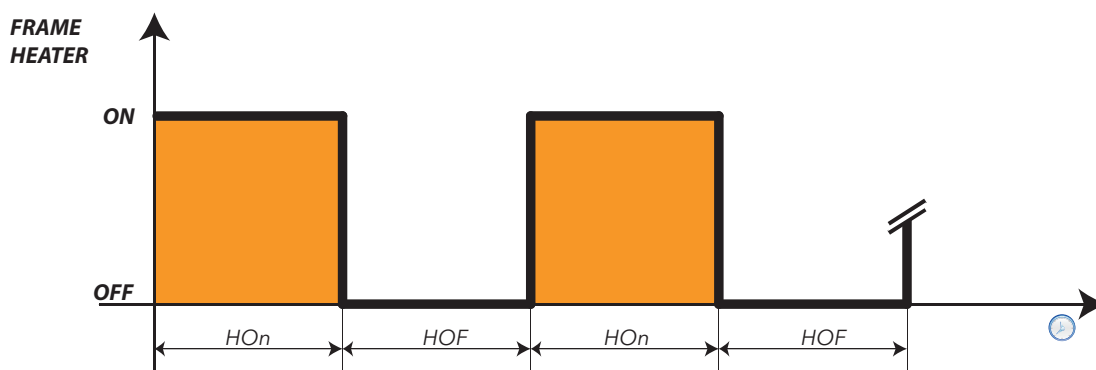

#### User parameters

The parameters that manage the frame heater regulator are:

| Label | Description   |
|-------|---|
| HOn   | Frame Heater regulator output ON time.  |
| HOF   | Frame Heater regulator output OFF time.   |
| dt3   | Frame Heater regulator time standard unit of measurement: 0=hours; 1=minutes; 2=seconds |




## 6.14. CONDENSER FANS

This regulator is associated with probe Pb3 (see specific section) and features:

- SCF activation setpoint
- dCF operating differential
- dCd exclusion of fans during defrost
- tCF activation delay after end of defrost

If a digital output is set as condenser fans (H21...H25=12), this output will behave as follows:

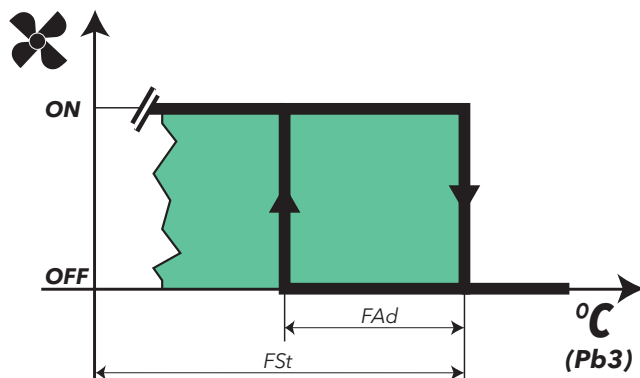

If probe Pb3 is not present and if alarm E3 is active, the regulator will always be active except during the defrost cycle.

Probe 3 can be excluded and, in this case, its lack of connection to the instrument will not cause any error signalling to occur.

NOTE: During the dripping time the output is OFF.

NOTE: If a digital output is programmed as "condenser fans" (H21...H25=12), parameter SA3 is always an absolute value, regardless of the value assumed by the parameter Att.

### User parameters

The parameters that manage the condenser fan regulator are:

| Label | Description                                  |
|-------|--|
| SCF   | Condenser fans activation Setpoint           |
| dCF   | Condenser fans activation differential       |
| tCF   | Condenser fans switch-on delay after defrost |
| dCd   | Exclusion of condenser fans during defrost   |
| dt    | Dripping time.                               |



## 6.15. STAND-BY

### Operating conditions

The stand-by regulator can be activated by digital input (if configured) or by key (if programmed).

**With the device OFF the display shows "OFF" and all regulators are blocked including alarms.**

When the device is switched on via a key or an appropriately configured digital input, regular operation commences, the same as from power-on. After power-on, the temperature alarm is excluded for a time set in parameter **PAO**, and the delay set by parameter **OdO** is activated.

Each time that the device is switched off, all cycle times are reset.

The on/off status is saved in non-volatile memory hence when power returns after a blackout, the device will restart in the status that was active prior to the blackout.

The output from stand-by is linked to the delay set in parameter **OdO**.



**NOTE:** With the controller off, all relays are de-energized except for Aux: button/aux input-light-door switch are active.

### User parameters

The parameters that manage the stand-by regulator are:

| Label | Description  |
|-------|--|
| PAO   | Alarm disabling after power-on                               |
| OdO   | Output activation delay from power-on                        |
| OAO   | High/low temperature alarm exclusion time after door closing |

## 6.16. PUMP DOWN

In some applications, Coldface manages the fluid solenoid valve, located in the cold room, while the refrigeration output is generated by a condenser unit, where the compressor is switched on/off directly by a minimum pressure switch on the unit itself. Pump-down mode can be used to manage the compressor directly by connecting the minimum pressure switch to the Coldface, which means it can also be used for diagnostics.

The purpose of this regulator is to allow compressor activation (pump-down compressor output) exclusively on the basis of minimum pressure switch regulation and regardless of the status of the main temperature controller, which will be used to activate/deactivate solenoid valves (compressor output) instead.

### 6.16.1. SERVICE STOPPAGE

Service stoppage switches the cold room OFF, and this status is indicated on the display. It also allows compressor activation every time the pressure on the suction line rises until the minimum pressure switch starts running (pump-down).

## 7. PARAMETERS



### 7.1. HOW TO MODIFY THE USER PARAMETERS

**The 'User' parameters are the most useful parameters and are described in this document, in the section Parameters Table.**

- 1) Press and hold the SET key for 3 seconds until the display shows USr
- 2) Press and release the SET key once more. The upper display will show the first parameter, the lower display will indicate the current parameter value
- 3) Using the UP & DOWN keys, find the parameter that you wish to modify
- 4) Press and release the SET key once more. The upper display will show the name of the blinking parameter
- 5) Use the UP & DOWN keys to adjust the parameter value
- 6) Press and release SET to save the parameter value
- 7) Return to step 3) or press ESC several times to return to the normal display

**THE INSTRUMENT IS USED TO EDIT OTHER PARAMETERS PRESENT IN THE INSTALLER LEVEL (inS)**

### 7.2. HOW TO EDIT THE INSTALLER LEVEL PARAMETERS

- 1) Press and hold the SET key for 3 seconds until the display shows **USr**
  - 2) Use UP & DOWN to select the parameter section **inS**
  - 3) Press and release the SET key once more. The display will show the first folder
  - 4) Press and release the SET key once more. The upper display will show the first parameter in the folder, the lower display will indicate the current parameter value
  - 5) Using the UP & DOWN keys, find the parameter that you wish to modify
- The procedure proceeds in a similar manner to that described for the User parameters (points 4-7)



## 7.3. PARAMETER TABLE

| PAR.                    | LEV.       | DESCRIPTION   | U.M.                | RANGE             | DEFAULT |
|-------------------------|------------|---|---------------------|-------------------|---------|
| <b>SEt</b>              | USr/inS    | Temperature control SEtpoint  | °C/°F               | -58.0...302       | 0.0     |
| <b>COMPRESSOR (CPr)</b> |            |   |                     |                   |         |
| <b>diF</b>              | USr/inS    | Activation differential<br><b>N.B.: diF cannot be equal to 0.</b>   | °C/°F               | 0 ... 30.0        | 2.0     |
| <b>HSE</b>              | USr/inS    | Maximum value that can be assigned to the setpoint.<br><b>NOTE: The two setpoints are interdependent: HSE cannot be less than LSE and vice-versa.</b>   | °C/°F               | LSE ... HdL       | 50.0    |
| <b>LSE</b>              | USr/inS    | Minimum value that can be assigned to the setpoint.<br><b>NOTE: The two setpoints are interdependent: LSE cannot be greater than HSE and vice-versa.</b>  | °C/°F               | LdL ... HSE       | -50.0   |
| <b>OSP</b>              | USr/inS    | Temperature value to be added algebraically to the setpoint if reduced set enabled (Economy function). Enabling can take place via key, function or digital input configured specifically for this purpose.   | °C/°F               | -30.0 ... 30.0    | 0.0     |
| <b>Cit</b>              | USr/inS    | Minimum activation time of compressor before possible deactivation.<br>If <b>Cit = 0</b> not active.  | min                 | 0 ... 255         | 0       |
| <b>CAt</b>              | USr/inS    | Maximum activation time of compressor before possible deactivation.<br>If <b>CAt = 0</b> not active.  | min                 | 0 ... 255         | 0       |
| <b>Ont</b>              | USr/inS    | Controller switch-on time in the event of faulty probe.<br>- if <b>Ont = 1</b> and <b>OFt = 0</b> , compressor stays on permanently (ON).<br>- if <b>Ont &gt; 0</b> and <b>OFt &gt; 0</b> , compressor operates in Duty Cycle mode.   | min                 | 0 ... 255         | 10      |
| <b>OFt</b>              | USr/inS    | Controller switch-off time in the event of faulty probe.<br>- if <b>OFt = 1</b> and <b>Ont = 0</b> , compressor will always stay off (OFF).<br>- if <b>Ont &gt; 0</b> and <b>OFt &gt; 0</b> , compressor operates in Duty Cycle mode.   | min                 | 0 ... 255         | 10      |
| <b>dOn</b>              | USr/inS    | Delayed start. The parameter indicates that a protection is active on the general compressor relay actuations. At least the indicated time must elapse between the request and the actual activation of the compressor relay.   | sec                 | 0 ... 255         | 2       |
| <b>dOF</b>              | USr/inS    | Delay time after power-off: the delay time indicated must elapse between deactivation of the compressor relay and the next power-on.  | min                 | 0 ... 255         | 0       |
| <b>dbi</b>              | USr/inS    | Delay between switch-ons; the delay time indicated must elapse between two consecutive compressor power-ons.  | min                 | 0 ... 255         | 2       |
| <b>OdO</b>              | USr/inS    | Output activation delay after the instrument is switched on or after a power failure.<br><b>0 = not active</b>  | min                 | 0 ... 255         | 0       |
| <b>dSC</b>              | <b>inS</b> | Compressor 2 activation delay.<br>Indicates the time after which the relay configured as compressor 2 will be activated in relation to the first compressor. If compressor 1 is disabled during this time, the call for compressor 2 will be cancelled.   | sec                 | 0 ... 255         | 0       |
| <b>dCS</b>              | <b>inS</b> | <b>DEEP COOLING CYCLE</b><br>Deep cooling cycle setpoint.   | °C/°F               | -302.0 ... 1472.0 | 0       |
| <b>tdc</b>              | <b>inS</b> | Deep cooling cycle duration.  | min                 | 0 ... 600         | 10      |
| <b>dcc</b>              | <b>inS</b> | Defrost delay after deep cooling cycle.   | min                 | 0 ... 255         | 0       |
| <b>DEFROST (dEF)</b>    |            |   |                     |                   |         |
| <b>dtY</b>              | USr/inS    | Defrost mode<br>0 = electric defrost (defrost cycle OFF), or compressor not running during defrost.<br>NOTE: electrical defrost + air defrost, in the case of fans connected in parallel to the defrost output relay.<br>1 = cycle inversion defrost (hot gas, or compressor on during defrost)<br>2 = "free" mode defrost (independent of compressor). | num                 | 0 ... 2           | 0       |
| <b>dit</b>              | USr/inS    | Interval between defrost cycles.<br>Interval between the start of two consecutive defrost cycles.<br>0 = function disabled (defrost NEVER performed).   | hours/mins/<br>secs | 0 ... 255         | 6 hours |
| <b>dt1</b>              | <b>inS</b> | Unit of measurement for defrost interval (parameter dit).<br>0 = parameter dit in hours.<br>1 = parameter dit in minutes.<br>2 = parameter dit in seconds.  | num                 | 0 ... 2           | 0       |
| <b>dt2</b>              | <b>inS</b> | Unit of measurement for duration of defrost (parameter dEt/dE2).<br>0 = parameter dEt/dE2 in hours.<br>1 = parameter dEt/dE2 in minutes.<br>2 = parameter dEt/dE2 in seconds.   | num                 | 0 ... 2           | 1       |



| PAR.  | LEV.    | DESCRIPTION  | U.M.              | RANGE   | DEFAULT   |          |   |
|---|---------|--|-------------------|---|---|----------|---|
| <b>dCt</b>  | USr/inS | Defrost interval count mode.<br>0 = compressor running time (DIGIFROST® method); defrost active ONLY when compressor is on.<br>NOTE: compressor running time is counted separately from the evaporator probe (count active also when evaporator probe missing or faulty).<br>1 = appliance running time; defrost counting is always active when the machine is on and starts at each power-on.<br>2 = compressor stop. Every time the compressor stops, a defrost cycle is performed according to parameter dtY.<br>3 = RTC. Defrost at specific times set by parameters dE1...dE8, F1...F8.   | num               | 0 ... 3   | 1   |          |   |
| <b>dOH</b>  | USr/inS | Defrost cycle activation delay from request.<br>Delay preceding start of first defrost after call.   | min               | 0 ... 59  | 0   |          |   |
| <b>dEt</b>  | USr/inS | Defrost timeout.<br>Determines the maximum defrost time on Evaporator 1.   | hours/mins/secs   | 1 ... 255   | 30  |          |   |
| <b>dSt</b>  | USr/inS | Defrost end temperature.<br>Defrost 1 end temperature (determined by evaporator probe 1).  | °C/°F             | -302.0 ... 1472.0                                     | 6.0   |          |   |
| <b>dS2</b>  | inS     | Evaporator 2 defrost end temperature.<br>Determines the maximum defrost time on Evaporator 2.  | °C/°F             | -302.0 ... 1472.0                                     | 8.0   |          |   |
| <b>dE2</b>  | inS     | Evaporator 2 maximum defrost duration.<br>Determines the maximum defrost time on Evaporator 2.   | hours/mins/secs   | 1 ... 255   | 30  |          |   |
| <b>dPO</b>  | USr/inS | Defrost enabling request from power-on.<br>Determines whether or not the instrument must defrost at power-up (provided that the temperature measured at the evaporator will allow defrost).<br><b>n</b> = no, does not start defrosting at power-on; <b>y</b> = yes, starts defrost at power-on.   | flag              | n/y   | n   |          |   |
| <b>tcd</b>  | inS     | Compressor output activation/deactivation time before a defrost.<br>Minimum time that must elapse with the compressor ON or OFF before defrost is activated.   | min               | -31 ... 31  | 0   |          |   |
| <b>Cod</b>  | inS     | Time preceding a defrost, during which the compressor output is not activated.   | min               | 0 ... 60  | 0   |          |   |
| <b>Parameters dE1...dE8 / F1...F8 - ONLY VISIBLE IN HACCP MODELS</b><br><b>Important: do not confuse parameters dE1...dE8 with values d0 ...d7 in folder nAd, used for the Day/Night regulator.</b> |         |  |                   |   |   |          |   |
| <b>dE1...dE8<br/>F1...F8</b>  |         | Parameters for setting the time of single defrosts.<br><ul style="list-style-type: none"> <li>• daily (dE1...dE8)</li> <li>• daily "weekends/public holidays" (F1..F8), used by the Day/Night regulator.</li> </ul> The parameters will only be displayed if: <ul style="list-style-type: none"> <li>• dit = <b>0</b></li> <li>• dCt = <b>3</b> (Real time clock)</li> <li>• H48 = <b>y</b> (rtc option declared present)</li> <li>• the device has been switched off and on again after the above parameters have been set.</li> </ul>  |                   |   |   |          |   |
| <b>dE1...dE8</b>  |         | Setting the time for defrosts on weekdays<br>If parameter dit (defrosting interval) = 0, dCt = 3 and the rtc option is (declared) present, then parameters dE1...dE8 allow you to set the hours and minutes.<br>Only on the basis of these values will a defrost cycle begin.<br>If you do not wish to use some of the defrost times (dE1...dE8), exclude them as explained below:<br>Select the parameter (dE1...dE8) that you want to exclude, then increase the value until 24 appears on the display, indicating that the parameter has been excluded.<br>Bear in mind that the times do not have to be set in exact chronological order, e.g.<br>dE1 = h 12.25<br>dE2 = h 06.05<br>dE3 = h 18.30<br>...         | hours and minutes |   | The parameter is then split into<br>dEn_H (hours),<br>dEn_m (minutes),<br>n=1...8 |          |   |
| <b>F1...F8</b>  |         | Setting the time for defrosts on weekends/public holidays<br>If parameter dit (defrosting interval) is dit = 0, dCt = 3 and the RTC option is declared present, then parameters F1...F8 allow you to set the hours and minutes. Only on the basis of these values will a defrost cycle begin.<br>If you do not wish to use some of the defrost times (F1...F8), exclude them as explained below:<br>Select the parameter (F1...F8) that you want to exclude, then increase the value until 59 appears on the display, indicating that the parameter has been excluded.<br>Bear in mind that the times do not have to be set in exact chronological order, e.g.<br>• F1 = h 12.25<br>• F2 = h 06.05<br>• F3 = h 18.30 | hours and minutes |   | The parameter is then split into<br>Fn_H (hours),<br>Fn_m (minutes),<br>n=1...8   |          |   |
| <b>dE1H</b>   | USr/inS | Start time weekday defrost 1.  |                   | <b>0 ... 23</b> = start hour; <b>24</b> = disabled.   | hours   | 0 ... 24 | 0 |
| <b>dE1m</b>   | USr/inS | Start time minutes weekday defrost 1.  |                   |   | min   | 0 ... 59 | 0 |
| <b>dE2H</b>   | USr/inS | Start time weekday defrost 2.  |                   | <b>d1H ... 23</b> = start hour; <b>24</b> = disabled. | hours   | 0 ... 24 | 0 |



| PAR.              | LEV.                  | DESCRIPTION  | U.M.  | RANGE         | DEFAULT        |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
|-------------------|-----------------------|--|---|---------------|----------------|-------|---|-----------------------|-----|---|---|-----------------------|-----------------------|---|---|-----------------------|-----------------------|---|---|-----------------------|------------|---|---|-----------------------|------------|---|-----|---------|---|
| dE2m              | USr/inS               | Start time minutes weekday defrost 2.  | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dE3H              | USr/inS               | Start time weekday defrost 3. <b>d2H ... 23</b> = start hour; <b>24</b> = disabled.  | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dE3m              | USr/inS               | Start time minutes weekday defrost 3.  | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dE4H              | USr/inS               | Start time weekday defrost 4. <b>d3H ... 23</b> = start hour; <b>24</b> = disabled.  | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dE4m              | USr/inS               | Start time minutes weekday defrost 4.  | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dE5H              | USr/inS               | Start time weekday defrost 5. <b>d4H ... 23</b> = start hour; <b>24</b> = disabled.  | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dE5m              | USr/inS               | Start time minutes weekday defrost 5.  | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dE6H              | USr/inS               | Start time weekday defrost 6. <b>d5H ... 23</b> = start hour; <b>24</b> = disabled.  | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dE6m              | USr/inS               | Start time minutes weekday defrost 6.  | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dE7H              | USr/inS               | Start time weekday defrost 7. <b>d4H ... 23</b> = start hour; <b>24</b> = disabled.  | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dE7m              | USr/inS               | Start time minutes weekday defrost 7.  | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dE8H              | USr/inS               | Start time weekday defrost 8. <b>d5H ... 23</b> = start hour; <b>24</b> = disabled.  | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dE8m              | USr/inS               | Start time minutes weekday defrost 8.  | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F1H               | USr/inS               | Start time weekend/public holiday defrost 1. <b>0 ... 23</b> = start hour; <b>24</b> = disabled.   | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F1m               | USr/inS               | Start time minutes weekend/public holiday defrost 1.   | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F2H               | USr/inS               | Start time weekend/public holiday defrost 2. <b>F1H ... 23</b> = start hour; <b>24</b> = disabled.   | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F2m               | USr/inS               | Start time minutes weekend/public holiday defrost 2.   | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F3H               | USr/inS               | Start time weekend/public holiday defrost 3. <b>F2H ... 23</b> = start hour; <b>24</b> = disabled.   | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F3m               | USr/inS               | Start time minutes weekend/public holiday defrost 3.   | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F4H               | USr/inS               | Start time weekend/public holiday defrost 4. <b>F3H ... 23</b> = start hour; <b>24</b> = disabled.   | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F4m               | USr/inS               | Start time minutes weekend/public holiday defrost 4.   | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F5H               | USr/inS               | Start time weekend/public holiday defrost 5. <b>F4H ... 23</b> = start hour; <b>24</b> = disabled.   | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F5m               | USr/inS               | Start time minutes weekend/public holiday defrost 5.   | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F6H               | USr/inS               | Start time weekend/public holiday defrost 6. <b>F5H ... 23</b> = start hour; <b>24</b> = disabled.   | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F6m               | USr/inS               | Start time minutes weekend/public holiday defrost 6.   | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F7H               | USr/inS               | Start time weekend/public holiday defrost 7. <b>F5H ... 23</b> = start hour; <b>24</b> = disabled.   | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F7m               | USr/inS               | Start time minutes weekend/public holiday defrost 7.   | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F8H               | USr/inS               | Start time weekend/public holiday defrost 8. <b>F5H ... 23</b> = start hour; <b>24</b> = disabled.   | hours   | 0 ... 24      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| F8m               | USr/inS               | Start time minutes weekend/public holiday defrost 8.   | min   | 0 ... 59      | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| <b>FANS (FAn)</b> |                       |  |   |               |                |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| FPt               | inS                   | FSt parameter management mode.<br>(0) = absolute value; (1) = relative value.  | flag  | 0/1           | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| FSt               | USr/inS               | Fans lockout temperature; if the value read is greater than FSt, the fans will be stopped.<br>The value can positive or negative.  | °C/°F   | -58.0...302   | 6.0            |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| Fot               | inS                   | Fans start temperature.<br>If the temperature read by the evaporator probe is lower than the set value, the fans remain off.   | °C/°F   | -58.0...302   | -50.0          |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| FAd               | USr/inS               | Fans activation differential.  | °C/°F   | 0.1 ... 25.0  | 1.0            |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| Fdt               | USr/inS               | Fans activation delay after a defrost cycle.   | min   | 0 ... 255     | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dt                | USr/inS               | Dripping time. Dripping time.  | min   | 0 ... 255     | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| dFd               | USr/inS               | Operating mode of evaporator fans during defrost.<br><b>n</b> (0) = Fans Off; <b>y</b> (1) = Fans On.  | flag  | n/y           | y              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| Fco               | USr/inS               | Evaporator fans operating mode. The status of the fans will be:<br><table border="1" data-bbox="363 1550 1062 1917"> <thead> <tr> <th>FCO</th> <th>COMPRESSOR ON</th> <th>COMPRESSOR OFF</th> <th>Notes</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>Thermostat controlled</td> <td>OFF</td> <td>-</td> </tr> <tr> <td>1</td> <td>Thermostat controlled</td> <td>Thermostat controlled</td> <td>-</td> </tr> <tr> <td>2</td> <td>Thermostat controlled</td> <td>Thermostat controlled</td> <td>-</td> </tr> <tr> <td>3</td> <td>Thermostat controlled</td> <td>Duty cycle</td> <td>controlled via parameters <b>FOn</b> and <b>FOF</b></td> </tr> <tr> <td>4</td> <td>Thermostat controlled</td> <td>Duty cycle</td> <td>controlled via parameters <b>FOn</b> and <b>FOF</b></td> </tr> </tbody> </table> | FCO   | COMPRESSOR ON | COMPRESSOR OFF | Notes | 0 | Thermostat controlled | OFF | - | 1 | Thermostat controlled | Thermostat controlled | - | 2 | Thermostat controlled | Thermostat controlled | - | 3 | Thermostat controlled | Duty cycle | controlled via parameters <b>FOn</b> and <b>FOF</b> | 4 | Thermostat controlled | Duty cycle | controlled via parameters <b>FOn</b> and <b>FOF</b> | num | 0 ... 4 | 1 |
| FCO               | COMPRESSOR ON         | COMPRESSOR OFF   | Notes   |               |                |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| 0                 | Thermostat controlled | OFF  | -   |               |                |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| 1                 | Thermostat controlled | Thermostat controlled  | -   |               |                |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| 2                 | Thermostat controlled | Thermostat controlled  | -   |               |                |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| 3                 | Thermostat controlled | Duty cycle   | controlled via parameters <b>FOn</b> and <b>FOF</b> |               |                |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| 4                 | Thermostat controlled | Duty cycle   | controlled via parameters <b>FOn</b> and <b>FOF</b> |               |                |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| FdC               | inS                   | Evaporator fans switch-off delay after compressor deactivation.  | min   | 0 ... 255     | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| FOn               | inS                   | Time fans remain ON during daytime duty cycle. Fans used in duty cycle mode; applies to <b>FCO = 3,4 (duty cycle)</b> .  | min   | 0 ... 255     | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |
| FOF               | inS                   | Time fans remain OFF during daytime duty cycle. Fans used in duty cycle mode; applies to <b>FCO = dc</b> .   | min   | 0 ... 255     | 0              |       |   |                       |     |   |   |                       |                       |   |   |                       |                       |   |   |                       |            |   |   |                       |            |   |     |         |   |



| PAR.                                     | LEV.           | DESCRIPTION   | U.M.  | RANGE             | DEFAULT |
|--|----------------|---|-------|-------------------|---------|
| <b>SCF</b>                               | <b>inS</b>     | <b>Condenser Fans</b><br>Condenser fans activation Setpoint   | °C/°F | -50.0...150.0     | 10.0    |
| <b>dCF</b>                               | <b>inS</b>     | Condenser fans activation differential  | °C/°F | -30.0...30.0      | 2.0     |
| <b>tCF</b>                               | <b>inS</b>     | Condenser fans switch-on delay after defrost  | min   | 0...59            | 0       |
| <b>dCd</b>                               | <b>inS</b>     | Exclusion of condenser fans during defrost.<br>n (0) = fans running during defrost; y (1) = fans excluded.  | flag  | n/y               | n       |
| <b>ALARMS (ALr)</b>                      |                |   |       |                   |         |
| <b>Att</b>                               | <b>inS</b>     | Parameters <b>HAL</b> and <b>LAL</b> mode intended as the absolute temperature value or differential in relation to the Setpoint.<br>(0) = absolute value<br>(1) = relative value<br><b>NOTE: In case of relative values (par. Att=1), the HAL parameter should be set to positive values, while the LAL parameter should be set to negative values (-LAL).</b> | flag  | 0/1               | 0       |
| <b>AFd</b>                               | <b>USr/inS</b> | Alarms cut-in differential.   | °C/°F | 0.1 ... 25.0      | 1.0     |
| <b>HAL</b>                               | <b>USr/inS</b> | Probe 1 maximum alarm. Temperature value (intended either as distance from setpoint or as an absolute value based on <b>Att</b> ) above which the probe will trigger activation of the alarm signal.  | °C/°F | LA1...302         | 50.0    |
| <b>LAL</b>                               | <b>USr/inS</b> | Probe 1 minimum alarm Temperature value (intended as distance from setpoint or as an absolute value based on <b>Att</b> ) beneath which the probe will trigger activation of the alarm signal.  | °C/°F | -58.0...HA1       | -50.0   |
| <b>PAO</b>                               | <b>USr/inS</b> | Alarm exclusion time after device is switched on following a power failure.<br><b>This parameter refers to high/low temperature alarms LAL and HAL only.</b>  | hours | 0 ... 10          | 3       |
| <b>dAO</b>                               | <b>USr/inS</b> | Temperature alarm exclusion time after defrost.   | min   | 0 ... 255         | 60      |
| <b>OAO</b>                               | <b>USr/inS</b> | Alarm indication delay (high and low temperature) following deactivation of digital input (port closed).  | hours | 0 ... 10          | 1       |
| <b>tdO</b>                               | <b>USr/inS</b> | Door open alarm activation delay.   | min   | 0 ... 255         | 10      |
| <b>tAO</b>                               | <b>USr/inS</b> | Delay preceding temperature alarm signal.<br><b>This parameter refers to high/low temperature alarms LAL and HAL only.</b>  | min   | 0 ... 255         | 0       |
| <b>dAt</b>                               | <b>inS</b>     | Alarm indicating end of defrost as a result of timeout.<br>n (0) = the alarm is not triggered.<br>y (1) = triggers the alarm.   | flag  | n/y               | n       |
| <b>rLO</b>                               | <b>inS</b>     | Regulators inhibited by external alarm.<br>0 = does not inhibit any resource.<br>1 = compressor and defrost blocked.<br>2 = compressor, defrost and fans blocked.   | num   | 0/1/2             | 0       |
| <b>AOP</b>                               | <b>inS</b>     | Alarm output polarity:<br>0 = alarm active and output disabled.<br>1 = alarm active and output enabled.   | flag  | 0 ... 1           | 1       |
| <b>PbA</b>                               | <b>inS</b>     | Configuration of temperature alarm on probe 1 and/or 3:<br>0 = on probe 1 (cold room).<br>1 = on probe 3 (display).<br>2 = on probes 1 and 3 (cold room and display).<br>3 = on probes 1 and 3 (cold room and display) with external threshold.   | num   | 0 ... 3           | 0       |
| <b>SA3</b>                               | <b>inS</b>     | Probe 3 alarm setpoint.   | °C/°F | -302.0 ... 1472.0 | 0.0     |
| <b>dA3</b>                               | <b>inS</b>     | Probe 3 alarm differential.   | °C/°F | -300 ... 300      | 2.0     |
| <b>tA3</b>                               | <b>inS</b>     | Delay time for alarm signal on probe 3.   | min   | 0 ... 59          | 0       |
| <b>ArE</b>                               | <b>inS</b>     | Enables alarm relay in the event of probe 3-related alarms:<br>0 = does not enable alarms in the event of alarms/errors on probe 3.<br>1 = enables the alarm relay in the event of alarms/errors on all probes.<br>2 = enables the alarm relay ONLY in the event of alarms/errors on probe 3.   | num   | 0 ... 2           | 0       |
| <b>LIGHTS &amp; DIGITAL INPUTS (Lit)</b> |                |   |       |                   |         |
| <b>dSd</b>                               | <b>inS</b>     | Light relay / door switch interlock.<br>n (0) = door opening does not switch on the light.<br>y (1) = door opening switches on the light (if it was off).   | flag  | n/y               | y       |
| <b>dLt</b>                               | <b>inS</b>     | Delay preceding deactivation (switch-off) of light relay (interior light). The interior light remains on for dLt minutes when the door is closed if parameter <b>dSd</b> is set to 'yes'.   | min   | 0 ... 31          | 0       |
| <b>OFL</b>                               | <b>inS</b>     | Light relay always deactivated by light key. Allows the interior light to be switched off by pressing the key, even if the delay parameter <b>dLt</b> is set to 'yes'.<br>n (0) = no.<br>y (1) = yes.   | flag  | n/y               | y       |
| <b>dOd</b>                               | <b>inS</b>     | Enable switch-off of loads on activation of door switch.<br>0 = disabled.<br>1 = disable fans.<br>2 = disable compressor.<br>3 = disable fans and compressor.   | num   | 0 ... 3           | 1       |





| PAR.       | LEV.       | DESCRIPTION   | U.M. | RANGE     | DEFAULT |
|------------|------------|---|------|-----------|---------|
| <b>dAd</b> | <b>inS</b> | Activation delay for digital inputs DI1, DI2.   | min  | 0 ... 255 | 0       |
| <b>dOA</b> | <b>inS</b> | Action forced from digital input (if <b>PEA</b> ≠ <b>0</b> ):<br><b>0</b> = activate compressor.<br><b>1</b> = activate fans.<br><b>2</b> = activate compressor and fans.<br><b>3</b> = deactivate compressor.<br><b>4</b> = deactivate fans.<br><b>5</b> = deactivate compressor and fans. | num  | 0 ... 5   | 0       |
| <b>PEA</b> | <b>inS</b> | Selection of digital input configured to inhibit/enable resources.<br><b>0</b> = function disabled.<br><b>1</b> = associated with door switch.<br><b>2</b> = associated with external alarm.<br><b>3</b> = associated with external alarm and door switch.                                  | num  | 0 ... 3   | 0       |
| <b>dCO</b> | <b>inS</b> | Compressor activation/deactivation delay when enabled.  | min  | 0 ... 255 | 0       |
| <b>dOC</b> | <b>inS</b> | Compressor switch-off delay from acknowledgement.   | min  | 0 ... 255 | 0       |
| <b>dFO</b> | <b>inS</b> | Fan activation/deactivation delay when enabled.   | min  | 0 ... 255 | 0       |
| <b>PEn</b> | <b>inS</b> | Number of errors allowed per pressure switch input. <b>0</b> = disabled.  | num  | 0 ... 15  | 15      |
| <b>PEi</b> | <b>inS</b> | Pressure switch error count interval.   | min  | 1 ... 99  | 99      |

**NIGHT AND DAY (nAd)  
FOLDER ONLY VISIBLE IN HACCP MODELS**

If the Night & Day regulator is enabled (via key or D.I.), both weekday and weekend defrost management is active (see parameters dE1...dE8, F1...F8): parameter E3 can be used for every day to establish which defrosts to activate.

If the Night & Day regulator has not been enabled, only weekday defrosts dE1...dE8 will be run.

Folder consisting of 7 sub-folders: d0, d1, d2, d3, d4, d5, d6 and d7\*, each of which contain the following parameters.

NOTE: it is advisable to consider the first day d0 as SUNDAY. 'd7' can be used to program daily events which are valid for all days.

|                  |            |   |       |          |   |
|------------------|------------|---|-------|----------|---|
| <b>E0</b>        |            | Functions enabled during events.<br><b>0</b> = events management disabled.<br><b>1</b> = enable reduced setpoint.<br><b>2</b> = enable reduced set+light.<br><b>3</b> = enable reduced set+light+aux.<br><b>4</b> = enable stand-by.<br><b>5</b> = enable reduced setpoint*.<br><b>6</b> = enable reduced set+light*.<br><b>7</b> = enable reduced set+light+aux*.<br><b>8</b> = enable stand-by*.<br>* disables the buzzer; the alarms and alarm relay continue to run as per the programming. |       |          |   |
| <b>E1</b>        |            | Start of event hours/minutes. Sets event start time based on the value of E0.<br>The "NIGHT" mode begins at this time.<br>The duration is determined by parameter E2.<br>In hours and minutes (in the parameter table, the parameter is split into E1_h (hours), E1_min (minutes)).   |       |          |   |
| <b>E2</b>        |            | Duration of event. Sets the duration of the event starting as programmed in E1, based on the value of E0.<br>In hours.  |       |          |   |
| <b>E3</b>        |            | Enable defrost weekdays or weekends:<br><b>0</b> = "weekdays" defrost sequence defined by parameters dE1...dE8.<br><b>1</b> = "weekends/public holidays" defrost sequence defined by parameters F1...F8.<br>NOTE: This regulator can be enabled by key (see para. H32...H37=11) or by Digital Input (see para. H11...H12=16).<br>Note: for the daily event 'd7', this parameter is ignored (it is not possible to manage defrosts).   |       |          |   |
| <b>d0_E0</b>     | <b>inS</b> | Enable functions during events day 1 (SUNDAY)   | num   | 0 ... 8  | 0 |
| <b>d0_E1_h</b>   | <b>inS</b> | Event start time (hours) day 1.   | hours | 0 ... 23 | 0 |
| <b>d0_E1_min</b> | <b>inS</b> | Event start time (minutes) day 1.   | min   | 0 ... 59 | 0 |
| <b>d0_E2</b>     | <b>inS</b> | Event duration day 1.   | hours | 0 ... 72 | 0 |
| <b>d0_E3</b>     | <b>inS</b> | Enable defrost weekdays or weekends day 1.  | flag  | 0 ... 1  | 0 |
| <b>d1_E0</b>     | <b>inS</b> | Enable functions during events day 2.   | num   | 0 ... 8  | 0 |
| <b>d1_E1_h</b>   | <b>inS</b> | Event start time (hours) day 2.   | hours | 0 ... 23 | 0 |
| <b>d1_E1_min</b> | <b>inS</b> | Event start time (minutes) day 2  | min   | 0 ... 59 | 0 |
| <b>d1_E2</b>     | <b>inS</b> | Event duration day 2.   | hours | 0 ... 72 | 0 |
| <b>d1_E3</b>     | <b>inS</b> | Enable defrost weekdays or weekends day 2   | flag  | 0 ... 1  | 0 |
| <b>d2_E0</b>     | <b>inS</b> | Enable functions during events day 3.   | num   | 0 ... 8  | 0 |
| <b>d2_E1_h</b>   | <b>inS</b> | Event start time (hours) day 3.   | hours | 0 ... 23 | 0 |
| <b>d2_E1_min</b> | <b>inS</b> | Event start time (minutes) day 3.   | min   | 0 ... 59 | 0 |
| <b>d2_E2</b>     | <b>inS</b> | Event duration day 3.   | hours | 0 ... 72 | 0 |
| <b>d2_E3</b>     | <b>inS</b> | Enable defrost weekdays or weekends day 3.  | flag  | 0 ... 1  | 0 |
| <b>d3_E0</b>     | <b>inS</b> | Enable functions during events day 4.   | num   | 0 ... 8  | 0 |
| <b>d3_E1_h</b>   | <b>inS</b> | Event start time (hours) day 4.   | hours | 0 ... 23 | 0 |
| <b>d3_E1_min</b> | <b>inS</b> | Event start time (minutes) day 4.   | min   | 0 ... 59 | 0 |
| <b>d3_E2</b>     | <b>inS</b> | Event duration day 4.   | hours | 0 ... 72 | 0 |
| <b>d3_E3</b>     | <b>inS</b> | Enable defrost weekdays or weekends day 4.  | flag  | 0 ... 1  | 0 |



| PAR.                                  | LEV.    | DESCRIPTION  | U.M.  | RANGE            | DEFAULT |
|---------------------------------------|---------|--|-------|------------------|---------|
| d4_E0                                 | inS     | Enable functions during events day 5.  | num   | 0 ... 8          | 0       |
| d4_E1_h                               | inS     | Event start time (hours) day 5.  | hours | 0 ... 23         | 0       |
| d4_E1_min                             | inS     | Event start time (minutes) day 5.  | min   | 0 ... 59         | 0       |
| d4_E2                                 | inS     | Event duration day 5.  | hours | 0 ... 72         | 0       |
| d4_E3                                 | inS     | Enable defrost weekdays or weekends day 5.   | flag  | 0 ... 1          | 0       |
| d5_E0                                 | inS     | Enable functions during events day 6.  | num   | 0 ... 8          | 0       |
| d5_E1_h                               | inS     | Event start time (hours) day 6.  | hours | 0 ... 23         | 0       |
| d5_E1_min                             | inS     | Event start time (minutes) day 6.  | min   | 0 ... 59         | 0       |
| d5_E2                                 | inS     | Event duration day 6.  | hours | 0 ... 72         | 0       |
| d5_E3                                 | inS     | Enable defrost weekdays or weekends day 6.   | flag  | 0 ... 1          | 0       |
| d6_E0                                 | inS     | Enable functions during events day 7 (SATURDAY)  | num   | 0 ... 8          | 0       |
| d6_E1_h                               | inS     | Event start time (hours) day 7.  | hours | 0 ... 23         | 0       |
| d6_E1_min                             | inS     | Event start time (minutes) day 7.  | min   | 0 ... 59         | 0       |
| d6_E2                                 | inS     | Event duration day 7.  | hours | 0 ... 72         | 0       |
| d6_E3                                 | inS     | Enable defrost weekdays or weekends day 7.   | flag  | 0 ... 1          | 0       |
| d7_E0                                 | inS     | Enable functions during daily event (EVERY DAY)  | num   | 0 ... 8          | 0       |
| d7_E1_h                               | inS     | Daily event start time (EVERY DAY)   | hours | 0 ... 23         | 0       |
| d7_E1_min                             | inS     | Daily event start time (minutes) (EVERY DAY)   | min   | 0 ... 59         | 0       |
| d7_E2                                 | inS     | Daily event duration (EVERY DAY)   | hours | 0 ... 72         | 0       |
| d7_E3                                 | inS     | Enable daily defrost weekdays or weekends (EVERY DAY)  | flag  | 0 ... 1          | 0       |
| <b>COMMUNICATION parameters (Add)</b> |         |  |       |                  |         |
| PtS                                   | inS     | Protocol selection.<br>t (0) = Televis.<br>d (1) = ModBUS.   | flag  | t<br>d           | t       |
| dEA                                   | inS     | Device address: indicates the device address to the management protocol.   | num   | 0 ... 14         | 0       |
| FAA                                   | inS     | Family address: indicates the device family to the management protocol.  | num   | 0 ... 14         | 0       |
| Adr                                   | inS     | ModBUS protocol controller address (only if PtS=d).  | num   | 1 ... 250        | 1       |
| Pty                                   | inS     | Set the ModBUS parity bit (only if PtS = d).<br>n (0) = none.<br>E (1) = parity.<br>o (2) = disparity.   | num   | n<br>E<br>o      | n       |
| StP                                   | inS     | ModBUS stop bit: 1b=1 bit; 2b=2 bit.   | num   | 1b/2b            | 1b      |
| bAU                                   | inS     | Baudrate selection.<br>96 (0) = 9600<br>192 (1) = 19200<br>384 (2) = 38400   | num   | 96<br>192<br>384 | 96      |
| <b>DISPLAY parameters (dis)</b>       |         |  |       |                  |         |
| LOC                                   | USr/inS | LOCK. Setpoint edit lock. The parameter programming menu can still be accessed, and the settings changed, which means also that the status of this parameter can be changed so as to unlock the keypad.<br>n (0) = no.<br>y (1) = yes. | flag  | n/y              | n       |
| PA1                                   | USr/inS | PAssword 1. When enabled (PA1 ≠ 0) this password provides access to level1 parameters (User).  | num   | 0 ... 255        | 0       |
| PA2                                   | inS     | PAssword 2. When enabled (PA2 ≠ 0), this password provides access to level2 parameters (Installer).  | num   | 0 ... 255        | 15      |
| PA3                                   | inS     | PAssword 3. When enabled (PA3 ≠ 0), this is the access key used to clear HACCP alarms in the Functions menu.   | num   | 0 ... 255        | 0       |
| ndt                                   | USr/inS | Display values with decimal point.<br>n (0) = no (integers only).<br>y (1) = yes (display with decimal point).   | flag  | n/y              | y       |
| CA1                                   | USr/inS | Calibration of probe Pb1.<br>Positive or negative temperature value added to the value read by Pb1. This sum is used for both temperature display and temperature regulation purposes.   | °C/°F | -30.0...30.0     | 0.0     |
| CA2                                   | USr/inS | Calibration of probe Pb2.<br>Positive or negative temperature value added to the value read by Pb2. This sum is used for both temperature display and temperature regulation purposes.   | °C/°F | -30.0...30.0     | 0.0     |
| CA3                                   | inS     | Calibration of probe Pb3.<br>Positive or negative temperature value added to the value read by Pb3. This sum is used for both temperature display and temperature regulation purposes.   | °C/°F | -30.0...30.0     | 0.0     |



| PAR.                                       | LEV.       | DESCRIPTION   | U.M.  | RANGE         | DEFAULT |
|--|------------|---|-------|---------------|---------|
| <b>CA</b>                                  | <b>inS</b> | Offset activation on display, thermoregulation or both:<br>0 = only the temperature shown is modified.<br>1 = only the temperature used by the regulators is modified; the display remains unchanged.<br>2 = temperature displayed is modified, which is also the one used by the regulators.   | num   | 0/1/2         | 2       |
| <b>LdL</b>                                 | <b>inS</b> | Minimum value that can be displayed by the device.  | °C/°F | -58.0...HdL   | -50.0   |
| <b>HdL</b>                                 | <b>inS</b> | Maximum value that can be displayed by the device.  | °C/°F | LdL...302     | 140.0   |
| <b>ddl</b>                                 | USr/inS    | Display mode during defrost.<br><b>0</b> = displays the temperature read by probe.<br><b>1</b> = locks the reading at the temperature value read by probe when defrosting starts and until the next time the SEt is reached.<br><b>2</b> = displays label <b>def</b> during defrost and until the SEt is reached (or until <b>Ldd</b> elapses).   | num   | 0/1/2         | 1       |
| <b>Ldd</b>                                 | <b>inS</b> | Timeout value for display unlock - label <b>def</b> .   | min   | 0 ... 255     | 0       |
| <b>dro</b>                                 | <b>inS</b> | Selection of °C or °F to display the probe value. 0 = °C, 1 = °F.<br><b>NOTE: switching between °C and °F or vice-versa DOES NOT modify the setpoint, differential, etc. (e.g. setpoint = 10°C becomes 10°F).</b>   | flag  | 0/1           | 0       |
| <b>ddd</b>                                 | <b>inS</b> | Selects the type of value to show in the display.<br>0 = Setpoint.<br>1 = probe Pb1 will be used.<br>2 = probe Pb2 will be used.<br>3 = probe Pb3 will be used.   | num   | 0 ... 3       | 1       |
| <b>dd2</b>                                 | <b>inS</b> | <b>PARAMETER ONLY VISIBLE IN HACCP MODELS</b><br>Selects the type of value to show in the display.<br>0 = Setpoint.<br>1 = RTC.   | num   | 0/1           | 1       |
| <b>HACCP ALARM parameters (HAC)</b>        |            |   |       |               |         |
| <b>FOLDER ONLY VISIBLE IN HACCP MODELS</b> |            |   |       |               |         |
| <b>Shi</b>                                 | <b>inS</b> | "Instant" maximum HACCP alarm indication threshold: when the temperature value read by the temperature control probe goes beyond the range set in "SHi", an HACCP alarm is immediately triggered, with light-up of the LED/alarm relay according to parameter H50 (see specific section).   | °C/°F | SHH ... 150.0 | 35.0    |
| <b>SLi</b>                                 | <b>inS</b> | The differential when returning from the alarm condition is fixed at 0.1°C.<br>"Instant" minimum HACCP alarm indication threshold: when the temperature value read by the temperature control probe goes beyond the range set in "SLi", an HACCP alarm is immediately triggered, with light-up of the LED/alarm relay according to parameter H50 (see specific section).<br>The differential when returning from the alarm condition is fixed at 0.1°C. | °C/°F | -50.0 ... SLH | -35.0   |
| <b>SHH</b>                                 | <b>inS</b> | Maximum HACCP alarm indication threshold: when the temperature value displayed by the temperature control probe is outside the range set by the value of "SHH" for longer than the time set in parameter "drA", an HACCP alarm is triggered, with light-up of the LED/(alarm relay) according to parameter H50 (see specific section).<br>The differential when returning from the alarm condition is fixed at 0.1°C.                                   | °C/°F | SLH ... 150.0 | 30.0    |
| <b>SLH</b>                                 | <b>inS</b> | Minimum HACCP alarm indication threshold: when the temperature value read by the temperature control probe is outside the range set by the value "SLH" for longer than the time set in parameter "drA", an HACCP alarm is triggered, with light-up of the LED/(alarm relay) according to parameter H50 (see specific section).<br>The differential when returning from the alarm condition is fixed at 0.1°C.   | °C/°F | -50.0 ... SHH | -30.0   |
| <b>drA</b>                                 | <b>inS</b> | Minimum dwelling time in critical area for the event to be recorded: one this time has elapsed it is saved and an HACCP alarm generated.  | min   | 0 ... 99      | 10      |
| <b>drH</b>                                 | <b>inS</b> | HACCP alarm reset time from last reset: this is the time that must pass once the instrument has been switched on before any recorded alarms are cleared automatically.<br>If the parameter is set to 0, automatic reset is inhibited and only manual reset is enabled.  | hours | 0 ... 255     | 0       |
| <b>H50</b>                                 | <b>inS</b> | Enable HACCP alarms storage with or without alarm relay enabling:<br><b>IMPORTANT! SWITCH THE INSTRUMENT OFF AND ON AGAIN AFTER MODIFYING PARAMETER H50.</b><br>• 0 = HACCP alarms disabled.<br>• 1 = HACCP alarms enabled and alarm relay NOT enabled.<br>• 2 = HACCP alarms enabled and alarm relay enabled.  | num   | 0 ... 2       | 0       |
| <b>H51</b>                                 | <b>inS</b> | HACCP alarms storage disabling time (key or digital input).<br>In minutes.  | min   | 0 ... 255     | 0       |
| <b>H52</b>                                 | <b>inS</b> | Probe enabled to signal HACCP alarms:<br>1 = probe 1; 3 = probe 3.  | flag  | 1/3           | 1       |



| PAR.   | LEV.   | DESCRIPTION  | U.M.   | RANGE  | DEFAULT |             |   |
|--|--|--|--|--|---------|-------------|---|
| <b>CONFIGURATION (CnF)</b>   |  |  |  |  |         |             |   |
| If one or more parameters present in the folder are changed, the controller <b>MUST</b> be switched off and switched on again.   |  |  |  |  |         |             |   |
| <b>H00</b>   | Usr/inS  | Selection of type of probe used (Pb1 ... Pb3).<br>(0) = PTC.<br>(1) = NTC.   | num  | 0/1  | 1       |             |   |
| <b>H01</b>   | inS  | Enable deep cooling function.<br>n (0) = not enabled; y (1) = enabled.   | flag   | n/y  | n       |             |   |
| <b>H02</b>   | inS  | Activation time for keypad functions   | sec  | 0 ... 15   | 3       |             |   |
| <b>H06</b>   | inS  | Key or digital input configured as AUX/LIGHT on with device in stand-by.<br>n = not active; y = active.  | flag   | n/y  | y       |             |   |
| <b>H08</b>   | inS  | Stand-by operating mode.<br><b>0</b> = the display is off and the regulators on, the device signals any alarms by reactivating the display. <b>1</b> = the display is on, plus all regulators including alarms.<br><b>2</b> = the display is off, plus all regulators are locked including alarms.<br><b>3</b> = the upper display shows the label "OFF", plus all regulators are locked including alarms.   | num  | 0/1/2/3  | 3       |             |   |
| <b>H11</b>   | inS  | Configuration of digital input 1/polarity.<br><b>NOTE:</b> - The "+" sign indicates that the input is active when the contact is closed.<br>- The "-" sign indicates that the input is active when the contact is open.<br><br><table border="0" style="width: 100%;"> <tr> <td style="vertical-align: top;"> <b>0</b> = Disabled<br/> <b>± 1</b> = Defrost<br/> <b>± 2</b> = Reduced set<br/> <b>± 3</b> = Auxiliary AUX<br/> <b>± 4</b> = Door switch<br/> <b>± 5</b> = External alarm<br/> <b>± 6</b> = Disable HACCP alarm storage<br/> <b>± 7</b> = Stand-by<br/> <b>± 8</b> = NOT USED<br/> <b>± 9</b> = Minimum pressure switch </td> <td style="vertical-align: top;"> <b>±10</b> = Maximum pressure switch<br/> <b>±11</b> = General pressure switch<br/> <b>±12</b> = Preheat<br/> <b>±13</b> = Force evaporator fans<br/> <b>±14</b> = Activate light relay<br/> <b>±15</b> = Activate Frame Heater relay<br/> <b>±16</b> = Enable/disable Night And Day functions<br/> <b>±17</b> = Deep cooling cycle<br/> <b>±18</b> = Panic alarm<br/> <b>±19</b> = Reset HACCP alarms<br/> <b>±20</b> = Pressure switch Pump Down </td> </tr> </table> | <b>0</b> = Disabled<br><b>± 1</b> = Defrost<br><b>± 2</b> = Reduced set<br><b>± 3</b> = Auxiliary AUX<br><b>± 4</b> = Door switch<br><b>± 5</b> = External alarm<br><b>± 6</b> = Disable HACCP alarm storage<br><b>± 7</b> = Stand-by<br><b>± 8</b> = NOT USED<br><b>± 9</b> = Minimum pressure switch | <b>±10</b> = Maximum pressure switch<br><b>±11</b> = General pressure switch<br><b>±12</b> = Preheat<br><b>±13</b> = Force evaporator fans<br><b>±14</b> = Activate light relay<br><b>±15</b> = Activate Frame Heater relay<br><b>±16</b> = Enable/disable Night And Day functions<br><b>±17</b> = Deep cooling cycle<br><b>±18</b> = Panic alarm<br><b>±19</b> = Reset HACCP alarms<br><b>±20</b> = Pressure switch Pump Down | num     | -20 ... +20 | 4 |
| <b>0</b> = Disabled<br><b>± 1</b> = Defrost<br><b>± 2</b> = Reduced set<br><b>± 3</b> = Auxiliary AUX<br><b>± 4</b> = Door switch<br><b>± 5</b> = External alarm<br><b>± 6</b> = Disable HACCP alarm storage<br><b>± 7</b> = Stand-by<br><b>± 8</b> = NOT USED<br><b>± 9</b> = Minimum pressure switch | <b>±10</b> = Maximum pressure switch<br><b>±11</b> = General pressure switch<br><b>±12</b> = Preheat<br><b>±13</b> = Force evaporator fans<br><b>±14</b> = Activate light relay<br><b>±15</b> = Activate Frame Heater relay<br><b>±16</b> = Enable/disable Night And Day functions<br><b>±17</b> = Deep cooling cycle<br><b>±18</b> = Panic alarm<br><b>±19</b> = Reset HACCP alarms<br><b>±20</b> = Pressure switch Pump Down |  |  |  |         |             |   |
| <b>H12</b>   | inS  | Configuration of digital input 2/polarity. Same as <b>H11</b> .  | num  | -20 ... +20  | 0       |             |   |
| <b>H21</b>   | inS  | Configuration of digital output 1 (OUT 1).<br><br><table border="0" style="width: 100%;"> <tr> <td style="vertical-align: top;"> <b>0</b> = Disabled<br/> <b>1</b> = Compressor (cooling)<br/> <b>2</b> = Defrost<br/> <b>3</b> = Fans<br/> <b>4</b> = Alarm<br/> <b>5</b> = AUX<br/> <b>6</b> = Stand-by<br/> <b>7</b> = Light </td> <td style="vertical-align: top;"> <b>8</b> = Buzzer output<br/> <b>9</b> = 2nd evaporator<br/> <b>10</b> = 2nd compressor<br/> <b>11</b> = Frame Heater<br/> <b>12</b> = Condenser fans<br/> <b>13</b> = Compressor Pump Down </td> </tr> </table>   | <b>0</b> = Disabled<br><b>1</b> = Compressor (cooling)<br><b>2</b> = Defrost<br><b>3</b> = Fans<br><b>4</b> = Alarm<br><b>5</b> = AUX<br><b>6</b> = Stand-by<br><b>7</b> = Light   | <b>8</b> = Buzzer output<br><b>9</b> = 2nd evaporator<br><b>10</b> = 2nd compressor<br><b>11</b> = Frame Heater<br><b>12</b> = Condenser fans<br><b>13</b> = Compressor Pump Down  | num     | 0 ... 13    | 1 |
| <b>0</b> = Disabled<br><b>1</b> = Compressor (cooling)<br><b>2</b> = Defrost<br><b>3</b> = Fans<br><b>4</b> = Alarm<br><b>5</b> = AUX<br><b>6</b> = Stand-by<br><b>7</b> = Light   | <b>8</b> = Buzzer output<br><b>9</b> = 2nd evaporator<br><b>10</b> = 2nd compressor<br><b>11</b> = Frame Heater<br><b>12</b> = Condenser fans<br><b>13</b> = Compressor Pump Down  |  |  |  |         |             |   |
| <b>H22</b>   | inS  | Configuration of digital output 2 (OUT 2). Same as <b>H21</b> .  | num  | 0 ... 13   | 2       |             |   |
| <b>H23</b>   | inS  | Configuration of digital output 3 (OUT 3). Same as <b>H21</b> .  | num  | 0 ... 13   | 3       |             |   |
| <b>H24</b>   | inS  | <b>PARAMETER ONLY VISIBLE IN MODEL EWRC 500 NT 5 relays</b><br>Configuration of digital output 4 (OUT 4). Same as <b>H21</b> .   | num  | 0 ... 13   | 7       |             |   |
| <b>H25</b>   | inS  | <b>PARAMETER ONLY VISIBLE IN MODEL EWRC 500 NT 5 relays</b><br>Configuration of digital output 5 (OUT 5). Same as <b>H21</b> .   | num  | 0 ... 13   | 4       |             |   |
| <b>H28</b>   | inS  | Enable buzzer.<br>(0) = output disabled.<br>(8) = output enabled.  | num  | 0 ... 13   | 8       |             |   |
| <b>H32</b>   | inS  | Configuration of DOWN key.<br><br><table border="0" style="width: 100%;"> <tr> <td style="vertical-align: top;"> <b>0</b> = Disabled<br/> <b>1</b> = Defrost<br/> <b>2</b> = Auxiliary<br/> <b>3</b> = Activate economy setpoint<br/> <b>4</b> = Reset HACCP alarms<br/> <b>5</b> = Disable HACCP alarms<br/> <b>6</b> = Light<br/> <b>7</b> = Stand-by<br/> <b>8</b> = NOT USED<br/> <b>9</b> = Evaporator fans ON </td> <td style="vertical-align: top;"> <b>10</b> = Activate / deactivate Frame Heater relay<br/> <b>11</b> = Enable/disable Night And Day functions<br/> <b>12</b> = Deep cooling cycle<br/> <b>13</b> = Clear voltage drop errors (Power Failure Reset)<br/> <b>14</b> = Service stoppage<br/> <b>15</b> = Activate economy set + Night And Day </td> </tr> </table>   | <b>0</b> = Disabled<br><b>1</b> = Defrost<br><b>2</b> = Auxiliary<br><b>3</b> = Activate economy setpoint<br><b>4</b> = Reset HACCP alarms<br><b>5</b> = Disable HACCP alarms<br><b>6</b> = Light<br><b>7</b> = Stand-by<br><b>8</b> = NOT USED<br><b>9</b> = Evaporator fans ON                       | <b>10</b> = Activate / deactivate Frame Heater relay<br><b>11</b> = Enable/disable Night And Day functions<br><b>12</b> = Deep cooling cycle<br><b>13</b> = Clear voltage drop errors (Power Failure Reset)<br><b>14</b> = Service stoppage<br><b>15</b> = Activate economy set + Night And Day  | num     | 0 ... 15    | 2 |
| <b>0</b> = Disabled<br><b>1</b> = Defrost<br><b>2</b> = Auxiliary<br><b>3</b> = Activate economy setpoint<br><b>4</b> = Reset HACCP alarms<br><b>5</b> = Disable HACCP alarms<br><b>6</b> = Light<br><b>7</b> = Stand-by<br><b>8</b> = NOT USED<br><b>9</b> = Evaporator fans ON                       | <b>10</b> = Activate / deactivate Frame Heater relay<br><b>11</b> = Enable/disable Night And Day functions<br><b>12</b> = Deep cooling cycle<br><b>13</b> = Clear voltage drop errors (Power Failure Reset)<br><b>14</b> = Service stoppage<br><b>15</b> = Activate economy set + Night And Day  |  |  |  |         |             |   |
| <b>H33</b>   | inS  | Configuration of ESC key. Same as <b>H32</b> .   | num  | 0 ... 15   | 1       |             |   |
| <b>H34</b>   | inS  | ON/OFF key configuration. Same as <b>H33</b> .   | num  | 0 ... 15   | 7       |             |   |



| PAR.   | LEV.    | DESCRIPTION   | U.M.  | RANGE       | DEFAULT |
|--|---------|---|-------|-------------|---------|
| H35  | inS     | LIGHT key configuration. Same as H34.   | num   | 0 ... 15    | 6       |
| H41  | inS     | Presence of Cold Room probe Pb1.<br>n= not present; y= present.   | flag  | n/y         | y       |
| H42  | USr/inS | Presence of Evaporator probe Pb2.<br>n= not present; y= present.  | flag  | n/y         | y       |
| H43  | inS     | Presence of probe Pb3 n=not present; y=present;<br>2EP= second evaporator; 3-1= regulation on Pb1 or on Pb3-Pb1 differential  | num   | n/y/2EP/3-1 | n       |
| H44  | inS     | Setpoint for Pb3-Pb1 temperature differential.<br>Sets the Pb3-Pb1 differential.<br>If H43=3-1, regulation of the temperature differential between probes Pb3 and Pb1, in addition to regulation of probe Pb1, is enabled. In this way, to activate compressor regulation, one or both of the two conditions must be met (on Pb1 or Pb3-Pb1 differential). The differential is defined by H44.<br>To disable the compressor, both conditions must be met, so:<br>• Output enabled if: Pb1>SET+diF, or (Pb3-Pb1) > H44+diF.<br>• Output not enabled if: Pb1<SET and (Pb3-Pb1) < H44. | °C/°F | 0...255     | 0.0     |
| H45  | inS     | Start defrost mode for applications with double evaporator:<br>0 = Defrost is enabled by checking only that the temperature of evaporator 1 is lower than the value set in parameter dSt.<br>1 = Defrost is enabled, checking that the readings from at least one of the two probes is below its defrosting end temperature (dSt for evaporator 1 and dS2 for evaporator 2).<br>2 = Defrost is enabled, checking that both probe values are below the relative end of defrost Setpoints (dSt for evaporator 1 and dS2 for evaporator 2).  | num   | 0/1/2       | 0       |
| H48  | inS     | <b>PARAMETER ONLY VISIBLE IN MODEL EWRC 500 NT HACCP</b><br>Clock presence.<br>(0) = no clock.<br>(1) = clock present.  | flag  | n/y         | y       |
| rEL  | USr/inS | Firmware version release (e.g. 1,2,...). Read only. See Technical Support.  | /     | /           |         |
| tAb  | USr/inS | Map code. Read only. See Technical Support.   | /     | /           |         |
| H60  | inS     | Display of selected application.<br>0 = no vector selected; 1 = vector 1, ..., 6 = vector 6.<br>It has a subset of parameters which can be programmed in line with the type of configuration required for the installation.<br>By setting H60, the user can also select one of the six 'sets' of pre-programmed parameters. If you do not want to enable any of the available setpoints, but prefer to use the programming menu values, simply set parameter H60 to 0.<br>The parameters corresponding to the different programs are described at the bottom of the table.          | num   | 0 ... 6     | 0       |
| <b>FRAME HEATER parameters (FrH)</b>   |         |   |       |             |         |
| <b>The Frame Heater function can be selected by key or by Digital Input.</b><br>This function can be associated to all relay outputs (by setting parameters H21...H25 = 11) and can be used to actuate "Duty Cycle" regulation with the intervals set by parameters HOn and HOF. |         |   |       |             |         |
| HOn  | inS     | Frame Heater regulator output ON time.  | min   | 0 ... 255   | 0       |
| HOF  | inS     | Frame Heater regulator output OFF time.   | min   | 0 ... 255   | 0       |
| dt3  | inS     | Frame Heater regulator time standard unit of measurement:<br>0 = hours; 1 = minutes; 2 = seconds.   | num   | 0 ... 2     | 0       |
| <b>COPY CARD parameters (FPr)</b>  |         |   |       |             |         |
| UL   |         | Upload. To transfer programming parameters from instrument to CopyCard.   | /     | /           |         |
| dL   |         | Download. To transfer programming parameters from Copy Card to instrument.  | /     | /           |         |
| Fr   |         | Formatting. To erase data on Copy Card.<br><b>IMPORTANT: if parameter "Fr" is used, the data entered will be permanently lost. This operation cannot be reversed.</b>   | /     | /           |         |



### 7.3.1. PARAMETER H60

Display of selected application.

0 = no vector selected; 1 = vector 1, ..., 6 = vector 6.

It has a subset of parameters which can be programmed in line with the type of configuration required for the installation.

By setting H60, the user can also select one of the six 'sets' of pre-programmed parameters. If you do not want to enable any of the available setpoints, but prefer to use the programming menu values, simply set parameter H60 to 0.

The parameters corresponding to the different programs are described at the bottom of the table.

| parameter H60   | =1    | =2   | =3    | =4   | =5    | =6   |
|---|-------|------|-------|------|-------|------|
| <b>SEt</b> Temperature control SEtpoint                       | 0.0   | 2.0  | -18.0 | 2.0  | -18.0 | 5.0  |
| <b>diF</b> Activation differential (absolute or relative)     | 2.0   | 2.0  | 2.0   | 2.0  | 2.0   | 2.0  |
| <b>LSE</b> Maximum value that can be assigned to the setpoint | -50.0 | -5.0 | -25.0 | -5.0 | -25.0 | 2.0  |
| <b>HSE</b> Minimum value that can be assigned to the setpoint | 50.0  | 5.0  | -15.0 | 5.0  | -15.0 | 10.0 |
| <b>dSt</b> Defrost end temperature                            | 6.0   | 10.0 | 15.0  | 10.0 | 15.0  | 10.0 |
| <b>FSt</b> Fans disabling temperature                         | 6.0   | 8.0  | -5.0  | 8.0  | -5.0  | 50.0 |
| <b>dtY</b> Defrost mode                                       | 0     | 1    | 1     | 0    | 0     | 0    |
| <b>dit</b> Defrost cycle activation delay from request        | 6     | 6    | 6     | 6    | 6     | 6    |
| <b>dCt</b> Defrost interval count mode.                       | 1     | 1    | 1     | 1    | 1     | 1    |
| <b>dOH</b> Defrost cycle enabling delay from request          | 0     | 0    | 0     | 0    | 0     | 0    |
| <b>dEt</b> Defrost timeout                                    | 30    | 15   | 15    | 30   | 30    | 15   |
| <b>Fdt</b> Fans activation delay after a defrost cycle        | 3     | 1    | 2     | 1    | 2     | 0    |
| <b>dt</b> Dripping time. Dripping time                        | 0     | 2    | 2     | 2    | 2     | 0    |
| <b>dPO</b> Defrost enabling request from power-on             | 0     | 0    | 0     | 0    | 0     | 0    |
| <b>ddl</b> Display mode during defrost                        | 1     | 0    | 0     | 0    | 0     | 0    |
| <b>dFd</b> Operating mode of evaporator fans during defrost   | 1     | 1    | 1     | 1    | 1     | 1    |

## 8. ALARMS



### 8.1. ALARMS AND SIGNALS TABLE

When an alarm condition is detected, the ALARM LED will come on.

If present and enabled, the buzzer and alarm relay will also activate.

To silence the buzzer, press and release any key, the relative icon will continue to flash.

All alarms are reset automatically (i.e. they disappear when the issue that caused them is removed).

The alarm codes are as follows:

| Code | Description                   | Alarm relay   | Reset         | Parameters involved in ENABLING ALARM       |
|------|-------------------------------|---------------|---------------|---|
| E1   | Pb1 probe faulty              | <b>active</b> | Automatic     | Ont, OFt                                    |
| E2   | Pb2 probe faulty              | <b>active</b> | Automatic     | Ont, OFt                                    |
| E3   | Pb3 probe faulty              | <b>active</b> | Automatic     | Ont, OFt                                    |
| HA1  | HIGH temperature alarm        | <b>active</b> | Automatic     | SP1, Att, AFd, HAL, LAL, PAO, dAO, OAO, tAO |
| LA1  | LOW temperature alarm         | <b>active</b> | Automatic     | SP1, Att, AFd, HAL, LAL, PAO, dAO, OAO, tAO |
| EAL  | External alarm                | <b>active</b> | Automatic     | PEA, rLO                                    |
| OPd  | Door open alarm               | not active    | Automatic     | PEA, tdO                                    |
| Ad2  | Defrost end due to timeout    | not active    | Automatic     | dEt, dE2, dAt                               |
| PAn  | Panic alarm                   | not active    | Automatic     |   |
| Prr  | Preheat alarm                 | not active    | Automatic     |   |
| E10  | Clock alarm                   | not active    | Automatic     |   |
| PA   | General pressure switch alarm | not active    | <b>Manual</b> | PEn, PEi                                    |
| LPA  | Low pressure switch alarm     | not active    | <b>Manual</b> | PEn, PEi                                    |
| HPA  | High pressure switch alarm    | not active    | <b>Manual</b> | PEn, PEi                                    |

#### NOTES:

- 1) If alarm exclusion times have been set (see "ALr" folder in the parameters table) the alarm will not be signalled.
- 2) With the exception of faulty probe alarms, all other alarms will record the corresponding label in the ALr folder (press UP key).
- 3) Faulty probe alarms will be indicated on the display by means of label E1, E2, E3 depending on whether the fault relates to probe Pb1, Pb2 or Pb3 respectively.





## 8.2. ALARM CAUSE/EFFECT TABLE

**EWRC 300/500 NT** can run integral diagnostics on the installation, signalling any operating faults with specific alarms found, and record and signal any user-defined unusual events to have greater control over the system as a whole.

| Label              | Fault                         | Cause  | Effects  | Remedy  |
|--------------------|-------------------------------|--|--|---|
| <b>E1</b>          | Probe Pb1 faulty              | <ul style="list-style-type: none"> <li>Measured values are outside operating range</li> <li>Probe faulty/short-circuited/open</li> </ul>                       | <ul style="list-style-type: none"> <li>Label <b>E1</b> displayed</li> <li>Alarm icon permanently alight</li> </ul>   | <ul style="list-style-type: none"> <li>Check probe type (<b>H00</b>)</li> <li>Check probe wiring</li> <li>Replace probe</li> </ul>  |
| <b>E2</b>          | Probe Pb2 faulty              | <ul style="list-style-type: none"> <li>Measured values are outside operating range.</li> <li>Probe faulty/short-circuited/open</li> </ul>                      | <ul style="list-style-type: none"> <li>Label <b>E2</b> displayed</li> <li>Alarm icon permanently alight</li> </ul>   | <ul style="list-style-type: none"> <li>Check probe type (<b>H00</b>)</li> <li>Check probe wiring</li> <li>Replace probe</li> </ul>  |
| <b>E3</b>          | Probe Pb3 faulty              | <ul style="list-style-type: none"> <li>Measured values are outside operating range</li> <li>Probe faulty/short-circuited/open</li> </ul>                       | <ul style="list-style-type: none"> <li>Label <b>E3</b> displayed</li> <li>Alarm icon permanently alight</li> </ul>   | <ul style="list-style-type: none"> <li>Check probe type (<b>H00</b>)</li> <li>Check probe wiring</li> <li>Replace probe</li> </ul>  |
| <b>HA1</b>         | HIGH temperature alarm 1      | Value read by probe 1 > HA1 after time equal to <b>tAO</b> .<br>(see "MAX/MIN TEMP. ALARMS")   | <ul style="list-style-type: none"> <li>Label <b>HA1</b> recorded in folder ALr</li> <li>No effect on regulation</li> </ul>   | Wait until value read by the probe returns below <b>HA1-AFd</b> .   |
| <b>LA1</b>         | LOW temperature alarm 1       | Value read by probe 1 < LA1 after time equal to tAO.<br>(see "MAX/MIN TEMP. ALARMS")   | <ul style="list-style-type: none"> <li>Label <b>LA1</b> recorded in folder ALr</li> <li>No effect on regulation</li> </ul>   | Wait until value read by the probe returns above <b>LA1+AFd</b> .   |
| <b>HA3</b>         | HIGH temperature alarm 3      | <u>PbA = 1 or 2</u><br>Value read by probe Pb3 > HAL after time equal to tAO.<br><br><u>PbA = 3 and dA3 &gt; 0</u><br>Value read by probe Pb3 > SA3 + time tA3 | <ul style="list-style-type: none"> <li>Label <b>HA3</b> recorded in folder ALr</li> <li>No effect on regulation</li> </ul>   | Wait until value read by the probe returns below HAL-AFd.<br><br><b>PbA = 1 or 2</b><br>returns below HAL-AFd.<br><br><b>PbA = 3 and dA3 &gt; 0</b><br>returns below SA3-dA3. |
| <b>LA3</b>         | LOW temperature alarm 3       | <u>PbA = 1 or 2</u><br>Value read by probe Pb3 < LAL after time equal to tAO.<br><br><u>PbA = 3 and dA3 &lt; 0</u><br>Value read by probe Pb3 < SA3 + time tA3 | <ul style="list-style-type: none"> <li>Label <b>LA3</b> recorded in folder ALr</li> <li>No effect on regulation</li> </ul>   | Attendere il rientro del valore letto dalla sonda<br><b>PbA = 1 or 2</b><br>returns above LAL-AFd.<br><br><b>con PbA = 3 and dA3 &lt; 0</b><br>return above SA3-dA3.          |
| <b>EAL</b>         | External alarm                | Digital input activated.   | <ul style="list-style-type: none"> <li>Label <b>EAL</b> recorded in folder ALr</li> <li>Alarm icon permanently alight</li> <li>Lockout of regulation as requested by <b>rLO</b></li> </ul>   | Check and remove external cause of alarm on D.I.  |
| <b>OPd</b>         | Door open alarm               | Digital input activated<br>(for a time greater than <b>tdO</b> ).  | <ul style="list-style-type: none"> <li>Label <b>OPd</b> recorded in folder ALr</li> <li>Alarm icon permanently alight</li> <li>Lockout of regulation as requested by <b>dOd</b></li> </ul>   | <ul style="list-style-type: none"> <li>Close the door</li> <li>Delay preceding defined alarm signal by <b>OAO</b></li> </ul>  |
| <b>Ad2</b>         | End of Defrost due to timeout | End of defrost cycle due to timeout rather than due to defrosting end temperature being read by <b>Pb2</b> .   | <ul style="list-style-type: none"> <li>Label <b>Ad2</b> recorded in folder ALr</li> <li>Alarm icon permanently alight</li> </ul>   | Await next defrost cycle for automatic return to normal   |
| <b>Prr</b>         | Preheat alarm                 | Alarm for preheat input regulator ON   | <ul style="list-style-type: none"> <li>Label <b>Prr</b> recorded in folder ALr</li> <li>Compressor icon blinking</li> <li>Regulation inhibited (Compressor and Fans)</li> </ul> <p><b>NOTE:</b> defrost will also be blocked if it is hot gas defrost.</p> | Preheat input regulator off.  |
| <b>E10</b>         | Clock alarm                   | <ul style="list-style-type: none"> <li>Clock (RTC) battery spent</li> <li>RTC failure</li> </ul>   | <ul style="list-style-type: none"> <li>Label <b>E10</b> recorded in folder ALr</li> <li>Functions associated with clock not available</li> </ul>   | Connect the instrument to the power supply.   |
| <b>P01 ... P99</b> | General pressure switch alarm | Pressure alarm activation by general pressure switch regulator.  | If the number <b>n</b> of pressure switch activations is<br>$n < PEn$ : <ul style="list-style-type: none"> <li>Number of pressure switch activations recorded</li> <li>Regulation inhibited (Compressor and Fans)</li> </ul>                               | Check and remove external cause of alarm on D.I. (Auto Reset).  |





| Label                           | Fault                         | Cause   | Effects  | Remedy  |
|---------------------------------|-------------------------------|---|--|---|
| <b>PA</b>                       | General pressure switch alarm | Pressure alarm activation by general pressure switch regulator.           | If the number <b>n</b> of pressure switch activations is<br>n=PEn:<br><ul style="list-style-type: none"> <li>• Label <b>PA</b> displayed</li> <li>• Recording of label <b>PA</b> in folder ALr</li> <li>• Alarm icon permanently alight</li> <li>• Regulation inhibited (Compressor and Fans)</li> </ul>   | <ul style="list-style-type: none"> <li>• Switch the device off and back on again</li> <li>• Reset alarms using the <b>rPA</b> key (Manual Reset)</li> </ul> |
| <b>L01</b><br>...<br><b>L99</b> | Low pressure switch alarm     | Activation of pressure switch alarm by minimum pressure switch regulator. | If the number <b>n</b> of pressure switch activations is<br>n<PEn:<br><ul style="list-style-type: none"> <li>• Number of pressure switch activations recorded</li> <li>• Regulation inhibited (Compressor and Fans)</li> </ul>   | Check and remove external cause of alarm on D.I. (Auto Reset).  |
| <b>LPA</b>                      | Low pressure switch alarm     | Activation of pressure switch alarm by minimum pressure switch regulator. | If the number <b>n</b> of pressure switch activations is<br>n=PEn:<br><ul style="list-style-type: none"> <li>• Label <b>LPA</b> displayed</li> <li>• Recording of label <b>LPA</b> in folder ALr</li> <li>• Alarm icon permanently alight</li> <li>• Regulation inhibited (Compressor and Fans)</li> </ul> | <ul style="list-style-type: none"> <li>• Switch the device off and back on again</li> <li>• Reset alarms using the <b>rPA</b> key (Manual Reset)</li> </ul> |
| <b>H01</b><br>...<br><b>H99</b> | High pressure switch alarm    | Activation of pressure switch alarm by maximum pressure switch regulator. | If the number <b>n</b> of pressure switch activations is<br>n<PEn:<br><ul style="list-style-type: none"> <li>• Number of pressure switch activations recorded</li> <li>• Regulation inhibited (Compressor and Fans)</li> </ul>   | Check and remove external cause of alarm on D.I. (Auto Reset).  |
| <b>HPA</b>                      | High pressure switch alarm    | Activation of pressure switch alarm by maximum pressure switch regulator. | If the number <b>n</b> of pressure switch activations is<br>n=PEn:<br><ul style="list-style-type: none"> <li>• Label <b>HPA</b> displayed</li> <li>• Label <b>HPA</b> recorded in folder ALr</li> <li>• Alarm icon permanently alight</li> <li>• Regulation inhibited (Compressor and Fans)</li> </ul>     | <ul style="list-style-type: none"> <li>• Switch the device off and back on again</li> <li>• Reset alarms using the <b>rPA</b> key (Manual Reset)</li> </ul> |
| <b>PAn</b>                      | Panic alarm                   | Digital input activated.  | <ul style="list-style-type: none"> <li>• Recording of label <b>PAn</b> in the alarms menu</li> <li>• Permanent illumination of Panic alarm LED</li> <li>• Regulation inhibited</li> </ul>  | Check and remove external cause of alarm on D.I. (Auto Reset).  |

**ALL ALARMS**

- Alarm icon permanently alight

Buzzer (if present) and alarm relay (OUT5) activated, except Ad2

Press any key to silence the alarm. The LED changes from a steady light to a blinking light. NOTE: the buzzer is deactivated while the alarm relay remains active

\*E1 - E2: If simultaneous they will be shown alternately on the display at a frequency of 2 seconds



## 8.3. DESCRIPTION OF ALARMS

### 8.3.1. PROBE ALARM

#### OPERATING CONDITIONS

When one of the probes is out of the nominal operating range or in the case of an open probe or a probe in short circuit, an alarm is generated if this condition persists for longer than 10 seconds.

The alarm condition is indicated on the display by means of the following error codes:

- **E1** = Probe Pb1 faulty
- **E2** = Probe Pb2 faulty
- **E3** = Probe Pb3 faulty

The alarm LED and alarm relay are activated. Codes **E1**, **E2**, **E3**, when occurring at the same time, are shown in the following sequence: E1 x 2 sec, E2 x 2 sec, E3 x 2 sec, etc.

#### ACTIONS ON CURRENT REGULATION

For all probes, the probe error condition causes the following actions:

- the display shows code **E<sub>x</sub>** (where **x** = 1, 2, 3)
- activation and permanent display of alarm icon and activation of alarm relay (if present)

When the faulty probe condition ceases, regulation resumes as normal.

During the probe error, the defrost interval count continues as normal.

#### SIGNALLING

| Code      | Meaning         |
|-----------|-----------------|
| <b>E1</b> | Probe Pb1 error |
| <b>E2</b> | Probe Pb2 error |
| <b>E3</b> | Probe Pb3 error |

#### ALARM ACKNOWLEDGMENT

In the alarm condition, it is possible to acknowledge the alarm and/or relay configured as an alarm, even if the alarm condition persists, by pressing any key or using the corresponding function in the menu. The alarm LED will start to blink.

Eliminating the cause of the alarm disarms the acknowledgement.

The probe fault alarm is not stored by the controller.

#### USER PARAMETERS

| Label      | Description  |
|------------|--|
| <b>Ont</b> | ON time for compressor output with faulty control probe  |
| <b>OFt</b> | OFF time for compressor output with faulty control probe |



## 8.3.2. MINIMUM AND MAXIMUM TEMPERATURE ALARM

### OPERATING CONDITIONS

The alarm regulation is carried out on probe 1. The temperature limits defined in parameters **HAL** and **LAL** are determined by parameter **Att** which specifies if they represent the absolute temperature value or a setpoint differential (in the case of offset on the entered setpoint, the high and low alarms will refer to this new control setpoint).

- If **Att** = 0 **Ab(solute)**, the temperature limits for probe 1/2 are absolute.
- If **Att** = 1 **rE(lative)**, the temperature limits for probe 1/2 refer to the **SEt**.

 **NOTE:** to obtain the minimum alarm below the setpoint in the case of **Att=1** (relative) it is necessary to set **LAL** < 0.

### ALARM CONDITIONS

A maximum/minimum alarm is generated when the Pb1 temperature is:


- Maximum alarm:  $\geq \text{HAL}$  if **Att=Ab(solute)** and  $\geq (\text{SEt} + \text{HAL})$  if **Att=rE(lative)**
- Minimum alarm:  $\leq \text{LAL}$  if **Att=Ab(solute)** and  $\leq (\text{SEt} + \text{LAL})$  if **Att=rE(lative)**


If **Att=Ab(solute)** the values of **HAL** and **LAL** must be with sign, if **Att=rE(lative)** it is necessary that **HAL** > 0 and **LAL** < 0.

When one of the two aforementioned conditions occurs, if no alarm override times apply (see alarm override parameters), the alarm LED lights up and the relay configured as alarm activates (if present).

The maximum/minimum alarm will be reset when the temperature of probe 1/2 is:

- Reset from maximum alarm:  $\leq (\text{HAL} - \text{AFd})$  if **Att=Ab(solute)** and  $\leq (\text{SEt} + \text{HAL} - \text{AFd})$  if **Att=rE(lative)**
- Reset from minimum alarm:  $\geq (\text{LAL} + \text{AFd})$  if **Att=Ab(solute)** and  $\geq (\text{SEt} + \text{LAL} + \text{AFd})$  if **Att=rE(lative)**

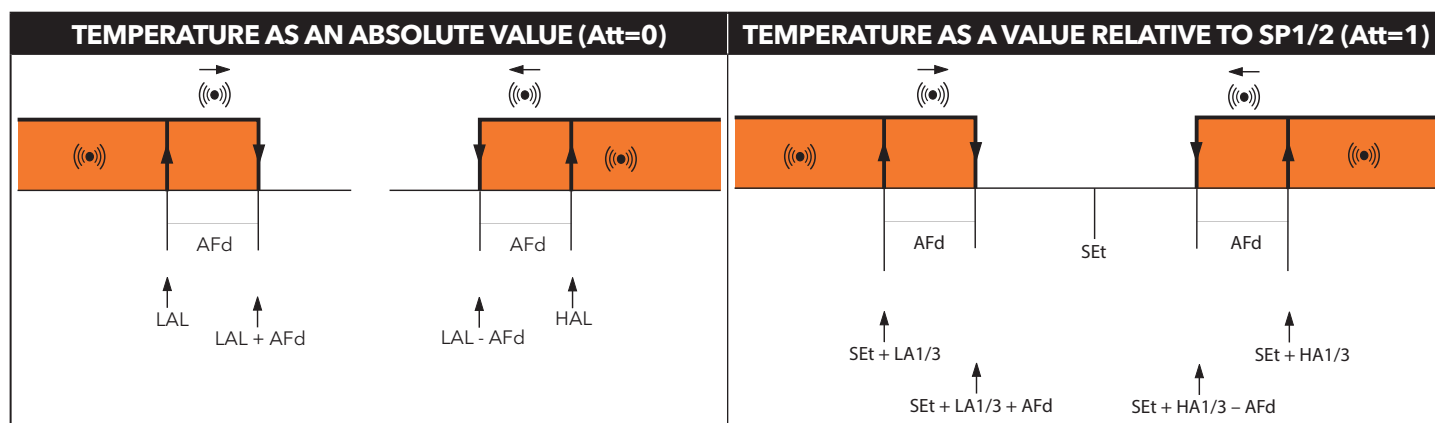

 **NOTES:**

- During a defrost cycle, high and low temperature alarms are overridden.
- Occurrence of this alarm does not effect any regulation in progress.

### SIGNALLING

| Code | Meaning                                 |
|------|---|
| HA1  | HIGH temperature alarm, refers to probe |
| LA1  | LOW temperature alarm, refers to probe  |

### ALARM ACKNOWLEDGMENT

In the alarm condition, it is possible to acknowledge the relay configured as an alarm (if present), even if the alarm condition persists, by pressing any key or using the corresponding function in the menu. The alarm LED will start to blink.

Eliminating the cause of the alarm disarms the acknowledgement.

The probe fault alarm is not stored by the controller.

### USER PARAMETERS

| Label      | Description  |
|------------|--|
| <b>Att</b> | HAL and LAL parameter mode (absolute or relative)            |
| <b>AFd</b> | Alarm activation differential                                |
| <b>HAL</b> | Probe maximum alarm threshold                                |
| <b>LAL</b> | Probe minimum alarm threshold                                |
| <b>PAO</b> | Temperature alarm exclusion time from power-on               |
| <b>dAO</b> | Temperature alarm disabling time after defrost cycle         |
| <b>OAO</b> | High/low temperature alarm exclusion time after door closing |
| <b>tAO</b> | Temperature alarms delay time                                |



### 8.3.3. END OF DEFROST DUE TO TIMEOUT ALARM

#### OPERATING CONDITIONS

The regulator is activated without any delay in the case of end of defrost due to timeout, instead of probe 2 reaching the defrost end temperature.

The action consists of:

- Permanent illumination of alarm LED
- Recording of label **Ad2** in the alarms menu

Automatic reset occurs with the start of the next defrost cycle.

The alarm LED can be switched off using the normal acknowledgement procedure, although the alarm signal is only actually cancelled at the start of the next defrost cycle.

#### SIGNALLING

| Code       | Meaning              |
|------------|----------------------|
| <b>Ad2</b> | Defrost alarm on Pb2 |

#### USER PARAMETERS

| Label      | Description                                    |
|------------|--|
| <b>dEt</b> | Evaporator 1 defrost timeout                   |
| <b>dE2</b> | Evaporator 2 defrost timeout                   |
| <b>dAt</b> | Alarm signalling end of defrost due to timeout |

### 8.3.4. EXTERNAL ALARM

#### OPERATING CONDITIONS

In the case of activation of the digital input, the alarm regulator is activated with the delay set by parameter **dAd**, and this alarm persists until the next time the digital input is deactivated.

The action consists of:

- Permanent illumination of alarm LED
- Recording of label **EAL** in the alarms menu
- Activation of the relay configured as alarm (if enabled)
- Deactivation of regulation if parameter **rLO** requires it.

It is possible to silence the alarm relay but the regulators still remain locked until the next time the digital input is deactivated.

The values that can be assigned to parameter **rLO** are:

- **rLO = 0**: an external alarm has not locked any resource;
- **rLO = 1**: an external alarm has locked the compressor and defrost;
- **rLO = 2**: an external alarm has locked the compressor, defrost and the fans.

#### SIGNALLING

| Code       | Meaning        |
|------------|----------------|
| <b>EAL</b> | External alarm |

#### USER PARAMETERS

| Label      | Description                             |
|------------|---|
| <b>rLO</b> | An external alarm blocks the regulators |



### 8.3.5. DOOR OPEN ALARM

#### OPERATING CONDITIONS

The door switch alarm is associated to a specially configured digital input:

- **H11, H12, = ± 4**

On activation of the digital input (door open) and after delay **tdO** has elapsed, the door open alarm must be signalled in the alarms folder and the LED and alarm relay must light up. The label **OPd** is displayed.

The action consists of:

- Permanent illumination of alarm LED
- Recording of label **OPd** in the alarms menu
- Activation of the relay configured as alarm

As in the case of the other alarms, the relay may be deactivated by pressing an acknowledgement key, the alarm LED will blink and label **OPd** will remain in the alarms menu until the door is closed.

If the door is opened, the regulator will operate on the basis of the value of parameter **dOd**. The values that can be assigned to it are:

- **dOd = 0**: no resource is locked;
- **dOd = 1**: fans are locked (FAN);
- **dOd = 2**: the compressor is locked (COMPR);
- **dOd = 3**: both the fans (FAN) and compressor (COMPR) are locked.

If the door open alarm locks the compressor, it can still be reactivated even if the door remains open, by setting the parameter **dCO**.

#### SIGNALLING

| Code       | Meaning         |
|------------|-----------------|
| <b>OPd</b> | Door open alarm |

#### USER PARAMETERS

| Label      | Description   |
|------------|---|
| <b>dOd</b> | Digital input for switching off loads:<br><b>0</b> = disabled; <b>1</b> = fans disabled; <b>2</b> = compressor disabled; <b>3</b> = fans and compressor disabled. |
| <b>dCO</b> | Compressor activation delay from acknowledgement  |
| <b>tdO</b> | Open door disabling time  |



### 8.3.6. PRESSURE SWITCH INPUT ALARM

#### OPERATING CONDITIONS

The pressure switch is associated with a suitably configured Digital Input and can be general, minimum or maximum.



**NOTE:** behaviour and configuration parameters are the same for all three types.

Every time pressure switch input activation causes the compressor/fans to be deactivated instantly, with only visual indication of the activation (WARNING) provided via illumination of the alarm LED and recording of the number of pressure switch activations that have taken place.

If the pressure switch Digital Input is deactivated, the compressor starts up again and the alarm LED switches off, but the alarm folder still contains the number of activations recorded in the previous counting interval (defined using parameter PEi).

Once the number of activations set in parameter **PEn** has been reached, **PA** (general), **LPA** (minimum) or **HPA** (maximum) will appear on the display.

Compressor, fans and defrosts are deactivated, the alarm LED lights up and the alarm relay comes on if configured. Once the device has entered alarm mode, it must be switched off and on again, or a key-activated reset performed using the function **rPA** (reset pressure switch alarm) on the functions menu.



**NOTE:** the value **PEn** represents the number of pressure switch activations within the interval defined in parameter PEI, which determines activation of alarm mode and deactivation of the compressor, fan and defrost outputs.  
If **PEn = 0** the function is excluded and the pressure switch alarm is ignored.

#### SIGNALLING

| Code       | Meaning                       |
|------------|-------------------------------|
| <b>PA</b>  | General pressure switch alarm |
| <b>LPA</b> | Minimum pressure switch alarm |
| <b>HPA</b> | Maximum pressure switch alarm |

#### USER PARAMETERS

| Label      | Description  |
|------------|--|
| <b>PEn</b> | Number of errors allowed per pressure switch input. <b>0</b> = disabled. |
| <b>PEi</b> | Pressure switch error count interval.                                    |

### 8.3.7. PANIC ALARM

#### OPERATING CONDITIONS

The panic alarm is associated to a specially configured digital input:

- **H11, H12, = ± 18**

After the delay set in parameter dAd, this alarm is activated and persists until the next digital input deactivation.

The action consists of:

- Permanent illumination of Panic alarm LED
- Recording of label **PAn** in the alarms menu
- Activation of the relay configured as alarm (if enabled)

It is possible to lock the alarm relay but the regulators still remain locked until the next time the digital input is deactivated.

#### SIGNALLING

| Code       | Meaning     |
|------------|-------------|
| <b>PAn</b> | Panic alarm |

#### USER PARAMETERS

| Label      | Description                   |
|------------|-------------------------------|
| <b>dAd</b> | Activation delay DI1 and DI 2 |

## 9. MODBUS MSK 554 FUNCTIONS AND RESOURCES



ModBUS is a client/server protocol for communication between devices connected in a network.

ModBUS devices communicate using a master-slave technique in which only one device (master) can send messages.

The other devices in the network (slave) respond, returning the data requested by the master or executing the action contained in the message sent.

A slave is a device connected to a network that processes information and sends the results to the master using the ModBUS protocol. The master device can send messages to individual slaves or to the entire network (broadcast) whilst slaves can only respond individually to the master.

The ModBUS standard used by Eliwell employs the RTU code for data transmission.

### 9.3.1. DATA FORMAT (RTU)

The coding model used defines the structure of messages transmitted on the network and the way in which this information is deciphered. The type of coding is usually selected on the basis of specific parameters (baud rate, parity, etc.); furthermore, some devices support only specific coding models, although it must be the same one for all devices connected in a ModBUS network.

The protocol uses the RTU binary method with bytes configured as follows: **8 bit for data, none parity bit (configurable), 2 stop BIT.**


**NOTE: the transmission speed must be set at 9600 baud.**

Parameter setting allows the integral configuration of the device

They can be modified through:

- Device keypad
- Copy Card
- Sending data via ModBUS protocol directly to an individual controller or broadcasting it using the address 0.

### 9.3.2. NETWORK

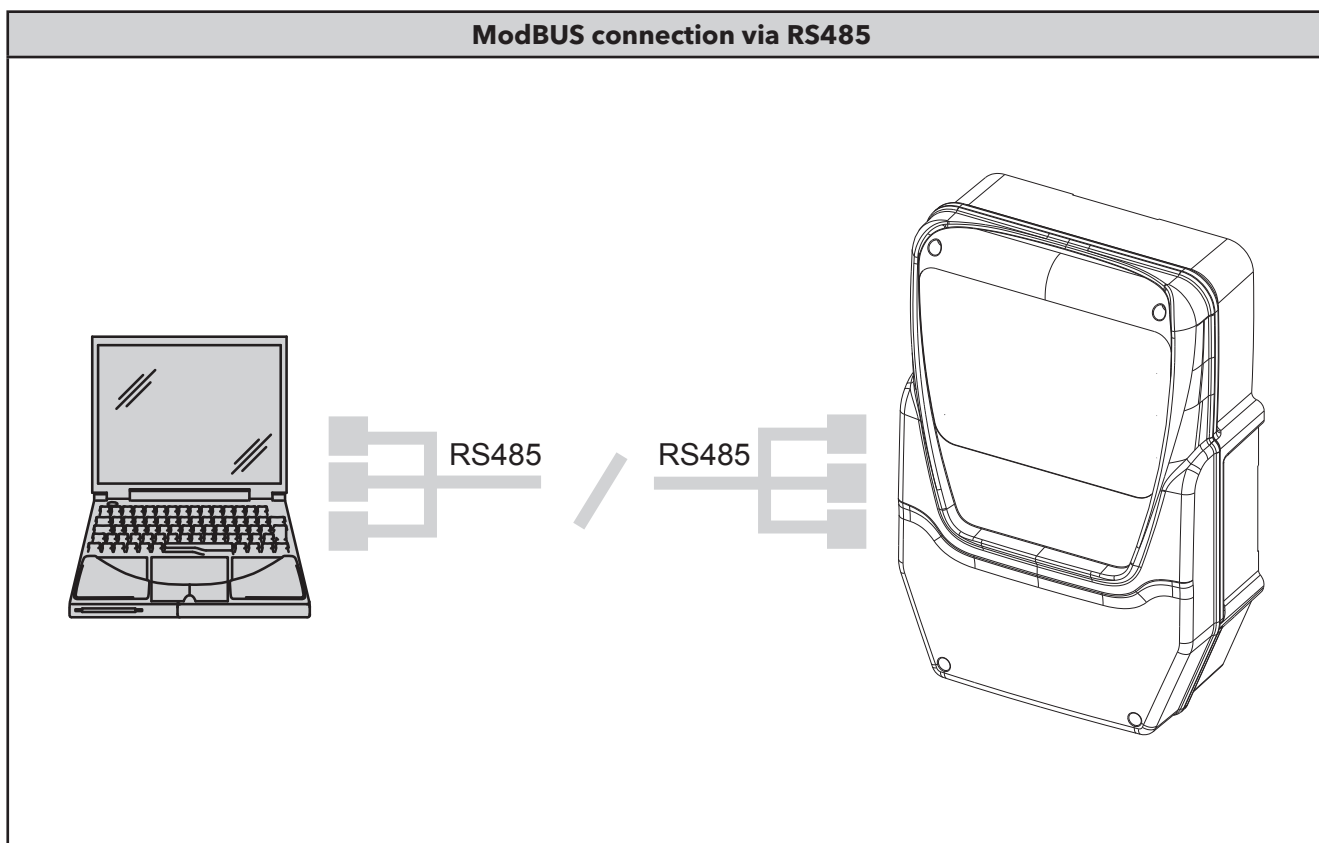



### 9.3.3. MODBUS COMMANDS AVAILABLE AND DATA AREAS

The following commands are implemented:

| ModBUS command       | Description of command  |            |                   |          |                                |          |                               |          |  |
|----------------------|---|------------|-------------------|----------|--------------------------------|----------|-------------------------------|----------|--|
| <b>03</b> (hex 0x03) | Read 16 consecutive registers for Client side.  |            |                   |          |                                |          |                               |          |  |
| <b>04</b> (hex 0x04) | Read 1 single register for parameters.  |            |                   |          |                                |          |                               |          |  |
| <b>16</b> (hex 0x10) | Write 15 consecutive registers for Client side.   |            |                   |          |                                |          |                               |          |  |
| <b>22</b> (hex 0x16) | Write 1 register for the parameters.  |            |                   |          |                                |          |                               |          |  |
| <b>43</b> (hex 0x2B) | Read device ID.<br>It is possible to read the following 3 fields: <table border="1" data-bbox="632 689 1439 891"> <thead> <tr> <th>Field code</th> <th>Field description</th> </tr> </thead> <tbody> <tr> <td><b>0</b></td> <td>Manufacturer ID (= "Invensys")</td> </tr> <tr> <td><b>1</b></td> <td>Device model/polycarbonate ID</td> </tr> <tr> <td><b>2</b></td> <td>Family ID (MSK 554)/<br/>instrument version</td> </tr> </tbody> </table> | Field code | Field description | <b>0</b> | Manufacturer ID (= "Invensys") | <b>1</b> | Device model/polycarbonate ID | <b>2</b> | Family ID (MSK 554)/<br>instrument version |
| Field code           | Field description   |            |                   |          |                                |          |                               |          |  |
| <b>0</b>             | Manufacturer ID (= "Invensys")  |            |                   |          |                                |          |                               |          |  |
| <b>1</b>             | Device model/polycarbonate ID   |            |                   |          |                                |          |                               |          |  |
| <b>2</b>             | Family ID (MSK 554)/<br>instrument version  |            |                   |          |                                |          |                               |          |  |

#### Length restrictions

|  |          |
|--|----------|
| Maximum length in bytes of messages sent to device         | 30 BYTES |
| Maximum length in bytes of messages received by the device | 30 BYTES |

### 9.3.4. ADDRESS CONFIGURATION

The serial TTL - which we will call COM1 - can be used to configure the device, parameters, statuses, and variables with ModBUS via the ModBUS protocol.

The address of a device within a ModBUS message is set using the parameter **Adr**.

The address 0 is used for broadcast messages that all slaves recognise. Slaves don't respond to broadcast messages. The parameters for configuring the device are:

| Parameter  | Description                        | Values | Range  |
|------------|------------------------------------|--------|--|
| <b>PtS</b> | Select COM1 (TTL) protocol         | d      | t = Televis<br>d = ModBUS  |
| <b>Adr</b> | ModBUS protocol controller address | 1      | 1 ... 250  |
| <b>Pty</b> | ModBUS protocol parity bit         | n      | <ul style="list-style-type: none"> <li>• n= NONE</li> <li>• E = EVEN (parity)</li> <li>• o = ODD (disparity)</li> </ul>    |
| <b>bAU</b> | Baudrate selection                 | 96     | <ul style="list-style-type: none"> <li>• 96 = 9600 baud</li> <li>• 192 = 19200 baud</li> <li>• 384 = 38400 baud</li> </ul> |

**NOTE:** to guarantee correct operation, the controller must be switched off and switched on again after modification

**IMPORTANT:** remember to set **1 BIT** of stop.





### 9.3.5. PARAMETER VISIBILITY AND VALUES

#### IMPORTANT:

- 1) When not indicated otherwise, the parameter is always visible and modifiable, unless customised settings have been configured by the user via serial.
- 2) If folder visibility is modified, the new setting will apply to all parameters in the folder.

### 9.3.6. MODBUS TABLES

The tables below list all information required to read, write and decode all accessible resources in the device. There are 3 tables:

- the "**PARAMETER TABLE**" contains all device configuration parameters stored in the controller's non-volatile memory, including visibility
- the "**FOLDER VISIBILITY TABLE**" indicates the visibility of the folders containing the parameters
- the "**CLIENT TABLE**" includes all I/O and alarm status resources available in the volatile memory of the instrument.

#### Description of columns:

#### FOLDER

Indicates the label of the folder containing the parameter in question.

#### LABEL

Indicates the label used to display the parameters in the menu of the controller.

#### PAR. VALUE ADDRESS

The whole part represents the address of the ModBUS register containing the value of the resource to be read or written in the controller. The value after the decimal point indicates the position of the most significant data bit inside the register; if not indicated it is taken to be zero. This information is always provided when the register contains more than one information item, and it is necessary to distinguish which bits actually represent the data (the working size of the data indicated in the column DATA SIZE is also taken into consideration).

Given that the ModBUS registers have the size of one WORD (16 bit), the index number after the point can vary from 0 (least significant bit -LSb-) to 15 (most significant bit -MSb-).

Examples (in binary form the least significant bit is the first on the right):

| PAR. VALUE ADDRESS | DATA SIZE | Value |      | Content of register         |
|--------------------|-----------|-------|------|-----------------------------|
| 8806               | WORD      | 1350  | 1350 | (0000010101000110)          |
| 8806               | BYTE      | 70    | 1350 | (00000101 <b>01000110</b> ) |
| 8806.8             | BYTE      | 5     | 1350 | ( <b>00000101</b> 01000110) |
| 8806.14            | 1 BIT     | 0     | 1350 | (0000010101000 <b>110</b> ) |
| 8806.7             | 4 BIT     | 10    | 1350 | (00000 <b>1010</b> 1000110) |

**IMPORTANT:** when the register contains more than one piece of data, the write procedure is as follows:

- Read current value of register
- Modify bits for the resource concerned
- Write register

#### VIS PAR. ADDRESS

The same as above. In this case, the ModBUS register address contains the visibility value of the parameter.

By default all parameters have:

- Data size 2 bit
- Range 0...3
- \*\*Visibility 3
- U.M. num

#### \*\*Value Meaning

- Value 3 = parameter or folder always visible
- Value 2 = **installer level**; these parameters can only be viewed by entering the manufacturer password (see parameter PS2) (all parameters specified as always visible, parameters visible at the installer level and manufacturer level will be visible)
- Value 1 = **user level**; these parameters can only be viewed by entering the installer password (see parameter PS1) (all parameters specified as always visible and parameters visible at the installer level will be visible)
- Value 0 = parameter or folder NOT visible

1. Parameters and/or folders with a level of visibility <>3 (password-protected) will be visible only if the correct password is entered (installer or user) following this procedure:
2. Parameters and/or folders with a level of visibility =3 are always visible even without a password: in this case, the following procedure is not necessary.



Examples (in binary form the least significant bit is the first on the right):

**Default visibility:**

| PAR. VALUE ADDRESS | DATA SIZE | Value |       | Content of register                         |
|--------------------|-----------|-------|-------|---|
| 49336.6            | 2 BIT     | 3     | 65535 | ------(00000000 <b>11</b> 1111111111111111) |
| 49337              | 2 BIT     | 3     | 65535 | (00000000111111 <b>11</b> 1111111111)       |
| 49337.2            | 2 BIT     | 3     | 65535 | (000000001111 <b>11</b> 1111111111)         |
| 49337.4            | 2 BIT     | 3     | 65535 | (000000001 <b>11</b> 111111111111)          |
| 49337.6            | 2 BIT     | 3     | 65535 | (00000000 <b>11</b> 111111111111)           |

**R/W**

Indicates the option of reading or writing the resource

- R The resource is read-only
- W The resource is write-only
- RW The resource can be both read and written

**DESCRIPTION**

This is the description of the meaning of **parameters** in the **LABEL** column.

**DATA SIZE**

Indicates the size of the data in bits.

- WORD = 16 bit
- Byte = 8 bit
- "n" bit = 0...15 bit based on the value of "n"

**CPL**

When the field indicates "Y", the value read by the register needs to be converted because the value represents a number with a sign. In the other cases the value is always positive or null.

To carry out conversion, proceed as follows:

- If the value in the register is between 0 and 32.767, the result is the value itself (zero and positive values)
- If the value in the register is between 32.768 and 65.535, the result is the value of the register - 65.536 (negative values)

**EXP**

**WHEN UTILISING MODBUS PROTOCOL ONLY**

If = -1 the value read by the register is divided by 10 (value/10) to convert it to the values indicated in the RANGE and DEFAULT columns

using the unit of measurement indicated in the column M.U.

Example: parameter HSE = 50.0. Column EXP = -1:

- The value read by the device/ParamManager is 50.0
- The value read by the register is 500 --> 500/10 = 50.0

**RANGE**

Describes the interval of values that can be assigned to the parameter. It can be correlated with other parameters in the instrument (indicated with the parameter label).

**U.M.**

Unit of measurement for values converted according to the rules indicated in the CPL and EXP columns.



### 9.3.7. PARAMETER/VISIBILITY TABLE

**NOTE:** ModBUS read command: 04 (0x04) and ModBUS write command: 22 (0x16)

| FOLDER | LABEL   | PAR. Value ADDRESS | Vis. PAR. ADDRESS | R/W | DESCRIPTION   | DATA SIZE | CPL | EXP | U.M.                | RANGE           |
|--------|---------|--------------------|-------------------|-----|---|-----------|-----|-----|---------------------|-----------------|
| /      | SEt     | 16386              | 49455             | RW  | Setpoint  | WORD      | Y   |     | °C/°F               | LSE...HSE       |
| CPr    | diF     | 16388              | 49455.2           | RW  | Setpoint differential   | WORD      | Y   | -1  | °C/°F               | 0 ... 30.0      |
| CPr    | HSE     | 16390              | 49455.4           | RW  | Maximum setpoint value that can be set  | WORD      | Y   | -1  | °C/°F               | LSE ... HdL     |
| CPr    | LSE     | 16392              | 49455.6           | RW  | Minimum setpoint value that can be set  | WORD      | Y   | -1  | °C/°F               | LdL ... HSE     |
| CPr    | OSP     | 16394              | 49456             | RW  | Offset on setpoint  | WORD      | Y   | -1  | °C/°F               | -30.0 ... 30.0  |
| CPr    | Cit     | 49235              | 49456.4           | RW  | Minimum compressor output activation time                                     | BYTE      |     |     | min                 | 0 ... 255       |
| CPr    | CAt     | 49236              | 49456.6           | RW  | Maximum compressor output activation time                                     | BYTE      |     |     | min                 | 0 ... 255       |
| CPr    | Ont     | 49237              | 49457             | RW  | ON time for compressor output with faulty control probe                       | BYTE      |     |     | min                 | 0 ... 255       |
| CPr    | OFt     | 49238              | 49457.2           | RW  | OFF time for compressor output with faulty control probe                      | BYTE      |     |     | min                 | 0 ... 255       |
| CPr    | dOn     | 49239              | 49457.4           | RW  | Compressor output activation delay from request                               | BYTE      |     |     | sec                 | 0 ... 255       |
| CPr    | dOF     | 49240              | 49457.6           | RW  | Compressor output activation delay from shutdown                              | BYTE      |     |     | min                 | 0 ... 255       |
| CPr    | dbi     | 49241              | 49458             | RW  | Delay between two consecutive starts of the compressor output                 | BYTE      |     |     | min                 | 0 ... 255       |
| CPr    | OdO     | 49242              | 49458.2           | RW  | Output activation delay from power-on   | BYTE      |     |     | min                 | 0 ... 255       |
| CPr    | dSC     | 49243              | 49458.4           | RW  | Compressor activation delay   | BYTE      |     |     | sec                 | 0 ... 255       |
| CPr    | dCS     | 16396              | 49458.6           | RW  | Deep Cooling setpoint   | WORD      | Y   | -1  | °C/°F               | -58.0 ... 302.0 |
| CPr    | tdc     | 16398              | 49459             | RW  | Deep Cooling Duration   | WORD      |     |     | min                 | 0 ... 600       |
| CPr    | dcc     | 49244              | 49459.2           | RW  | Defrost delay after deep cooling cycle.                                       | BYTE      |     |     | min                 | 0 ... 255       |
| dEF    | dtY     | 49245              | 49459.4           | RW  | Defrost mode  | BYTE      |     |     | num                 | 0...2           |
| dEF    | dit     | 49246              | 49459.6           | RW  | Interval between defrost cycles   | BYTE      |     |     | hours/<br>mins/secs | 0...255         |
| dEF    | dt1     | 49247              | 49460             | RW  | Unit of measurement for defrost interval                                      | BYTE      |     |     | num                 | 0/1/2           |
| dEF    | dt2     | 49248              | 49460.2           | RW  | Unit of measurement for defrost duration                                      | BYTE      |     |     | num                 | 0/1/2           |
| dEF    | dCt     | 49249              | 49460.4           | RW  | Defrost interval count mode   | BYTE      |     |     | num                 | 0...3           |
| dEF    | dOH     | 49250              | 49460.6           | RW  | Defrost interval count mode   | BYTE      |     |     | min                 | 0...59          |
| dEF    | dEt     | 49251              | 49461             | RW  | Evaporator 1 defrost timeout  | BYTE      |     |     | hours/<br>mins/secs | 1...255         |
| dEF    | dSt     | 16400              | 49461.2           | RW  | Probe 1 defrost end temperature   | WORD      | Y   | -1  | °C/°F               | -58.0...302.0   |
| dEF    | dS2     | 16402              | 49461.4           | RW  | Probe 2 defrost end temperature   | WORD      | Y   | -1  | °C/°F               | -58.0...302.0   |
| dEF    | dE2     | 49252              | 49461.6           | RW  | Evaporator 2 defrost timeout  | BYTE      |     |     | hours/<br>mins/secs | 1...250         |
| dEF    | dPO     | 49253              | 49462             | RW  | Defrost activation request from power-on                                      | BYTE      |     |     | flag                | 0/1             |
| dEF    | tcd     | 16404              | 49462.2           | RW  | Minimum compressor ON or OFF time before defrost                              | WORD      | Y   |     | min                 | -31...31        |
| dEF    | Code    | 49254              | 49462.4           | RW  | Time preceding a defrost, during which the compressor output is not activated | BYTE      |     |     | min                 | 0...60          |
| dEF    | dE1_h   | 49341              |                   | RW  | Defrost start time (minutes) no. 1 weekday                                    | BYTE      |     |     | hours               | 0 ... 24        |
| dEF    | dE1_min | 49340              |                   | RW  | Defrost start time (hours) no. 2 weekday                                      | BYTE      |     |     | min                 | 0 ... 59        |
| dEF    | dE2_h   | 49343              |                   | RW  | Defrost start time (minutes) no. 2 weekday                                    | BYTE      |     |     | hours               | 0 ... 24        |
| dEF    | dE2_min | 49342              |                   | RW  | Defrost start time (hours) no. 3 weekday                                      | BYTE      |     |     | min                 | 0 ... 59        |
| dEF    | dE3_h   | 49345              |                   | RW  | Defrost start time (minutes) no. 3 weekday                                    | BYTE      |     |     | hours               | 0 ... 24        |
| dEF    | dE3_min | 49344              |                   | RW  | Defrost start time (hours) no. 4 weekday                                      | BYTE      |     |     | min                 | 0 ... 59        |
| dEF    | dE4_h   | 49347              |                   | RW  | Defrost start time (minutes) no. 4 weekday                                    | BYTE      |     |     | hours               | 0 ... 24        |
| dEF    | dE4_min | 49346              |                   | RW  | Defrost start time (hours) no. 5 weekday                                      | BYTE      |     |     | min                 | 0 ... 59        |
| dEF    | dE5_h   | 49349              |                   | RW  | Defrost start time (minutes) no. 5 weekday                                    | BYTE      |     |     | hours               | 0 ... 24        |
| dEF    | dE5_min | 49348              |                   | RW  | Defrost start time (hours) no. 6 weekday                                      | BYTE      |     |     | min                 | 0 ... 59        |
| dEF    | dE6_h   | 49351              |                   | RW  | Defrost start time (minutes) no. 6 weekday                                    | BYTE      |     |     | hours               | 0 ... 24        |
| dEF    | dE6_min | 49350              |                   | RW  | Defrost start time (hours) no. 7 weekday                                      | BYTE      |     |     | min                 | 0 ... 59        |
| dEF    | dE7_h   | 49353              |                   | RW  | Defrost start time (minutes) no. 7 weekday                                    | BYTE      |     |     | hours               | 0 ... 24        |
| dEF    | dE7_min | 49352              |                   | RW  | Defrost start time (hours) no. 8 weekday                                      | BYTE      |     |     | min                 | 0 ... 59        |
| dEF    | dE8_h   | 49355              |                   | RW  | Defrost start time (minutes) no. 8 weekday                                    | BYTE      |     |     | hours               | 0 ... 24        |
| dEF    | dE8_min | 49354              |                   | RW  | Weekday defrost 3 duration  | BYTE      |     |     | min                 | 0 ... 59        |
| dEF    | F1_h    | 49357              |                   | RW  | Defrost start time (hours) no. 1 weekend                                      | BYTE      |     |     | hours               | 0 ... 24        |



| FOLDER | LABEL  | PAR. Value ADDRESS | Vis. PAR. ADDRESS | R/W | DESCRIPTION   | DATA SIZE | CPL | EXP | U.M.  | RANGE           |
|--------|--------|--------------------|-------------------|-----|---|-----------|-----|-----|-------|-----------------|
| dEF    | F1_min | 49356              |                   | RW  | Defrost start time (minutes) no. 1 weekend                    | BYTE      |     |     | min   | 0 ... 59        |
| dEF    | F2_h   | 49359              |                   | RW  | Defrost start time (hours) no. 2 weekend                      | BYTE      |     |     | hours | 0 ... 24        |
| dEF    | F2_min | 49358              |                   | RW  | Defrost start time (minutes) no. 2 weekend                    | BYTE      |     |     | min   | 0 ... 59        |
| dEF    | F3_h   | 49361              |                   | RW  | Defrost start time (hours) no. 3 weekend                      | BYTE      |     |     | hours | 0 ... 24        |
| dEF    | F3_min | 49360              |                   | RW  | Defrost start time (minutes) no. 3 weekend                    | BYTE      |     |     | min   | 0 ... 59        |
| dEF    | F4_h   | 49363              |                   | RW  | Defrost start time (hours) no. 4 weekend                      | BYTE      |     |     | hours | 0 ... 24        |
| dEF    | F4_min | 49362              |                   | RW  | Defrost start time (minutes) no. 4 weekend                    | BYTE      |     |     | min   | 0 ... 59        |
| dEF    | F5_h   | 49365              |                   | RW  | Defrost start time (hours) no. 5 weekend                      | BYTE      |     |     | hours | 0 ... 24        |
| dEF    | F5_min | 49364              |                   | RW  | Defrost start time (minutes) no. 5 weekend                    | BYTE      |     |     | min   | 0 ... 59        |
| dEF    | F6_h   | 49367              |                   | RW  | Defrost start time (hours) no. 6 weekend                      | BYTE      |     |     | hours | 0 ... 24        |
| dEF    | F6_min | 49366              |                   | RW  | Defrost start time (minutes) no. 6 weekend                    | BYTE      |     |     | min   | 0 ... 59        |
| dEF    | F7_h   | 49369              |                   | RW  | Defrost start time (hours) no. 7 weekend                      | BYTE      |     |     | hours | 0 ... 24        |
| dEF    | F7_min | 49368              |                   | RW  | Defrost start time (minutes) no. 7 weekend                    | BYTE      |     |     | min   | 0 ... 59        |
| dEF    | F8_h   | 49371              |                   | RW  | Defrost start time (hours) no. 8 weekend                      | BYTE      |     |     | hours | 0 ... 24        |
| dEF    | F8_min | 49370              |                   | RW  | Defrost start time (minutes) no. 8 weekend                    | BYTE      |     |     | min   | 0 ... 59        |
| FAn    | FPt    | 49255              | 49463             | RW  | FSt parameter mode  | BYTE      |     |     | flag  | 0/1             |
| FAn    | FSt    | 16406              | 49463.2           | RW  | Fans disabling temperature                                    | WORD      | Y   | -1  | °C/°F | -58.0...302.0   |
| FAn    | Fot    | 16408              | 49463.4           | RW  | Evaporator fans start temperature                             | WORD      | Y   | -1  | °C/°F | -58.0...302.0   |
| FAn    | FAd    | 16410              | 49463.6           | RW  | Fans differential   | WORD      |     | -1  | °C/°F | 0.1...25.0      |
| FAn    | Fdt    | 49256              | 49464             | RW  | Fan activation delay from compressor start                    | BYTE      |     |     | min   | 0...255         |
| FAn    | dt     | 49257              | 49464.2           | RW  | Dripping time   | BYTE      |     |     | min   | 0...255         |
| FAn    | dFd    | 49258              | 49464.4           | RW  | Evaporator fans mode in defrost                               | BYTE      |     |     | flag  | 0/1             |
| FAn    | FCO    | 49259              | 49464.6           | RW  | Evaporator fans mode  | BYTE      |     |     | num   | 0...4           |
| FAn    | FdC    | 49261              | 49465.2           | RW  | Fan switch-off delay from compressor stoppage                 | BYTE      |     |     | min   | 0...255         |
| FAn    | FOn    | 49262              | 49465.4           | RW  | Fans ON time in duty cycle                                    | BYTE      |     |     | min   | 0...255         |
| FAn    | FOF    | 49263              | 49465.6           | RW  | Fans OFF time in duty cycle                                   | BYTE      |     |     | min   | 0...255         |
| FAn    | SCF    | 16412              | 49466             | RW  | Condenser fans activation Setpoint                            | WORD      |     | -1  | °C/°F | -50.0...150.0   |
| FAn    | dCF    | 16414              | 49466.2           | RW  | Condenser fans activation differential                        | WORD      |     | -1  | °C/°F | -30.0...30.0    |
| FAn    | tCF    | 49264              | 49466.4           | RW  | Condenser fans switch-on delay after defrost                  | BYTE      |     |     | min   | 0...59          |
| FAn    | dCd    | 49265              | 49466.6           | RW  | Condenser fans exclusion during defrost                       | BYTE      |     |     | flag  | 0/1             |
| AL     | Att    | 49266              | 49467             | RW  | HAL and LAL parameter mode                                    | BYTE      |     |     | flag  | 0/1             |
| AL     | AFd    | 16416              | 49467.2           | RW  | Alarm setpoint differential                                   | WORD      |     | -1  | °C/°F | 0.1...50.0      |
| AL     | HAL    | 16418              | 49467.4           | RW  | Maximum alarm   | WORD      | Y   | -1  | °C/°F | LA1...302.0     |
| AL     | LAL    | 16420              | 49467.6           | RW  | Minimum alarm   | WORD      | Y   | -1  | °C/°F | -58.0...HA1     |
| AL     | PAO    | 49267              | 49468             | RW  | Alarm exclusion at power-on                                   | BYTE      |     |     | hours | 0...10          |
| AL     | dAO    | 16422              | 49468.2           | RW  | Alarm exclusion after defrost                                 | WORD      |     |     | min   | 0...255         |
| AL     | OAO    | 49268              | 49468.4           | RW  | Alarm signalling delay from door closure                      | BYTE      |     |     | hours | 0...10          |
| AL     | tdO    | 49269              | 49468.6           | RW  | Open door disabling time                                      | BYTE      |     |     | min   | 0...255         |
| AL     | tAO    | 49270              | 49469             | RW  | Temperature alarms signalling delay                           | BYTE      |     |     | min   | 0...255         |
| AL     | dAt    | 49271              | 49469.2           | RW  | Enable alarm at end of defrost                                | BYTE      |     |     | flag  | 0/1             |
| AL     | rLO    | 49272              | 49469.4           | RW  | External alarm switches off loads                             | BYTE      |     |     | num   | 0/1/2           |
| AL     | AOP    | 49273              | 49469.6           | RW  | Alarm output polarity   | BYTE      |     |     | flag  | 0 / 1           |
| AL     | PbA    | 49275              | 49470.2           | RW  | Probe enabled to signal temperature alarms (probe 1 and/or 3) | BYTE      |     |     | num   | 0 ... 3         |
| AL     | SA3    | 16424              | 49470.4           | RW  | Alarm setpoint related to probe 3                             | WORD      | Y   | -1  | °C/°F | -50.0 ... 150.0 |
| AL     | dA3    | 16426              | 49470.6           | RW  | Probe 3 alarm activation differential                         | WORD      | Y   | -1  | °C/°F | -30.0 ... 30.0  |
| AL     | tA3    | 49276              | 49471             | RW  | Alarm 3 signalling delay time                                 | BYTE      |     |     | min   | 0 ... 59        |
| AL     | ArE    | 49277              | 49471.2           | RW  | Enables alarm relay in the event of probe 3-related alarms    | BYTE      |     |     | num   | 0/1/2           |
| Lit    | dSd    | 49278              | 49471.4           | RW  | Enable light relay from door switch                           | BYTE      |     |     | flag  | 0/1             |
| Lit    | dLt    | 49279              | 49471.6           | RW  | Light relay deactivation delay                                | BYTE      |     |     | min   | 0...31          |
| Lit    | OFL    | 49280              | 49472             | RW  | Light key always disables light relay                         | BYTE      |     |     | flag  | 0/1             |
| Lit    | dOd    | 49281              | 49472.2           | RW  | Door switch switches off loads                                | BYTE      |     |     | num   | 0...3           |
| Lit    | dAd    | 49282              | 49472.4           | RW  | Activation delay for digital inputs                           | BYTE      |     |     | min   | 0...255         |
| Lit    | dOA    | 49285              | 49473.2           | RW  | Action forced by digital input                                | BYTE      |     |     | num   | 0...5           |
| Lit    | PEA    | 49286              | 49473.4           | RW  | Select DI for lock/unlock resources function                  | BYTE      |     |     | num   | 0...3           |



| FOLDER | LABEL   | PAR. Value ADDRESS | Vis. PAR. ADDRESS | R/W | DESCRIPTION   | DATA SIZE | CPL | EXP | U.M.  | RANGE        |
|--------|---------|--------------------|-------------------|-----|---|-----------|-----|-----|-------|--------------|
| Lit    | dCO     | 49287              | 49473.6           | RW  | Evaporator fan compressor activation/switch-off delay | BYTE      |     |     | min   | 0...255      |
| Lit    | dOC     | 49260              | 49465             | RW  | Compressor activation/switch-off delay after request  | BYTE      |     |     | min   | 0...255      |
| Lit    | dFO     | 49288              | 49474             | RW  | Evaporator fan activation/switch-off delay            | BYTE      |     |     | min   | 0...255      |
| Lit    | PEn     | 49334              | 49474.2           | RW  | Number of errors permitted                            | BYTE      |     |     | num   | 0...15       |
| Lit    | PEi     | 49335              | 49474.4           | RW  | Error count interval                                  | BYTE      |     |     | min   | 1...99       |
| nAd    | d0_E0   | 49372              | --                | RW  | Enable functions during events day 1                  | BYTE      |     |     | num   | 0 ... 8      |
| nAd    | d0_E1_h | 49397              | --                | RW  | Event start time (hours) day 1                        | BYTE      |     |     | hours | 0 ... 23     |
| nAd    | d0_E1_m | 49396              | --                | RW  | Event start time (minutes) day 1                      | BYTE      |     |     | min   | 0 ... 59     |
| nAd    | d0_E2   | 49380              | --                | RW  | Event duration day 1                                  | BYTE      |     |     | hours | 0 ... 72     |
| nAd    | d0_E3   | 49388              | --                | RW  | Enable defrost weekdays or weekends day 1             | BYTE      |     |     | flag  | 0 ... 1      |
| nAd    | d1_E0   | 49373              | --                | RW  | Enable functions during events day 2                  | BYTE      |     |     | num   | 0 ... 8      |
| nAd    | d1_E1_h | 49399              | --                | RW  | Event start time (hours) day 2                        | BYTE      |     |     | hours | 0 ... 23     |
| nAd    | d1_E1_m | 49398              | --                | RW  | Event start time (minutes) day 2                      | BYTE      |     |     | min   | 0 ... 59     |
| nAd    | d1_E2   | 49381              | --                | RW  | Event duration day 2                                  | BYTE      |     |     | hours | 0 ... 72     |
| nAd    | d1_E3   | 49389              | --                | RW  | Enable defrost weekdays or weekends day 2             | BYTE      |     |     | flag  | 0 ... 1      |
| nAd    | d2_E0   | 49374              | --                | RW  | Enable functions during events day 3                  | BYTE      |     |     | num   | 0 ... 8      |
| nAd    | d2_E1_h | 49401              | --                | RW  | Event start time (hours) day 3                        | BYTE      |     |     | hours | 0 ... 23     |
| nAd    | d2_E1_m | 49400              | --                | RW  | Event start time (minutes) day 3                      | BYTE      |     |     | min   | 0 ... 59     |
| nAd    | d2_E2   | 49382              | --                | RW  | Event duration day 3                                  | BYTE      |     |     | hours | 0 ... 72     |
| nAd    | d3_E3   | 49390              | --                | RW  | Enable defrost weekdays or weekends day 3             | BYTE      |     |     | flag  | 0 ... 1      |
| nAd    | d3_E0   | 49375              | --                | RW  | Enable functions during events day 4                  | BYTE      |     |     | num   | 0 ... 8      |
| nAd    | d3_E1_h | 49403              | --                | RW  | Event start time (hours) day 4                        | BYTE      |     |     | hours | 0 ... 23     |
| nAd    | d3_E1_m | 49402              | --                | RW  | Event start time (minutes) day 4                      | BYTE      |     |     | min   | 0 ... 59     |
| nAd    | d3_E2   | 49383              | --                | RW  | Event duration day 4                                  | BYTE      |     |     | hours | 0 ... 72     |
| nAd    | d3_E3   | 49391              | --                | RW  | Enable defrost weekdays or weekends day 4             | BYTE      |     |     | flag  | 0 ... 1      |
| nAd    | d4_E0   | 49376              | --                | RW  | Enable functions during events day 5                  | BYTE      |     |     | num   | 0 ... 8      |
| nAd    | d4_E1_h | 49405              | --                | RW  | Event start time (hours) day 5                        | BYTE      |     |     | hours | 0 ... 23     |
| nAd    | d4_E1_m | 49404              | --                | RW  | Event start time (minutes) day 5                      | BYTE      |     |     | min   | 0 ... 59     |
| nAd    | d4_E2   | 49384              | --                | RW  | Event duration day 5                                  | BYTE      |     |     | hours | 0 ... 72     |
| nAd    | d4_E3   | 49392              | --                | RW  | Enable defrost weekdays or weekends day 5             | BYTE      |     |     | flag  | 0 ... 1      |
| nAd    | d5_E0   | 49377              | --                | RW  | Enable functions during events day 6                  | BYTE      |     |     | num   | 0 ... 8      |
| nAd    | d5_E1_h | 49407              | --                | RW  | Event start time (hours) day 6                        | BYTE      |     |     | hours | 0 ... 23     |
| nAd    | d5_E1_m | 49406              | --                | RW  | Event start time (minutes) day 6                      | BYTE      |     |     | min   | 0 ... 59     |
| nAd    | d5_E2   | 49385              | --                | RW  | Event duration day 6                                  | BYTE      |     |     | hours | 0 ... 72     |
| nAd    | d5_E3   | 49393              | --                | RW  | Enable defrost weekdays or weekends day 6             | BYTE      |     |     | flag  | 0 ... 1      |
| nAd    | d6_E0   | 49378              | --                | RW  | Enable functions during events day 7                  | BYTE      |     |     | num   | 0 ... 8      |
| nAd    | d6_E1_h | 49409              | --                | RW  | Event start time (hours) day 7                        | BYTE      |     |     | hours | 0 ... 23     |
| nAd    | d6_E1_m | 49408              | --                | RW  | Event start time (minutes) day 7                      | BYTE      |     |     | min   | 0 ... 59     |
| nAd    | d6_E2   | 49386              | --                | RW  | Event duration day 7                                  | BYTE      |     |     | hours | 0 ... 72     |
| nAd    | d6_E3   | 49394              | --                | RW  | Enable defrost weekdays or weekends day 7             | BYTE      |     |     | flag  | 0 ... 1      |
| nAd    | d7_E0   | 49379              | --                | RW  | Enable functions during daily event (EVERY DAY)       | BYTE      |     |     | num   | 0 ... 8      |
| nAd    | d7_E1_h | 49411              | --                | RW  | Daily event start time                                | BYTE      |     |     | hours | 0 ... 23     |
| nAd    | d7_E1_m | 49410              | --                | RW  | Daily event start time (minutes)                      | BYTE      |     |     | min   | 0 ... 59     |
| nAd    | d7_E2   | 49387              | --                | RW  | Duration of daily event                               | BYTE      |     |     | hours | 0 ... 72     |
| nAd    | d7_E3   | 49395              | --                | RW  | Enable defrost weekdays or weekends daily event       | BYTE      |     |     | flag  | 0 ... 1      |
| Add    | PtS     | 49289              | 49474.6           | RW  | Protocol selection (0: Televis; 1: ModBUS)            | BYTE      |     |     | flag  | 0/1          |
| Add    | dEA     | 49290              | 49475             | RW  | Device address, Micronet                              | BYTE      |     |     | num   | 0...14       |
| Add    | FAA     | 49291              | 49475.2           | RW  | Family address, Micronet                              | BYTE      |     |     | num   | 0...14       |
| Add    | Adr     | 49422              | 49453.6           | RW  | ModBUS address  | BYTE      |     |     | num   | 1...255      |
| Add    | Pty     | 49292              | 49475.4           | RW  | Parity bit (ModBUS protocol)                          | BYTE      |     |     | num   | 0/1/2        |
| Add    | Pty     | 49293              | 49475.6           | RW  | ModBUS stop bit                                       | BYTE      |     |     | num   | 0/1          |
| Add    | bAU     | 49421              | 49454             | RW  | BaudRate  | BYTE      |     |     | num   | 0/1/2        |
| diS    | LOC     | 49294              | 49476             | RW  | Keypad lock   | BYTE      |     |     | flag  | 0/1          |
| diS    | PS1     | 16428              | 49476.2           | RW  | Password 1  | WORD      |     |     | num   | 0...999      |
| diS    | PS2     | 16430              | 49476.4           | RW  | Password 2  | WORD      |     |     | num   | 0...999      |
| diS    | PS3     | 16432              | 49476.6           | RW  | Password 3  | WORD      |     |     | num   | 0...999      |
| diS    | ndt     | 49295              | 49477             | RW  | Display with decimal point                            | BYTE      |     |     | flag  | 0/1          |
| diS    | CA1     | 16434              | 49477.2           | RW  | Calibration Pb1                                       | WORD      | Y   |     | °C/°F | -30.0...30.0 |



| FOLDER | LABEL | PAR. Value ADDRESS | Vis. PAR. ADDRESS | R/W | DESCRIPTION  | DATA SIZE | CPL | EXP | U.M.    | RANGE         |
|--------|-------|--------------------|-------------------|-----|--|-----------|-----|-----|---------|---------------|
| diS    | CA2   | 16436              | 49477.4           | RW  | Calibration Pb2  | WORD      | Y   |     | °C/°F   | -30.0...30.0  |
| diS    | CA3   | 16438              | 49477.6           | RW  | Calibration Pb3  | WORD      | Y   |     | °C/°F   | -30.0...30.0  |
| diS    | CA    | 49296              | 49478             | RW  | Calibration operation  | BYTE      |     |     | num     | 0/1/2         |
| diS    | LdL   | 16440              | 49478.2           | RW  | Minimum possible value   | WORD      | Y   |     | °C/°F   | -58.0...HdL   |
| diS    | HdL   | 16442              | 49478.4           | RW  | Maximum possible value   | WORD      | Y   |     | °C/°F   | LdL...302     |
| diS    | ddL   | 49297              | 49478.6           | RW  | Lock display during defrost                                      | BYTE      |     |     | num     | 0/1/2         |
| diS    | Ldd   | 49298              | 49479             | RW  | Unlock timeout "ddl"   | BYTE      |     |     | minutes | 0...255       |
| diS    | dro   | 49299              | 49479.2           | RW  | °C/°F selection. (0=°C, 1=°F)                                    | BYTE      |     |     | flag    | 0/1           |
| diS    | ddd   | 49300              | 49479.4           | RW  | Selection of main display value 1                                | BYTE      |     |     | num     | 0/1/2         |
| diS    | dd2   | 49420              | 49491.2           | RW  | Selection of main display value 2                                | BYTE      |     |     | flag    | 0/1           |
| HAC    | SHi   | 16444              | 49479.6           | RW  | Maximum HACCP alarm threshold, no delay                          | WORD      | Y   | -1  | °C/°F   | SHH ... 150.0 |
| HAC    | SLi   | 16446              | 49480             | RW  | Minimum HACCP alarm threshold, no delay                          | WORD      | Y   | -1  | °C/°F   | -50.0 ... SLH |
| HAC    | SHH   | 16448              | 49480.2           | RW  | Maximum HACCP alarm threshold                                    | WORD      | Y   | -1  | °C/°F   | SLH ... 150.0 |
| HAC    | SLH   | 16450              | 49480.4           | RW  | Minimum HACCP alarm threshold                                    | WORD      | Y   | -1  | °C/°F   | 50.0 ... SHH  |
| HAC    | drA   | 49301              | 49480.6           | RW  | Minimum dwelling time in critical area before alarm signalling   | BYTE      |     |     | min     | 0 ... 99      |
| HAC    | drH   | 49302              | 49481             | RW  | HACCP alarm reset time from last manual reset                    | BYTE      |     |     | hours   | 0 ... 255     |
| HAC    | H50   | 49303              | 49481.2           | RW  | Enable HACCP alarms storage with/without alarm relay enabling    | BYTE      |     |     | num     | 0/1/2         |
| HAC    | H51   | 49304              | 49481.4           | RW  | HACCP alarms storage disabling time (key or digital input)       | BYTE      |     |     | min     | 0 ... 255     |
| HAC    | H52   | 49305              | 49481.6           | RW  | Probe enabled to signal HACCP alarms                             | BYTE      |     |     | flag    | 1/3           |
| CnF    | H00   | 49306              | 49482             | RW  | Probe type Pb1-Pb2-Pb3 (1=NTC, 0=PTC)                            | BYTE      |     |     | flag    | 0/1           |
| CnF    | H01   | 49307              | 49482.2           |     | Enable deep cooling  | BYTE      |     |     | flag    | 0/1           |
| CnF    | H02   | 49308              | 49482.4           | RW  | Key activation time  | BYTE      |     |     | sec     | 0 ... 15      |
| CnF    | H06   | 49309              | 49482.6           | RW  | Key or auxiliary digital input/light on with device Off          | BYTE      | Y   |     | flag    | 0/1           |
| CnF    | H08   | 49310              | 49483             | RW  | Stand-by mode  | BYTE      |     |     | num     | 0 ... 3       |
| CnF    | H11   | 16452              | 49483.2           | RW  | DI1 input configuration  | BYTE      | Y   |     | num     | -20 ... 20    |
| CnF    | H12   | 16454              | 49483.4           | RW  | DI2 input configuration  | BYTE      | Y   |     | num     | -20 ... 20    |
| CnF    | H21   | 49311              | 49484.2           | RW  | Configuration relay 1  | BYTE      |     |     | num     | 0...13        |
| CnF    | H22   | 49312              | 49484.4           | RW  | Configuration relay 2  | BYTE      |     |     | num     | 0...13        |
| CnF    | H23   | 49313              | 49484.6           | RW  | Configuration relay 3  | BYTE      |     |     | num     | 0...13        |
| CnF    | H24   | 49314              | 49485             | RW  | Configuration relay 4  | BYTE      |     |     | num     | 0...13        |
| CnF    | H25   | 49315              | 49485.2           | RW  | Configuration relay 5  | BYTE      |     |     | num     | 0...13        |
| CnF    | H28   | 49318              | 49486             | RW  | Enable buzzer  | BYTE      |     |     | flag    | 0/1           |
| CnF    | H32   | 49320              | 49486.4           | RW  | Configuration of DOWN key  | BYTE      |     |     | num     | 0...15        |
| CnF    | H33   | 49321              | 49486.6           | RW  | ESC key configuration  | BYTE      |     |     | num     | 0...15        |
| CnF    | H34   | 49322              | 49487             | RW  | ON/OFF key configuration   | BYTE      |     |     | num     | 0...15        |
| CnF    | H35   | 49323              | 49487.2           | RW  | LIGHT key configuration  | BYTE      |     |     | num     | 0...15        |
| CnF    | H41   | 49327              | 49488.2           | RW  | Pb1 input configuration  | WORD      |     |     | flag    | 0/1           |
| CnF    | H42   | 49328              | 49488.4           | RW  | Pb2 input configuration  | WORD      |     |     | flag    | 0/1           |
| CnF    | H43   | 49329              | 49488.6           | RW  | Pb3 input configuration  | WORD      |     |     | num     | 0...3         |
| CnF    | H44   | 49330              | 49489             | RW  | Setpoint for Pb3-Pb1 temperature differential                    | WORD      |     |     | num     | 0...255       |
| CnF    | H45   | 49331              | 49489.2           | RW  | Start defrost mode for applications with double evaporator       | WORD      |     |     | num     | 0...2         |
| CnF    | H48   | 49332              | 49489.4           | RW  | Clock presence   | WORD      |     |     | flag    | 0/1           |
| CnF    | H60   | 49333              | 49489.6           | R   | Preset selection (Vectors and parameters selection)              | WORD      |     |     | num     | 0...8         |
| CnF    | rEL   | ---                | ---               | R   | Device version   | WORD      |     |     | num     | 0...3         |
| CnF    | tAb   | ---                | ---               | R   | Map code   | WORD      |     |     | num     | 0...3         |
| FrH    | HOn   | 49336              | 49490.4           | RW  | Frame Heater regulator output On time                            | BYTE      |     |     | min     | 0...255       |
| FrH    | HOF   | 49337              | 49490.6           | RW  | Frame Heater regulator output Off time                           | BYTE      |     |     | min     | 0...255       |
| FrH    | dt3   | 49338              | 49491             | RW  | Frame Heater regulator time standard unit of measurement         | BYTE      |     |     | num     | 0/1/2         |
| FPr    | UL    | --                 | --                | --  | Parameter transfer function visibility (Controller -> Copy Card) | 2 BIT     |     |     | num     | 0...3         |
| FPr    | dL    | --                 | --                | --  | Parameter transfer function visibility (Copy Card -> Controller) | 2 BIT     |     |     | num     | 0...3         |
| FPr    | Fr    | --                 | --                | --  | Copy Card formatting function visibility                         | 2 BIT     |     |     | num     | 0...3         |





### 9.3.8. PARAMETER/VISIBILITY H60 TABLE

| LABEL  | PAR. Value ADDRESS | Vis. PAR. ADDRESS | R/W | DESCRIPTION                                       | DATA SIZE | U.M.                | RANGE           |
|--------|--------------------|-------------------|-----|---|-----------|---------------------|-----------------|
| V0-SEt | 16752              | --                | RW  | Regulation setpoint                               | WORD      | °C/°F               | LSE ... HSE     |
| V0-diF | 16754              | --                | RW  | Setpoint differential                             | WORD      | °C/°F               | 0.1 ... 30.0    |
| V0-LSE | 16756              | --                | RW  | Minimum setpoint value that can be set            | WORD      | °C/°F               | LSE ... HdL     |
| V0-HSE | 16758              | --                | RW  | Maximum setpoint value that can be set            | WORD      | °C/°F               | LdL ... HSE     |
| V0-dSt | 16760              | --                | RW  | Defrost end temperature                           | WORD      | °C/°F               | -58.0 ... 302.0 |
| V0-FSt | 16762              | --                | RW  | Evaporator fans status with Off compressor output | WORD      | °C/°F               | -50.0 ... 150.0 |
| V0-dtY | 49532              | --                | RW  | Defrost mode                                      | BYTE      | num                 | 0/1/2           |
| V0-dit | 49533              | --                | RW  | Interval between defrost cycles                   | BYTE      | min                 | 0 ... 255       |
| V0-dCt | 49534              | --                | RW  | Defrost interval count mode                       | BYTE      | num                 | 0 ... 3         |
| V0-dOH | 49535              | --                | RW  | Defrost cycle activation delay from request       | BYTE      | min                 | 0 ... 59        |
| V0-dEt | 49536              | --                | RW  | Defrost timeout                                   | BYTE      | hours/<br>mins/secs | 1 ... 255       |
| V0-Fdt | 49537              | --                | RW  | Evaporator fans delay after defrost cycle         | BYTE      | min                 | 0 ... 255       |
| V0-dt  | 49538              | --                | RW  | Dripping time                                     | BYTE      | min                 | 0 ... 255       |
| V0-dPO | 49539              | --                | RW  | Defrost enabling request from power-on            | BYTE      | flag                | 0/1             |
| V0-ddL | 49540              | --                | RW  | Lock display during defrost mode                  | BYTE      | num                 | 0/1/2           |
| V0-dFd | 49541              | --                | RW  | Evaporator fans disabling during defrost time     | BYTE      | flag                | 0/1             |
| V1-SEt | 16774              | --                | RW  | Regulation setpoint                               | WORD      | °C/°F               | LSE ... HSE     |
| V1-diF | 16776              | --                | RW  | Setpoint differential                             | WORD      | °C/°F               | 0.1 ... 30.0    |
| V1-LSE | 16778              | --                | RW  | Minimum setpoint value that can be set            | WORD      | °C/°F               | LSE ... HdL     |
| V1-HSE | 16780              | --                | RW  | Maximum setpoint value that can be set            | WORD      | °C/°F               | LdL ... HSE     |
| V1-dSt | 16782              | --                | RW  | Defrost end temperature                           | WORD      | °C/°F               | -58.0 ... 302.0 |
| V1-FSt | 16784              | --                | RW  | Evaporator fans status with Off compressor output | WORD      | °C/°F               | -50.0 ... 150.0 |
| V1-dtY | 49554              | --                | RW  | Defrost mode                                      | BYTE      | num                 | 0/1/2           |
| V1-dit | 49555              | --                | RW  | Interval between defrost cycles                   | BYTE      | min                 | 0 ... 255       |
| V1-dCt | 49556              | --                | RW  | Defrost interval count mode                       | BYTE      | num                 | 0 ... 3         |
| V1-dOH | 49557              | --                | RW  | Defrost cycle enabling delay from request         | BYTE      | min                 | 0 ... 59        |
| V1-dEt | 49558              | --                | RW  | Defrost timeout                                   | BYTE      | hours/<br>mins/secs | 1 ... 255       |
| V1-Fdt | 49559              | --                | RW  | Evaporator fans delay after defrost cycle         | BYTE      | min                 | 0 ... 255       |
| V1-dt  | 49560              | --                | RW  | Dripping time                                     | BYTE      | min                 | 0 ... 255       |
| V1-dPO | 49561              | --                | RW  | Defrost enabling request from power-on            | BYTE      | flag                | 0/1             |
| V1-ddL | 49562              | --                | RW  | Lock display during defrost mode                  | BYTE      | num                 | 0/1/2           |
| V1-dFd | 49563              | --                | RW  | Evaporator fans disabling during defrost time     | BYTE      | flag                | 0/1             |
| V2-SEt | 16796              | --                | RW  | Regulation setpoint                               | WORD      | °C/°F               | LSE ... HSE     |
| V2-diF | 16798              | --                | RW  | Setpoint differential                             | WORD      | °C/°F               | 0.1 ... 30.0    |
| V2-LSE | 16800              | --                | RW  | Minimum setpoint value that can be set            | WORD      | °C/°F               | LSE ... HdL     |
| V2-HSE | 16802              | --                | RW  | Maximum setpoint value that can be set            | WORD      | °C/°F               | LdL ... HSE     |
| V2-dSt | 16804              | --                | RW  | Defrost end temperature                           | WORD      | °C/°F               | -58.0 ... 302.0 |
| V2-FSt | 16806              | --                | RW  | Evaporator fans status with Off compressor output | WORD      | °C/°F               | -50.0 ... 150.0 |
| V2-dtY | 49576              | --                | RW  | Defrost mode                                      | BYTE      | num                 | 0/1/2           |
| V2-dit | 49577              | --                | RW  | Interval between defrost cycles                   | BYTE      | min                 | 0 ... 255       |
| V2-dCt | 49578              | --                | RW  | Defrost interval count mode                       | BYTE      | num                 | 0 ... 3         |
| V2-dOH | 49579              | --                | RW  | Defrost cycle activation delay from request       | BYTE      | min                 | 0 ... 59        |
| V2-dEt | 49580              | --                | RW  | Defrost timeout                                   | BYTE      | hours/<br>mins/secs | 1 ... 255       |
| V2-Fdt | 49581              | --                | RW  | Evaporator fans delay after defrost cycle         | BYTE      | min                 | 0 ... 255       |
| V2-dt  | 49582              | --                | RW  | Dripping time                                     | BYTE      | min                 | 0 ... 255       |
| V2-dPO | 49583              | --                | RW  | Defrost enabling request from power-on            | BYTE      | flag                | 0/1             |
| V2-ddL | 49584              | --                | RW  | Lock display during defrost mode                  | BYTE      | num                 | 0/1/2           |
| V2-dFd | 49585              | --                | RW  | Evaporator fans disabling during defrost time     | BYTE      | flag                | 0/1             |
| V3-SEt | 16818              | --                | RW  | Regulation setpoint                               | WORD      | °C/°F               | LSE ... HSE     |
| V3-diF | 16820              | --                | RW  | Setpoint differential                             | WORD      | °C/°F               | 0.1 ... 30.0    |
| V3-LSE | 16822              | --                | RW  | Minimum setpoint value that can be set            | WORD      | °C/°F               | LSE ... HdL     |
| V3-HSE | 16824              | --                | RW  | Maximum setpoint value that can be set            | WORD      | °C/°F               | LdL ... HSE     |



|        |       |    |    |   |      |                     |                 |
|--------|-------|----|----|---|------|---------------------|-----------------|
| V3-dSt | 16826 | -- | RW | Defrost end temperature                           | WORD | °C/°F               | -58.0 ... 302.0 |
| V3-FSt | 16828 | -- | RW | Evaporator fans status with Off compressor output | WORD | °C/°F               | -50.0 ... 150.0 |
| V3-dtY | 49598 | -- | RW | Defrost mode                                      | BYTE | num                 | 0/1/2           |
| V3-dit | 49599 | -- | RW | Interval between defrost cycles                   | BYTE | min                 | 0 ... 255       |
| V3-dCt | 49600 | -- | RW | Defrost interval count mode                       | BYTE | num                 | 0 ... 3         |
| V3-dOH | 49601 | -- | RW | Defrost cycle activation delay from request       | BYTE | min                 | 0 ... 59        |
| V3-dEt | 49602 | -- | RW | Defrost timeout                                   | BYTE | hours/<br>mins/secs | 1 ... 255       |
| V3-Fdt | 49603 | -- | RW | Evaporator fans delay after defrost cycle         | BYTE | min                 | 0 ... 255       |
| V3-dt  | 49604 | -- | RW | Dripping time                                     | BYTE | min                 | 0 ... 255       |
| V3-dPO | 49605 | -- | RW | Defrost enabling request from power-on            | BYTE | flag                | 0/1             |
| V3-ddL | 49606 | -- | RW | Lock display during defrost mode                  | BYTE | num                 | 0/1/2           |
| V3-dFd | 49607 | -- | RW | Evaporator fans disabling during defrost time     | BYTE | flag                | 0/1             |
| V4-SEt | 16840 | -- | RW | Regulation setpoint                               | WORD | °C/°F               | LSE ... HSE     |
| V4-diF | 16842 | -- | RW | Setpoint differential                             | WORD | °C/°F               | 0.1 ... 30.0    |
| V4-LSE | 16844 | -- | RW | Minimum setpoint value that can be set            | WORD | °C/°F               | LSE ... HdL     |
| V4-HSE | 16846 | -- | RW | Maximum setpoint value that can be set            | WORD | °C/°F               | LdL ... HSE     |
| V4-dSt | 16848 | -- | RW | Defrost end temperature                           | WORD | °C/°F               | -58.0 ... 302.0 |
| V4-FSt | 16850 | -- | RW | Evaporator fans status with Off compressor output | WORD | °C/°F               | -50.0 ... 150.0 |
| V4-dtY | 49620 | -- | RW | Defrost mode                                      | BYTE | num                 | 0/1/2           |
| V4-dit | 49621 | -- | RW | Interval between defrost cycles                   | BYTE | min                 | 0 ... 255       |
| V4-dCt | 49622 | -- | RW | Defrost interval count mode                       | BYTE | num                 | 0 ... 3         |
| V4-dOH | 49623 | -- | RW | Defrost cycle activation delay from request       | BYTE | min                 | 0 ... 59        |
| V4-dEt | 49624 | -- | RW | Defrost timeout                                   | BYTE | hours/<br>mins/secs | 1 ... 255       |
| V4-Fdt | 49625 | -- | RW | Evaporator fans delay after defrost cycle         | BYTE | min                 | 0 ... 255       |
| V4-dt  | 49626 | -- | RW | Dripping time                                     | BYTE | min                 | 0 ... 255       |
| V4-dPO | 49627 | -- | RW | Defrost enabling request from power-on            | BYTE | flag                | 0/1             |
| V4-ddL | 49628 | -- | RW | Lock display during defrost mode                  | BYTE | num                 | 0/1/2           |
| V4-dFd | 49629 | -- | RW | Evaporator fans disabling during defrost time     | BYTE | flag                | 0/1             |
| V5-SEt | 16862 | -- | RW | Regulation setpoint                               | WORD | °C/°F               | LSE ... HSE     |
| V5-diF | 16864 | -- | RW | Setpoint differential                             | WORD | °C/°F               | 0.1 ... 30.0    |
| V5-LSE | 16866 | -- | RW | Minimum setpoint value that can be set            | WORD | °C/°F               | LSE ... HdL     |
| V5-HSE | 16868 | -- | RW | Maximum setpoint value that can be set            | WORD | °C/°F               | LdL ... HSE     |
| V5-dSt | 16870 | -- | RW | Defrost end temperature                           | WORD | °C/°F               | -58.0 ... 302.0 |
| V5-FSt | 16872 | -- | RW | Evaporator fans status with Off compressor output | WORD | °C/°F               | -50.0 ... 150.0 |
| V5-dtY | 49642 | -- | RW | Defrost mode                                      | BYTE | num                 | 0/1/2           |
| V5-dit | 49643 | -- | RW | Interval between defrost cycles                   | BYTE | min                 | 0 ... 255       |
| V5-dCt | 49644 | -- | RW | Defrost interval count mode                       | BYTE | num                 | 0 ... 3         |
| V5-dOH | 49645 | -- | RW | Defrost cycle enabling delay from request         | BYTE | min                 | 0 ... 59        |
| V5-dEt | 49646 | -- | RW | Defrost timeout                                   | BYTE | hours/<br>mins/secs | 1 ... 255       |
| V5-Fdt | 49647 | -- | RW | Evaporator fans delay after defrost cycle         | BYTE | min                 | 0 ... 255       |
| V5-dt  | 49648 | -- | RW | Dripping time                                     | BYTE | min                 | 0 ... 255       |
| V5-dPO | 49649 | -- | RW | Defrost activation request from power-on          | BYTE | flag                | 0/1             |
| V5-ddL | 49650 | -- | RW | Lock display during defrost mode                  | BYTE | num                 | 0/1/2           |
| V5-dFd | 49651 | -- | RW | Evaporator fans disabling during defrost time     | BYTE | flag                | 0/1             |





### 9.3.9. FOLDER VISIBILITY TABLE

| LABEL   | ModBUS ADDRESS | R/W | DESCRIPTION    | DATA SIZE | RANGE   | U.M. |
|---------|----------------|-----|----------------|-----------|---------|------|
| vis_CPr | 49450          | RW  | Display folder | 2 bit     | 0 ... 3 | num  |
| vis_dEF | 49450.2        | RW  | Display folder | 2 bit     | 0 ... 3 | num  |
| vis_FAn | 49450.6        | RW  | Display folder | 2 bit     | 0 ... 3 | num  |
| vis_ALr | 49451          | RW  | Display folder | 2 bit     | 0 ... 3 | num  |
| vis_Lit | 49451.2        | RW  | Display folder | 2 bit     | 0 ... 3 | num  |
| vis_nAd | 49450.4        | RW  | Display folder | 2 bit     | 0 ... 3 | num  |
| vis_Add | 49451.4        | RW  | Display folder | 2 bit     | 0 ... 3 | num  |
| vis_diS | 49451.6        | RW  | Display folder | 2 bit     | 0 ... 3 | num  |
| vis_HAC | 49452          | RW  | Display folder | 2 bit     | 0 ... 3 | num  |
| vis_CnF | 49452.2        | RW  | Display folder | 2 bit     | 0 ... 3 | num  |
| vis_FrH | 49452.4        | RW  | Display folder | 2 bit     | 0 ... 3 | num  |
| vis_FPr | 49452.6        | RW  | Display folder | 2 bit     | 0 ... 3 | num  |

### 9.3.10. CLIENT TABLE

**NOTE:** ModBUS read command: 03 (0x03) and ModBUS write command: 16 (0x10)

| LABEL                      | ADDRESS | R/W | DESCRIPTION                              | DATA SIZE | RANGE           | U.M.  |
|----------------------------|---------|-----|--|-----------|-----------------|-------|
| AI1                        | 337     |     | Analogue input (display) 1               | WORD      | -58.0 ... 302.0 | °C/°F |
| AI2                        | 339     |     | Analogue input (display) 2               | WORD      | -58.0 ... 302.0 | °C/°F |
| AI3                        | 341     |     | Analogue input (display) 3               | WORD      | -58.0 ... 302.0 | °C/°F |
| ValSondeReg[0]             | 345     |     | Analogue input (regulation) 1            | WORD      | -58.0 ... 302.0 | °C/°F |
| ValSondeReg[1]             | 347     |     | Analogue input (regulation) 2            | WORD      | -58.0 ... 302.0 | °C/°F |
| ValSondeReg[2]             | 349     |     | Analogue input (regulation) 3            | WORD      | -58.0 ... 302.0 | °C/°F |
| DI1                        | 33130.4 |     | Digital input 1                          | 1 bit     | 0 ... 1         | flag  |
| DI2                        | 33130.3 |     | Digital input 2                          | 1 bit     | 0 ... 1         | flag  |
| DI3                        | 33130.2 |     | Digital input 3                          | 1 bit     | 0 ... 1         | flag  |
| DI4                        | 33130.1 |     | Digital input 4                          | 1 bit     | 0 ... 1         | flag  |
| HA1                        | 33085.5 |     | Analogue input 1 high threshold exceeded | 1 bit     | 0 ... 1         | flag  |
| LA1                        | 33085.6 |     | Analogue input 1 low threshold exceeded  | 1 bit     | 0 ... 1         | flag  |
| HA3                        | 33085   |     | Analogue input 3 high threshold exceeded | 1 bit     | 0 ... 1         | flag  |
| LA3                        | 33085.3 |     | Analogue input 3 low threshold exceeded  | 1 bit     | 0 ... 1         | flag  |
| EAL                        | 33085.4 |     | External                                 | 1 bit     | 0 ... 1         | flag  |
| PA                         | 33084.7 |     | Pressure switch                          | 1 bit     | 0 ... 1         | flag  |
| OPd                        | 33085.7 |     | Door open                                | 1 bit     | 0 ... 1         | flag  |
| Pan                        | 33084.1 |     | Man in cold room alarm                   | 1 bit     | 0 ... 1         | flag  |
| LPA                        | 33084.2 |     | Low pressure switch                      | 1 bit     | 0 ... 1         | flag  |
| HPA                        | 33084.3 |     | High pressure switch                     | 1 bit     | 0 ... 1         | flag  |
| E10                        | 33084.6 |     | Faulty clock alarm                       | 1 bit     | 0 ... 1         | flag  |
| Ad2                        | 33160   |     | Defrost timeout                          | 1 bit     | 0 ... 1         | flag  |
| Prr                        | 33099.2 |     | Preheat input regulator                  | 1 bit     | 0 ... 1         | flag  |
| E1                         | 33085.1 |     | Analogue input 1 fault                   | 1 bit     | 0 ... 1         | flag  |
| E2                         | 33085.2 |     | Analogue input 2 fault                   | 1 bit     | 0 ... 1         | flag  |
| E3                         | 33084.5 |     | Analogue input 3 fault                   | 1 bit     | 0 ... 1         | flag  |
| HACCP                      | 33163.2 |     | HACCP alarm                              | 1 bit     | 0 ... 1         | flag  |
| OnOff                      | 33089.1 |     | Device status                            | 1 bit     | 0 ... 1         | flag  |
| dEF_1                      | 33092.4 |     | Defrost 1                                | 2 bit     | 0 ... 1         | flag  |
| dEF_2                      | 33100.2 |     | Defrost 2                                | 2 bit     | 0 ... 1         | flag  |
| OSP                        | 33089   |     | Economy                                  | 1 bit     | 0 ... 1         | flag  |
| AUX                        | 33089.4 |     | Auxiliary                                | 1 bit     | 0 ... 1         | flag  |
| FrameH                     | 33101.6 |     | Demisting heaters                        | 1 bit     | 0 ... 1         | flag  |
| LIGHT                      | 33089.2 |     | Light                                    | 1 bit     | 0 ... 1         | flag  |
| Manutenzione (Maintenance) | 33090.4 |     | Maintenance                              | 1 bit     | 0 ... 1         | flag  |
| COMP1                      | 33092.3 |     | Compressor 1                             | 1 bit     | 0 ... 1         | flag  |
| COMP2                      | 33099.4 |     | Compressor 2                             | 1 bit     | 0 ... 1         | flag  |
| FAN_EVAP                   | 33094.7 |     | Evaporator 1 fans                        | 1 bit     | 0 ... 1         | flag  |
| FAN COND                   | 33102.7 |     | Condenser 1 fans                         | 1 bit     | 0 ... 1         | flag  |



| LABEL           | ADDRESS | R/W | DESCRIPTION                         | DATA SIZE | RANGE   | U.M. |
|-----------------|---------|-----|-------------------------------------|-----------|---------|------|
| DOOR            | 33096.3 |     | Door status                         | 1 bit     | 0 ... 1 | flag |
| Alarm           | 33097.5 |     | Alarm status                        | 1 bit     | 0 ... 1 | flag |
| Deep Cooling    | 33102.5 |     | Deep Cooling                        | 1 bit     | 0 ... 1 | flag |
| Pump Down       | 33102.4 |     | Pump Down                           | 1 bit     | 0 ... 1 | flag |
| LIGHT_ON        | 33057   |     | Lights on                           | 1 bit     | 0 ... 1 | num  |
| LIGHT_OFF       | 33057.1 |     | Lights off                          | 1 bit     | 0 ... 1 | num  |
| OSP_ON          | 33057.2 |     | Economy mode On                     | 1 bit     | 0 ... 1 | num  |
| OSP_OFF         | 33057.3 |     | Economy mode Off                    | 1 bit     | 0 ... 1 | num  |
| AUX_ON          | 33057.4 |     | Auxiliary output On                 | 1 bit     | 0 ... 1 | num  |
| AUX_OFF         | 33057.5 |     | Auxiliary output Off                | 1 bit     | 0 ... 1 | num  |
| ON              | 33057.6 |     | Instrument on                       | 1 bit     | 0 ... 1 | num  |
| OFF             | 33057.7 |     | Instrument off                      | 1 bit     | 0 ... 1 | num  |
| SILENT          | 33058   |     | Alarm acknowledgement               | 1 bit     | 0 ... 1 | num  |
| DEF             | 33058.1 |     | Manual defrost activation           | 1 bit     | 0 ... 1 | num  |
| NIGHTDAY_OFF    | 33058.5 |     | Disable Night & Day function        | 1 bit     | 0 ... 1 | num  |
| NIGHTDAY_ON     | 33058.6 |     | Enable Night & Day function         | 1 bit     | 0 ... 1 | num  |
| LOCK_KBD        | 33059   |     | Keypad lock                         | 1 bit     | 0 ... 1 | num  |
| UNLOCK_KBD      | 33059.1 |     | Unlock keypad                       | 1 bit     | 0 ... 1 | num  |
| RST_HACCP       | 33059.2 |     | Reset HACCP alarms                  | 1 bit     | 0 ... 1 | num  |
| RST_PRESS       | 33059.3 |     | Reset Pressure switch alarms        | 1 bit     | 0 ... 1 | num  |
| FRAMEHEATER_ON  | 33059.4 |     | Frame Heater regulator activation   | 1 bit     | 0 ... 1 | num  |
| FRAMEHEATER_OFF | 33059.5 |     | Frame Heater regulator deactivation | 1 bit     | 0 ... 1 | num  |
| HACCP_OFF       | 33059.6 |     | Disable HACCP alarm recording       | 1 bit     | 0 ... 1 | num  |
| HACCP_ON        | 33059.7 |     | Enable HACCP alarm recording        | 1 bit     | 0 ... 1 | num  |
| DEEP_COOL       | 33060   |     | Deep Cooling regulator activation   | 1 bit     | 0 ... 1 | num  |

## 10. ADVANCED FUNCTIONS - NIGHT AND DAY



Events and cycles can be programmed at set times during the week using the Night&Day regulator algorithm. The parameters concerned are contained in folder **nAd** / sub-folder **d0...d6, Ed**.

**IMPORTANT:** do not confuse labels **E0 ... E3** with probe error messages **E1 ... E2**.

**IMPORTANT:** be careful as to how **E0 = 3** (stand-by regulator) is used. You may not have access to the device for the duration of the event set in **E2**.

### 10.1. DAY/NIGHT REGULATOR OPERATION

Different events for days of the week.

For each day of the week, indicated by parameters/(sub-folders) **d0 ... d6**, you can set:

- a time for the start of the event (**E1, in the format HH:mm**)
- the duration (**E2**)
- which functions to enable (**E0**) for the event
- which defrost group to enable (**dE1..dE8 weekdays** or **F1...F8 weekends/public holidays**) (**E3**).

Parameters **E0 ... E3** can be different for each day.

According to the time set, E1 is the start time, usually set for the Reduced set (Economy) function ("NIGHT" mode). The duration is determined by parameter E2. In this mode, parameter E0 allows you to:

- Activate the reduced set functions.
- Activate the light regulator.
- Activate the aux regulator.
- Activate the stand-by regulator.

You can also decide whether to enable defrost during weekdays (E3 = 0) and weekends/public holidays (E3 = 1).

**ATTENZIONE:** bear in mind that parameter **E3** has no effect on the daily event settings.

#### Daily event

Using the same parameters, E0 ... E3 in the (sub-)folder Ed, you can also program a daily event, i.e. one that runs every day. Defrosts cannot be managed with this function. Hence parameter E3 in (sub-) folder d7 is not listed.

Daily or weekly events all have the same priority.

Days of the week correspond to these parameters:

Meaning of LEDs:

| Par.      | Day of the week         | Day #                          |
|-----------|-------------------------|--------------------------------|
| <b>d0</b> | Sunday                  | <b>day 1</b>                   |
| d1        | Monday                  | <b>day 2</b>                   |
| d2        | Tuesday                 | <b>day 3</b>                   |
| d3        | Wednesday               | <b>day 4</b>                   |
| d4        | Thursday                | <b>day 5</b>                   |
| d5        | Friday                  | <b>day 6</b>                   |
| d6        | Saturday                | <b>day 7</b>                   |
| d7        | Daily event (Every Day) | <b>Daily event (Every Day)</b> |



## 10.2. OPERATION WITH DEFROST GROUP

If E0 is not equal to 0, the meaning of weekday parameters dE1...dE8 shifts from:

Defrost group valid EVERY day (see Automatic defrost with Real Time Clock)

to:

Defrost group applicable only to weekdays.

The weekday parameters dE1...dE8 are supplemented with the management of weekend/public holiday parameters F1...F8.

Both folders still make use of the conditions for defrost at a pre-established time.

Hence for each day d0...d6 we can determine whether:

- E3 = 0, so that defrosts run at the times set in dE1...dE8.
- E3 = 1, so that defrosts run at the times set in F1...F8.

Example.

Supposing you set these time configurations:

- 3 "weekend" defrosts (when the chiller cabinet is not being intensively used)
  - 2 am (F1=> h02 '00)
  - 10 am (F2=> h10 '00)
  - 6 pm (F3=> h18 '00)
- 4 defrosts on "weekdays" (or days when the chiller cabinet is used intensively)
  - 5 am (dE1=> h05 '00)
  - 11 am (dE2=> h11 '00)
  - 5 pm (dE3=> h17 '00)
  - 11 pm (dE4=> h23 '00)

if the days considered as weekends/holidays are Sunday and Monday, this means the day settings will be:

- d0 / E3 = 1 (Sunday = "weekend" day)
- d1 / E3 = 1 (Monday = "weekend" day)
- d2 / E3 = 0 (Tuesday = "weekday")
- d3 / E3 = 0 (Wednesday = "weekday")
- d4 / E3 = 0 (Thursday = "weekday")
- d5 / E3 = 0 (Friday = "weekday")
- d6 / E3 = 0 (Saturday = "weekday")

## 10.3. DAY/NIGHT REGULATOR DURING A BLACKOUT

- If a blackout occurs during the activation period of a day/night status (i.e. caused by a day/night event), and power is restored:
  - During this event, the instrument will return to the status implemented at the time of the blackout, before disabling the event at the programmed time.
  - If it occurs after this event but before the next day/night event, the device starts up as if it has disabled the day/night event during which the blackout occurred.
  - If it occurs after this event but during the next day/night event, the device starts up as if it has disabled the day/night event during which the blackout occurred, before switching to the status requested by the day/night event underway when power was restored.
- Manual events (key or digital input) have priority over the day/night status until the next day/night event (event that either disables the current status or activates the next one) if the power supply is uninterrupted.
- If a manual event inverts the status set by the day/night function within the day/night status activation period and this is followed by a blackout, and power is restored:
  - During the activation period of the same day/night status, the controller will return to the status set by the manual event before disabling the event at the programmed time.
  - If it occurs after this event, the device starts in the status set by the manual event.
  - If it occurs after this event but during the activation period of the next day/night event, the controller switches to the status requested by the day/night event concerned before disabling the event at the programmed time.



## 10.4. OPENING FOLDER NAD - DAY/NIGHT

| Display | Description   |
|---------|---|
|         | Press SET for 3 seconds   |
|         | Folder USr appears<br>Use the UP & DOWN keys to search for the InS folder<br>Press and release the SET key  |
|         | Use the UP & DOWN keys to search for the nAd folder   |
|         | Press and release the SET key<br>Press and release the SET key to open the folder   |
|         | The first day, d0, appears<br>Scroll using 'UP' and 'DOWN' to access the other days<br>d1...d6 and Every Day d7<br>Press and release the SET key  |
|         | The first parameter E0 appears<br>Press and release the SEt key to modify it<br>The E0 label will blink<br>Use the UP & DOWN keys to adjust its value   |
|         | The first parameter E0 appears<br>Press and release the SEt key to modify it<br>The E0 label will blink<br>Use the UP & DOWN keys to adjust its value   |
|         | Press the ESC key several times<br>to return to the normal display, or repeat the procedure<br>to modify another parameter<br><br>NOTE: in the case of parameter E1, the clock LED will<br>switch on.<br>Modification takes place in the same way as the time<br>setting procedure (see User Interface) |

## 11. ADVANCED FUNCTIONS - HACCP



To meet the minimum requirements prescribed in HACCP regulations, there is a set of dedicated parameters. These parameters can be viewed and configured in folder:

### **HACCP (folder with label "HAC")**

The recording of HACCP alarms can be enabled in parameter H50≠0.

**IMPORTANT! SWITCH THE INSTRUMENT OFF AND ON AGAIN AFTER MODIFYING PARAMETER H50.**

HACCP alarm START and storing begins every time the alarms are cleared - see paragraph Deleting HACCP alarms.

These parameters record and file the high and low temperature alarms for cold room probe Pb1 or display probe Pb3, as well as any instrument power failures.

In addition to alarms, these parameters also record any controller blackouts, saving the number of blackouts that have occurred since the last time the machine was stopped.

Alarms for the HACCP function are managed independently from the rest of the regulators.

Each HACCP alarm consists of a folder containing the following information:

- alarm number: up to 40 alarms can be saved: 20 for high/low temperature and 20 for power failure
- type of alarm: Ht (high temperature), Lt (low temperature) and PF (Power failure)
- time/date and duration of all alarms
- maximum or minimum temperature, with corresponding time/date, reached during the event.

### **SLi, SHi parameters      Instant HACCP alarm**

When a temperature value exceeds the range defined by parameters SLi and SHi, an HACCP alarm is signalled and recorded.









This threshold indicates the limit beyond which the food concerned would deteriorate irreparably, even for brief periods of time.

### **SLL, SHH parameters      HACCP alarm**

When a temperature value exceeds the range defined by parameters SLL and SHH for a time greater than the drA parameter, a HACCP alarm is signalled and displayed.



## 11.1. DISPLAYING HACCP ALARMS

| Display   | Description  |
|---|--|
|    | <p>The red HACCP LED will remain permanently on to indicate an HACCP alarm has occurred<br/>Press and release the UP key</p> <p>The upper display will show ALr<br/>If HACCP alarms have occurred the lower display will show HACCP<br/>Press and release the SET key</p>  |
|    | <p>To access the information contained within each AHC folder, press the 'set' key</p>   |
|    | <p>The clock LED will be permanently on</p> <p>In fact, label StA will be shown on the upper display, while the alarm start time will appear on the lower display</p> <p>Use the DOWN key to scroll through the other alarm data</p>                                       |
|   | <p>The date LED will be permanently on</p> <p>In fact, label StA will be shown on the upper display, while the alarm activation date will appear on the lower display</p> <p>Use the DOWN key to scroll through the other alarm data</p>                                   |
|  | <p>Label dur will be shown on the upper display, while the alarm duration will appear on the lower display<br/>In HH:mm<br/>If --.-- appears, the alarm is still active</p> <p>Use the DOWN key to scroll through the other alarm data</p>                                 |
|  | <p>The clock LED will be permanently on</p> <p>...and the maximum temperature measured by the probe during the alarm (on the upper display) will be displayed along with the relative time (lower display)<br/>Use the DOWN key to scroll through the other alarm data</p> |
|  | <p>The clock LED will be permanently on</p> <p>...and the maximum temperature measured by the probe during the alarm (on the upper display) will be displayed along with the relative date (lower display)<br/>Use the DOWN key to scroll through the other alarm data</p> |
|  | <p>To return to the alarm display screen (label AHC) press the ESC key once</p> <p>Press the ESC key several times to return to the normal display</p>   |

## Eliwell Controls s.r.l.

Via dell'Industria, 15 • Z.I. Paludi  
32010 Pieve d'Alpago (BL) ITALY  
T +39 0437 986 111

[www.eliwell.com](http://www.eliwell.com)

## Technical Customer Support:

T +39 0437 986 300  
E [techsuppeliwell@schneider-electric.com](mailto:techsuppeliwell@schneider-electric.com)

## Sales

T +39 0437 986 100 (Italy)  
T +39 0437 986 200 (other countries)  
E [saleseliwell@schneider-electric.com](mailto:saleseliwell@schneider-electric.com)

